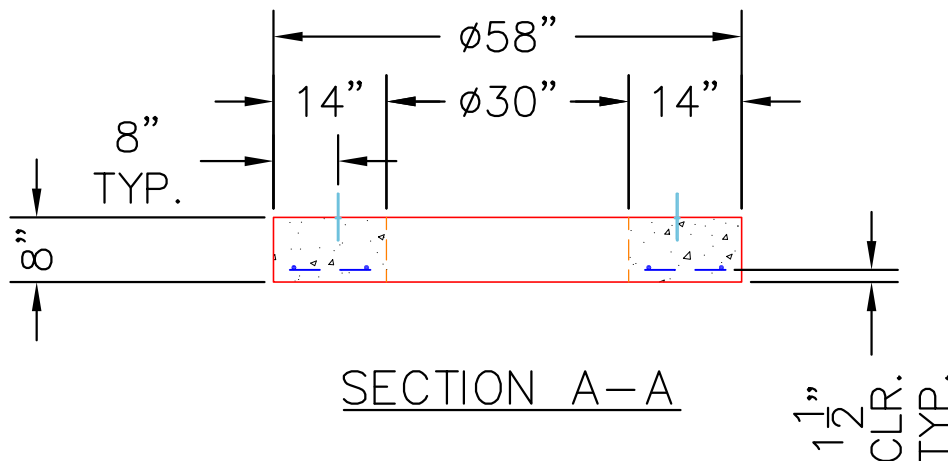
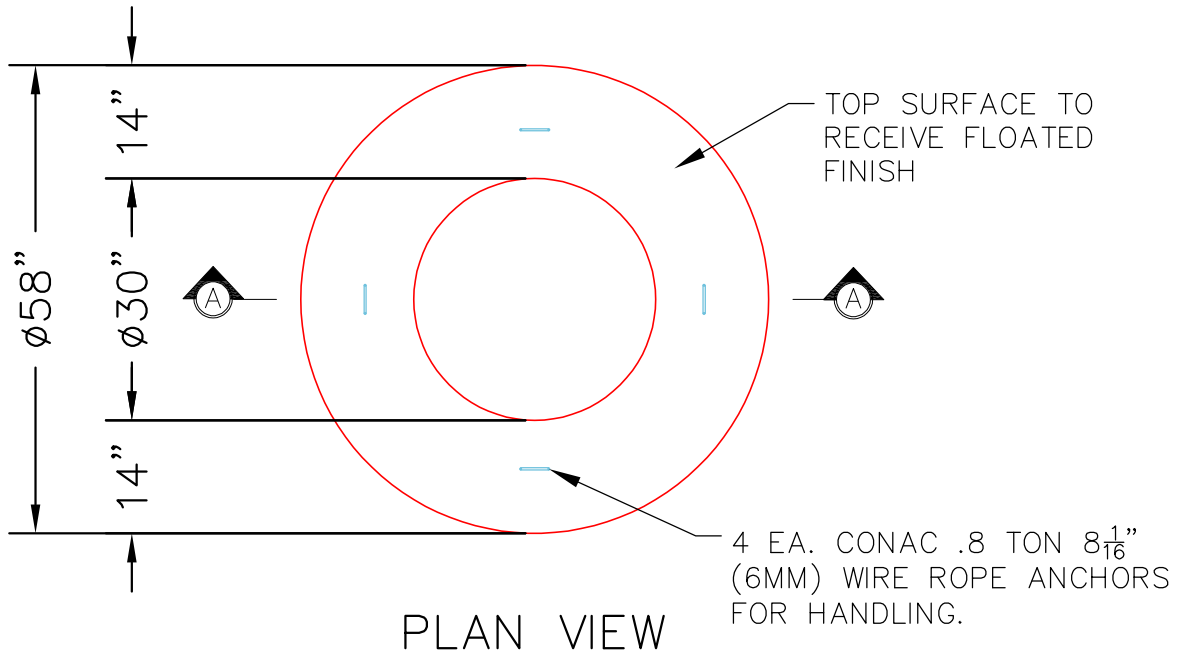


STRUCTURE NOTES:

1. MANUFACTURED PER ASTM C913 SPECIFICATIONS.
2. CONCRETE = 5,000 PSI AT 28 DAYS.
3. JOINT SEALANT - CONSEAL CS-231.
4. EXTERIOR JOINT WRAP - CONSEAL CS-212 & CS-75.
5. REINFORCING PER ASTM A615 (GRADE 60) EPOXY COATED. SEE ATTACHED DESIGN BY WINFORD A. PETRONE, PE.
6. HOE MC-747B FRAME & GRATE SUPPLIED BY ICAST.

**PRODUCTION WORK ORDER**

PRODUCT I.D.:
MH048LD08-30ECC

DESCRIPTION: ø48" MH FLAT TOP 8" HEIGHT
W/ 30" CONCENTRIC HOLE

**QUALITY CONTROL CHECKLIST**

- ☐ ALL DIMENSIONS CORRECT.
- ☐ LIFTERS INSTALLED INSIDE.
- ☐ RECESS WITH HAUNCHES CORRECT.
- ☐ REINFORCING CORRECT.
- ☐ SURFACE QUALITY ACCEPTABLE.
- ☐ LIFTERS INSTALLED OUTSIDE.
- ☐ PRODUCT SQUARE.

PRODUCT VIEW: RIGHT SIDE UP

PLANT: BEAVER DAM, KY.

WEIGHT: 1,394 LBS.

TOP JOINT: N/A

BOTTOM JOINT: FLAT

QC CHECK INITIALS:

CUSTOMER: CLEARY CONSTRUCTION INC

PROJECT: UK BP9 SITE THERMAL AND ELECTRIC UTILITIES

STRUCTURE: VAULT 3

SALES ORDER/QUOTE NO: 25-2504

PC: C. GOFF

DRAWING: S. FELLETER

DATE: 07/31/26



SCALE: NTS

PG.

1 of 1


NOTE: SEE "PRECAST DESIGN SUBMITTALS, CONCRETE COMPONENTS" SHEET FOR SUMMARY OF BUILDING AND DESIGN CODES, MATERIALS REQUIREMENTS, AND DESIGN LOADS.

NOTE: SEE ICAST WORKING DRAWINGS FOR ADDITIONAL INFORMATION AND LOCATION OF EACH COMPONENT.

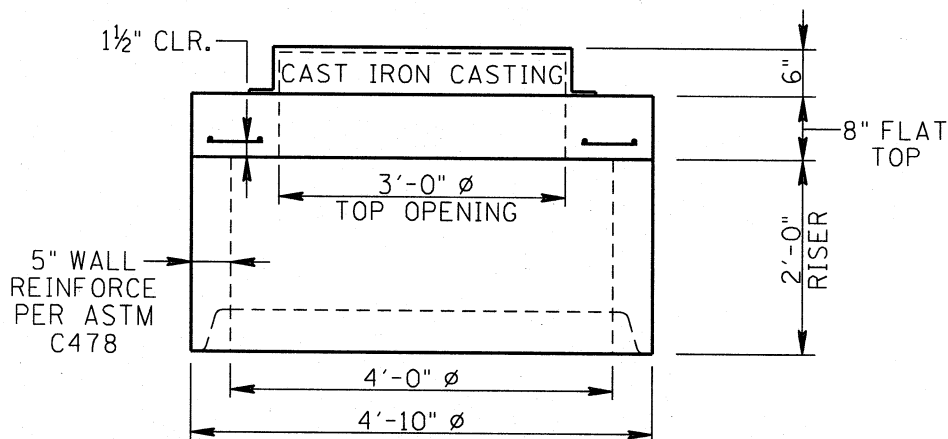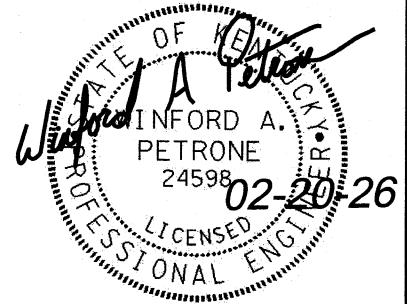


48" $\varnothing$ RISER SECTION
SHOWING REINFORCEMENT

#5X5'-0" EA. QUADRANT AS SHOWN, BEND TO FIT (TYP.)



#5'S @ 6" MAX. EACH WAY (BOTT.-TYP.)

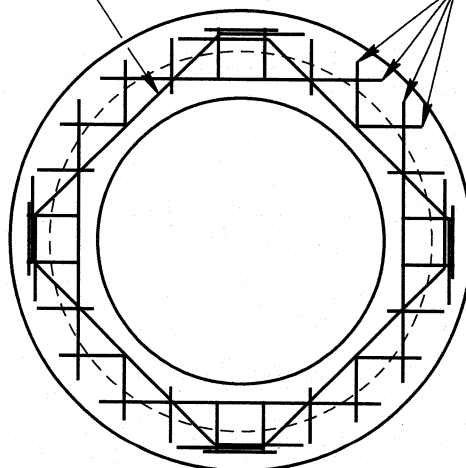

48" $\varnothing$ RISER PLAN
SHOWING REINFORCEMENT

48" $\varnothing$ RISER DETAILS

SK-1