

Job Name: 25-4508 - Georgetown Commons Target
 Job Location: Georgetown, KY
 Contractor: Winwater Hartford KY Co.

Plant: 100
 5/28/2026 6:53:44 PM

Tech: Jared - F
 PC: A. Chambers



Structure ID: 117 (34)

P2 BX2424-08R24

BOX RISER 8inW F/G

- P3) 24" x 24" - CASTING HEIGHT - 4"
- P2) 24" x 24" - BOX RISER 8inW F/G - 24"
- P1) 24" x 24" - BOX BASE 8inW, 8inF, Variable Ht T/n - 47"
- 1) CASTING - HOE 280T F/G
- 2) 24" x 24" - Conseal CS-102 1.00"
- 1) Hole - 16

0 lb
 2062 lb
 4978 lb
 182 lb
 0 lb
 0 lb



 Structure Total: 7222 lb

Structure Notes: 1. PER ASTM C913 SPECIFICATIONS.
 2. CONCRETE = 4,000 PSI AT 28 DAYS.
 3. NO STEPS AND NO INVERT CHANNEL.
 4. CASTING BY ICAST (HOE 280T F/G)
 REINFORCING PER ASTM A615 (GRADE 60).
 - WALLS (As .12) #5 BARS AT 12" C.C.E.W.
 - FLOOR (As .12) #5 BARS AT 12" C.C.E.W.


Rim: 874.6' Rim to Invert: 6.2' Slack: 0.65" Sump: 1.25" Step Position:

Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up (L)	Offset
Invert 1										
Invert 2										
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										

RIGHT-SIDE UP VIEW (int. dimensions)

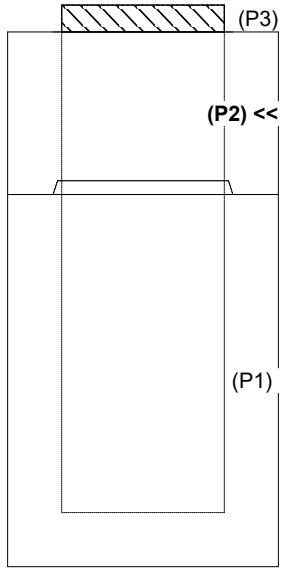

INSIDE WALL DIMENSIONS

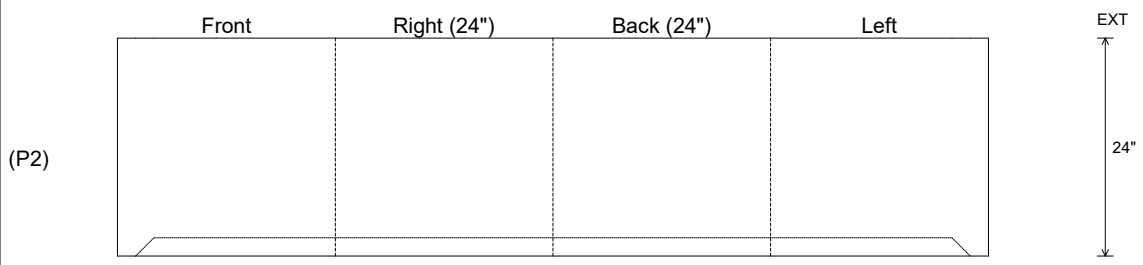

Coating (Int): Coating (Ext):	Seam Up: Flat Seam Dn: Groove	Wall Thickness: 8" Floor Height: 0"	Height (Int): 24" Height (Ext): 24"	Weight (Net): 2062 lb Volume (Net): 0.53cu.yd
----------------------------------	----------------------------------	--	--	--