

Job Name: 25-3364 East Side Retention Pond
 Job Location: Shelbyville, KY
 Contractor: Core & Main LP (Lou)

Plant: 100
 5/8/2026 2:27:33 PM

Tech: J. Horsley
 PC: T. Leweis



Structure ID: OCS

P2 BX060060-08LD08-S

BX FLAT LID 8inW w/36"x36" HATCH F/F

- P2) 60" x 60" - BX FLAT LID 8inW w/36"x36" HATCH F/F - 8"
- P1) 60" x 60" - BOX BASE 8inW, 8inF, Variable Ht F/n - 60"
- 1) HATCH (Alum.) - HALLIDAY W1S 36"x36"
- 1) 60" x 60" - Conseal CS-102 1.00"
- 3) Hole - 26
- 5) MH Step ML-10-TDS-NCR - 10"

3007 lb
 13764 lb
 78 lb
 0 lb
 0 lb
 0 lb


 Structure Total: 16849 lb

Structure Notes:
 1. PER ASTM C913 SPECIFICATIONS.
 2. CONCRETE = 4,500 PSI AT 28 DAYS.
 3. ALUM. HATCH BY ICAST (W1S 36"x36")

REINFORCING PER ASTM A615 (GRADE 60).
 - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W.
 - WALLS (As .31) #5 BARS AT 8" C.C.E.W.
 - FLOOR (As .31) #5 BARS AT 8" C.C.E.W.

NOTES:

- 1. MANUFACTURED TO ASTM C-913 (LATEST REVISION).
- 2. CONCRETE: 4,500 PSI AT 28 DAYS.
- 3. REINFORCING #5 BAR @ 6" C.C.E.W.

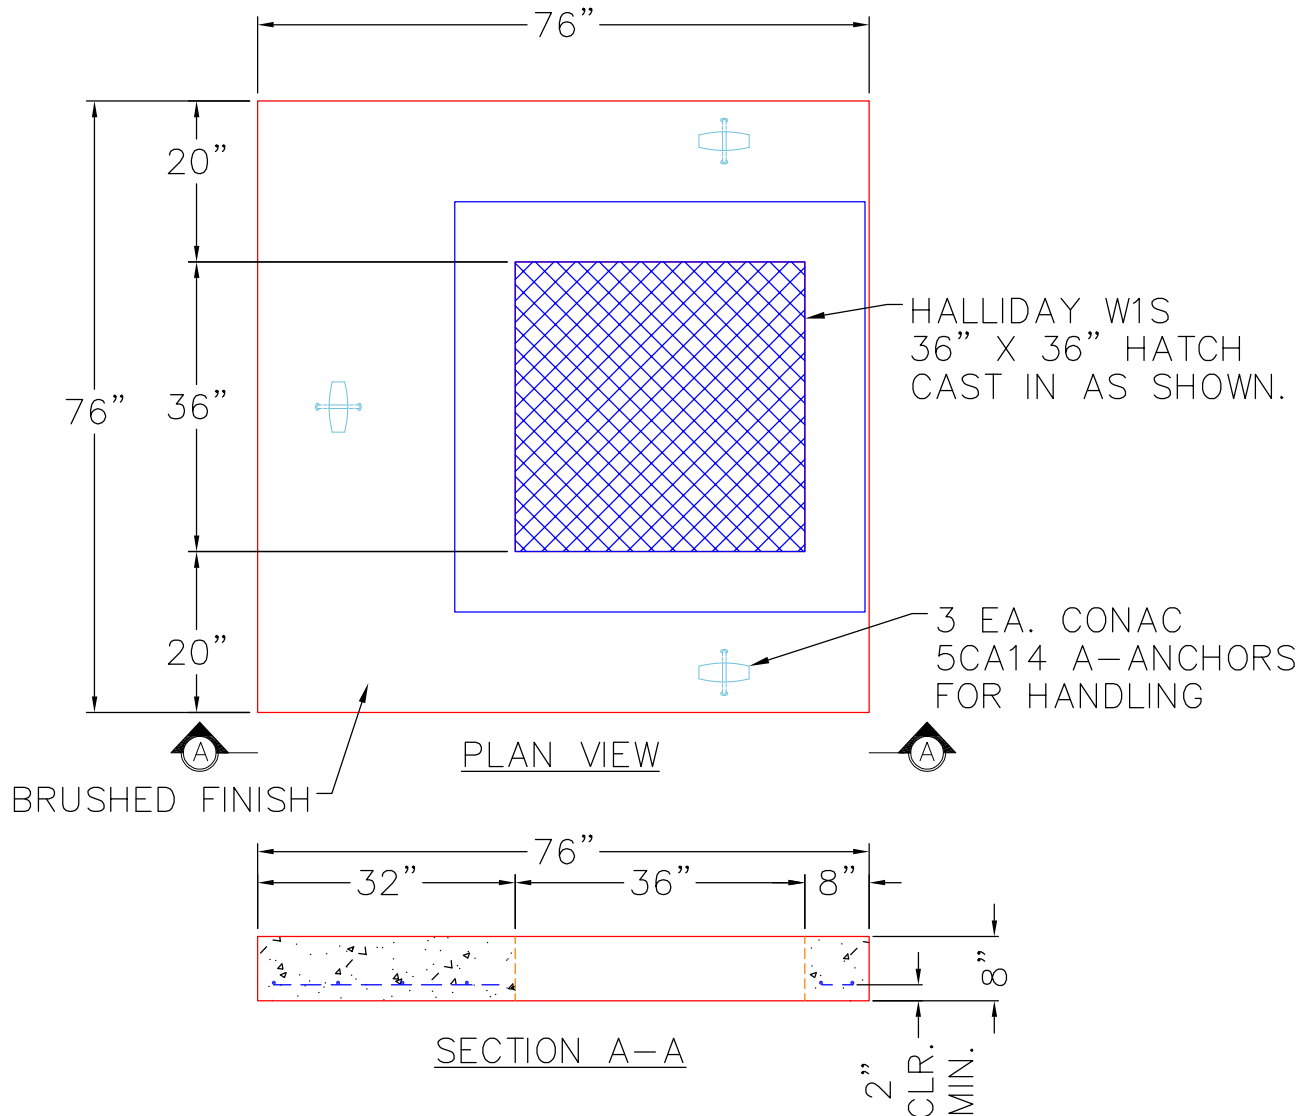

Coating (Int):
 Coating (Ext):

Seam Up: Flat
 Seam Dn: Flat

Wall Thickness: 8"

Height (Ext): 8"

Weight (Net): 3007 lb
 Volume (Net): 0.77cu.yd