

Job Name: 26-2049 - VSG 691257163
Job Location: CPU
Contractor: Endesol, Inc.

Plant: Beaver Dam
8/19/2026 2:10:16 PM

Tech: J. Coppage
PC: E. Bradley



Structure ID: 2-62050-2

P1 CVBS

BX Separate Base Slab


P3) 50" x 252" - CASTING HEIGHT - 0"
P2) 50" x 252" - BOX RISER 6inW, Variable Ht - 28"
P1) 50" x 252" - BX Separate Base Slab - 6"
2) 50" x 252" - Conseal CS-102 1.00"

Structure Total: 17043 lb


Structure Notes:
A) PER ASTM C913.
B) CONCRETE = 4,500 PSI AT 28 DAYS.
C) REINFORCING PER ASTM A615 (GRADE 60).

GENERAL NOTES:

1. MANUFACTURED TO ASTM C-913 (LATEST REVISION)
2. CONCRETE: 5,000 PSI AT 28 DAYS
3. REINFORCEMENT - MIN. 1½" REBAR
CLEARANCE:
- TOP MAT: PER ATTACHED DWG 252_BASE_TOP_MAT
- BOTTOM MAT: PER ATTACHED DWG 252_BASE_BOTTOM_MAT
4. WEIGHTS: 8,241 LBS

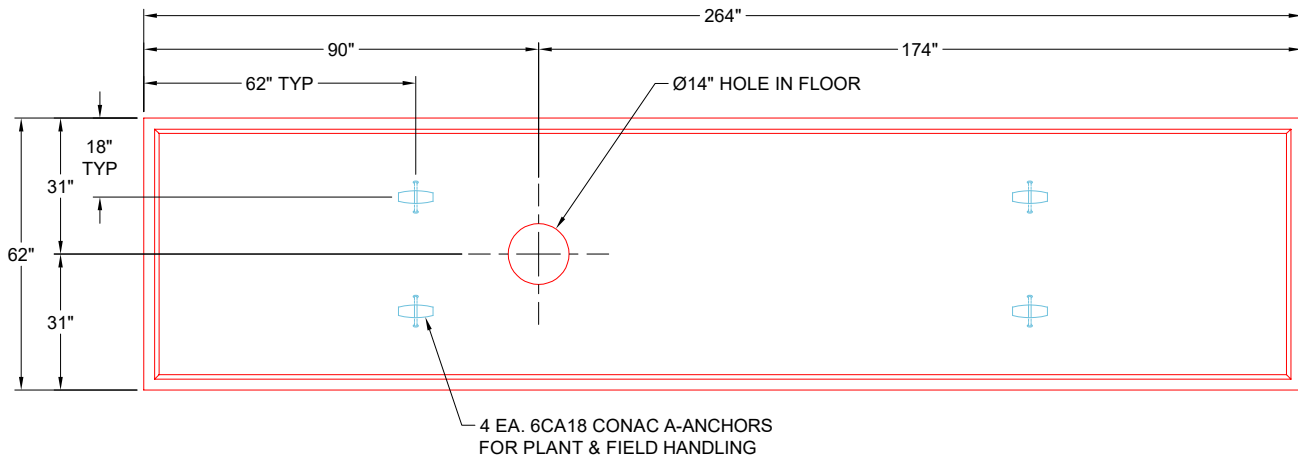

PLAN VIEW
(RIGHT SIDE UP)

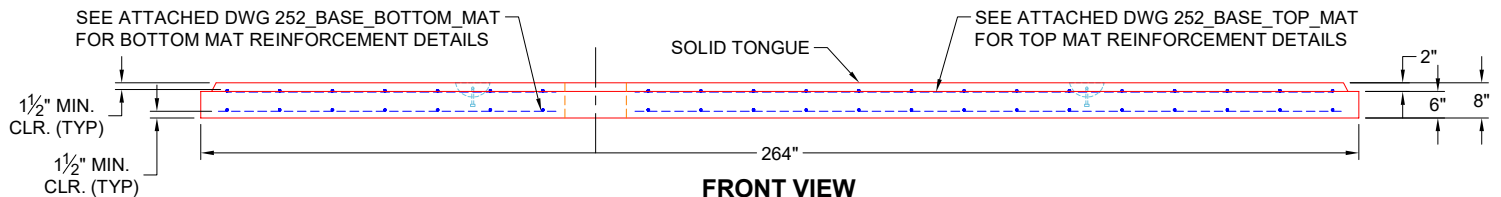

FRONT VIEW
(RIGHT SIDE UP)

Coating (Int):
Coating (Ext):

Seam Up: Tongue
Seam Dn: n/a

Wall Thickness: 6"
Floor Height: 6"

Height (Int): 0"
Height (Ext): 0"

Weight (Net): 8241 lb
Volume (Net): 2.1cu.yd

Job Name: 26-2049 - VSG 691257163
Job Location: CPU
Contractor: Endesol, Inc.

Plant: Beaver Dam
8/19/2026 2:10:16 PM

Tech: J. Coppage
PC: E. Bradley



Structure ID: 2-62050-2


P1 CVBS

BX Separate Base Slab

- P3) 50" x 252" - CASTING HEIGHT - 0"
P2) 50" x 252" - BOX RISER 6inW, Variable Ht - 28"
P1) 50" x 252" - BX Separate Base Slab - 6"
2) 50" x 252" - Conseal CS-102 1.00"

Structure Notes:
A) PER ASTM C913.
B) CONCRETE = 4,500 PSI AT 28 DAYS.
C) REINFORCING PER ASTM A615 (GRADE 60).

Structure Total: 17043 lb

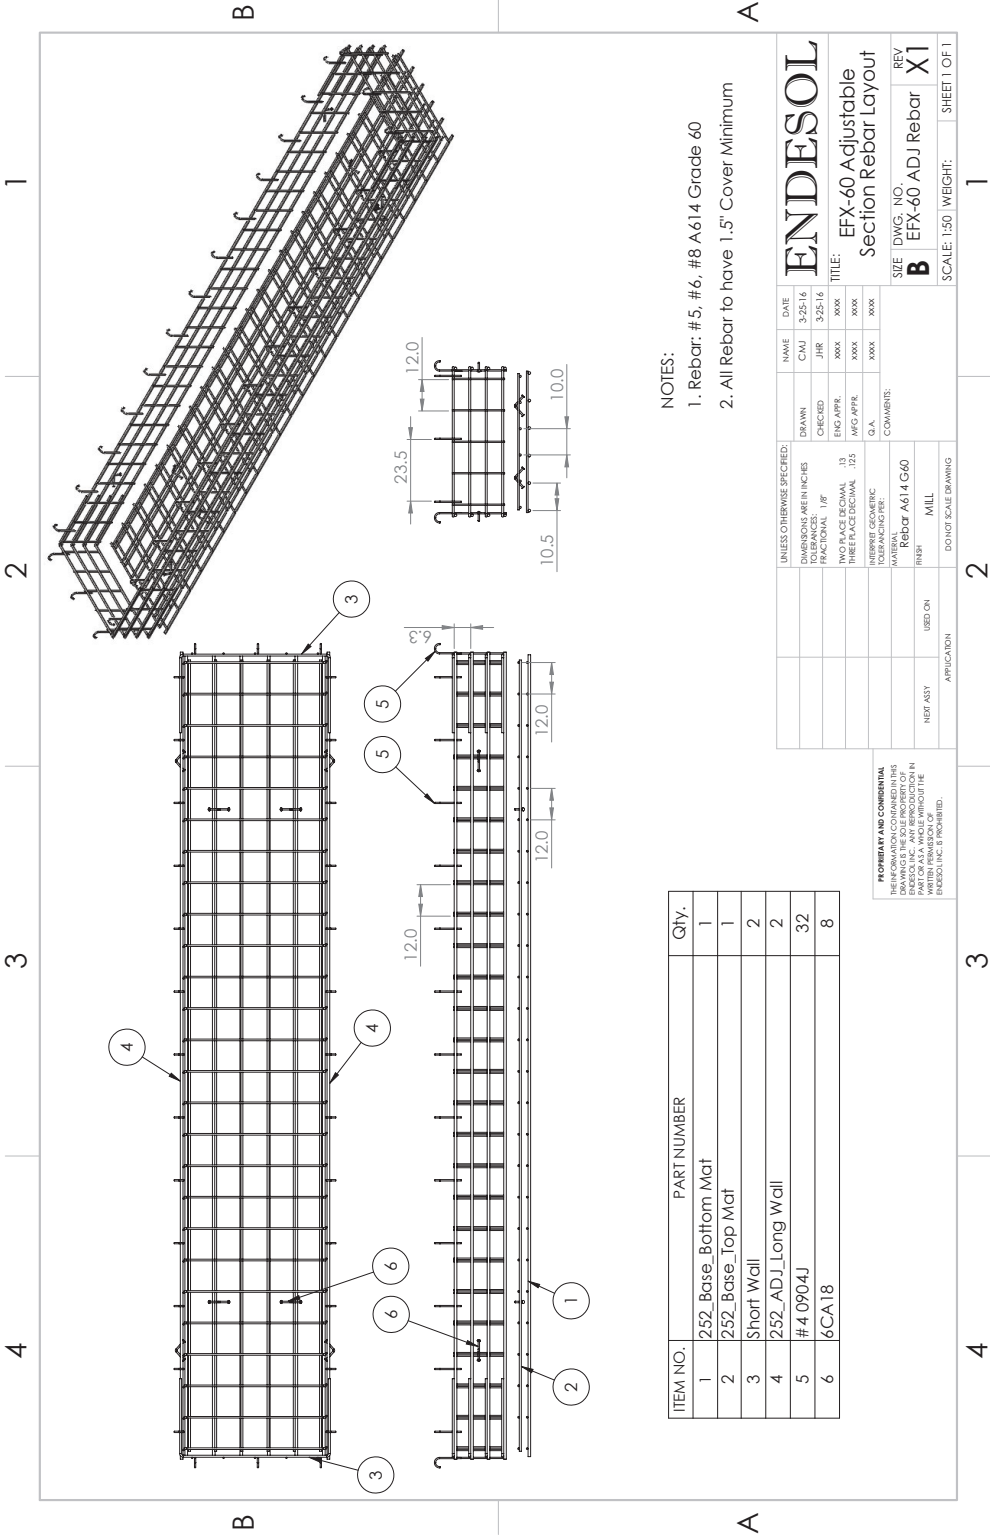

Coating (Int):
Coating (Ext):

Seam Up: Tongue
Seam Dn: n/a

Wall Thickness: 6"
Floor Height: 6"

Height (Int): 0"
Height (Ext): 0"

Weight (Net): 8241 lb
Volume (Net): 2.1cu.yd

Job Name: 26-2049 - VSG 691257163
Job Location: CPU
Contractor: Endesol, Inc.

Plant: Beaver Dam
8/19/2026 2:10:16 PM

Tech: J. Coppage
PC: E. Bradley



Structure ID: 2-62050-2


P1 CVBS

BX Separate Base Slab

- P3) 50" x 252" - CASTING HEIGHT - 0"
P2) 50" x 252" - BOX RISER 6inW, Variable Ht - 28"
P1) 50" x 252" - BX Separate Base Slab - 6"
2) 50" x 252" - Conseal CS-102 1.00"

0 lb
8802 lb
8241 lb
0 lb
Structure Total: 17043 lb

Structure Notes :
A) PER ASTM C913.
B) CONCRETE = 4,500 PSI AT 28 DAYS.
C) REINFORCING PER ASTM A615 (GRADE 60).

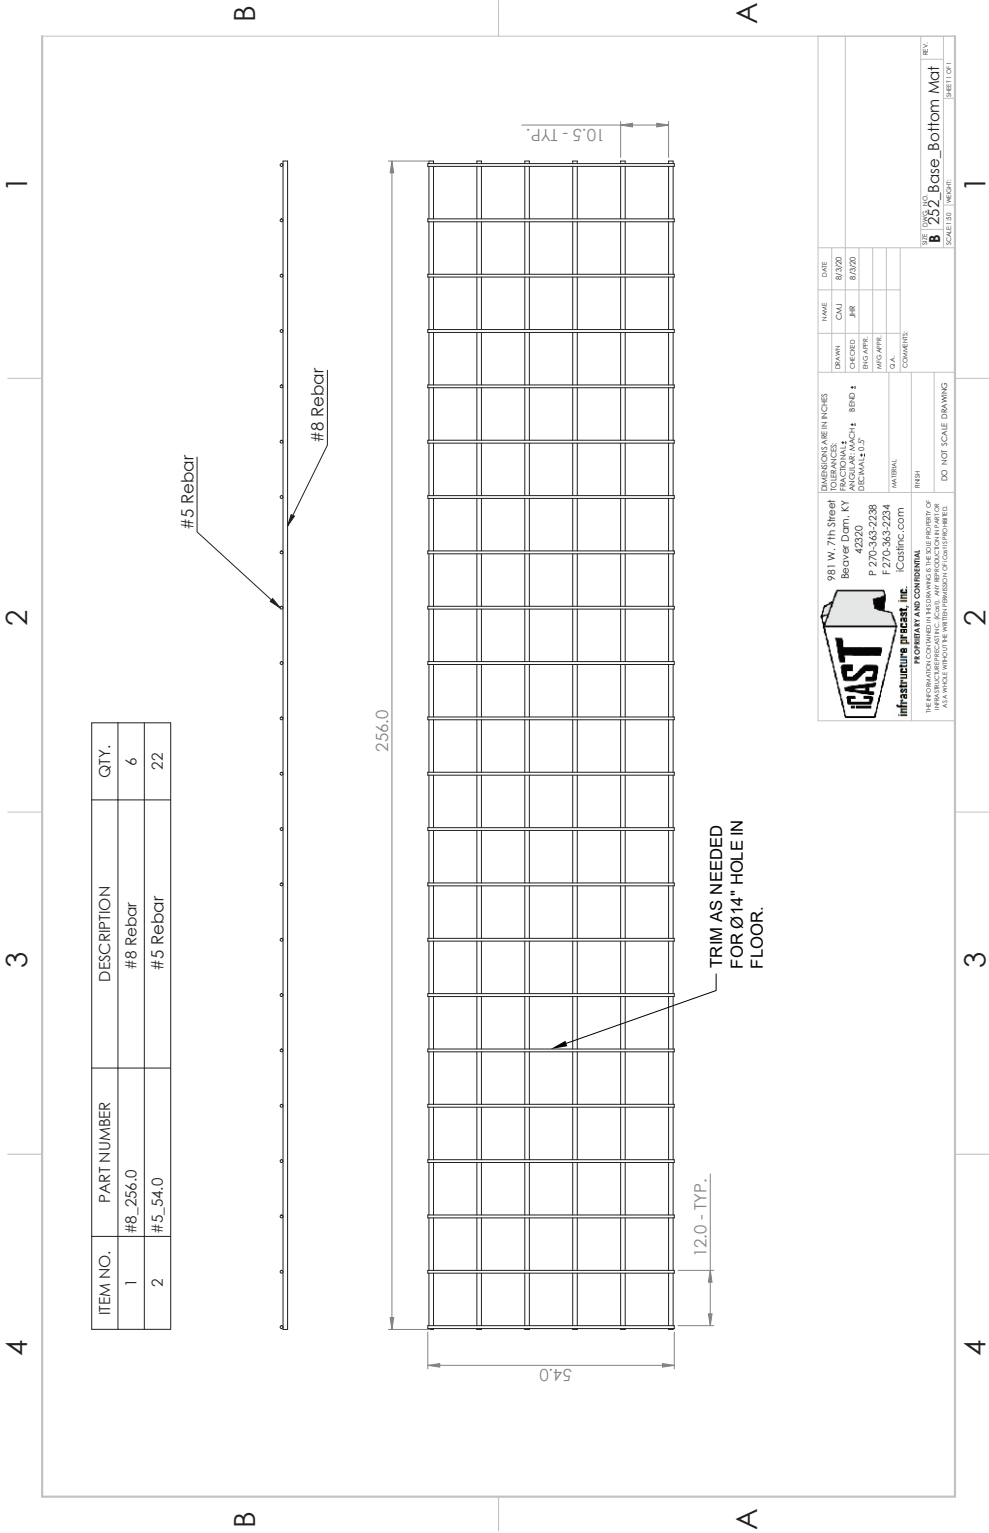

ICAST Infrastructure Precast, Inc. logo and contact information.

981 W. 7th Street
Beaver Dam, WI 53005
P 270-363-2238
F 270-363-2234
E info@icast.com
www.icast.com

PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF ICAST INFRASTRUCTURE PRECAST, INC. ANY REPRODUCTION IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF ICAST INFRASTRUCTURE PRECAST, INC. IS PROHIBITED.

DO NOT SCALE DRAWING

DATE: 8/19/2026
DRAWN: JCB
CHECKED: JCB
DESIGNED: JCB
SCALE: 1/8" = 1'-0"

REVISIONS

NO.	DATE	DESCRIPTION
1	8/19/2026	ISSUED FOR PERMIT

ICAST INFRASTRUCTURE PRECAST, INC.
B 252 Base Bottom Mat
SCALE: 1/8" = 1'-0"
SHEET 1 OF 1

Coating (Int):	Seam Up: Tongue	Wall Thickness: 6"	Height (Int): 0"	Weight (Net): 8241 lb
Coating (Ext):	Seam Dn: n/a	Floor Height: 6"	Height (Ext): 0"	Volume (Net): 2.1cu.yd

Job Name: 26-2049 - VSG 691257163
Job Location: CPU
Contractor: Endesol, Inc.

Plant: Beaver Dam
8/19/2026 2:10:16 PM

Tech: J. Coppage
PC: E. Bradley



Structure ID: 2-62050-2


P1 CVBS

BX Separate Base Slab

- P3) 50" x 252" - CASTING HEIGHT - 0"
P2) 50" x 252" - BOX RISER 6inW, Variable Ht - 28"
P1) 50" x 252" - BX Separate Base Slab - 6"
2) 50" x 252" - Conseal CS-102 1.00"

Structure Notes: .
A) PER ASTM C913.
B) CONCRETE = 4,500 PSI AT 28 DAYS.
C) REINFORCING PER ASTM A615 (GRADE 60).

Structure Total: 17043 lb

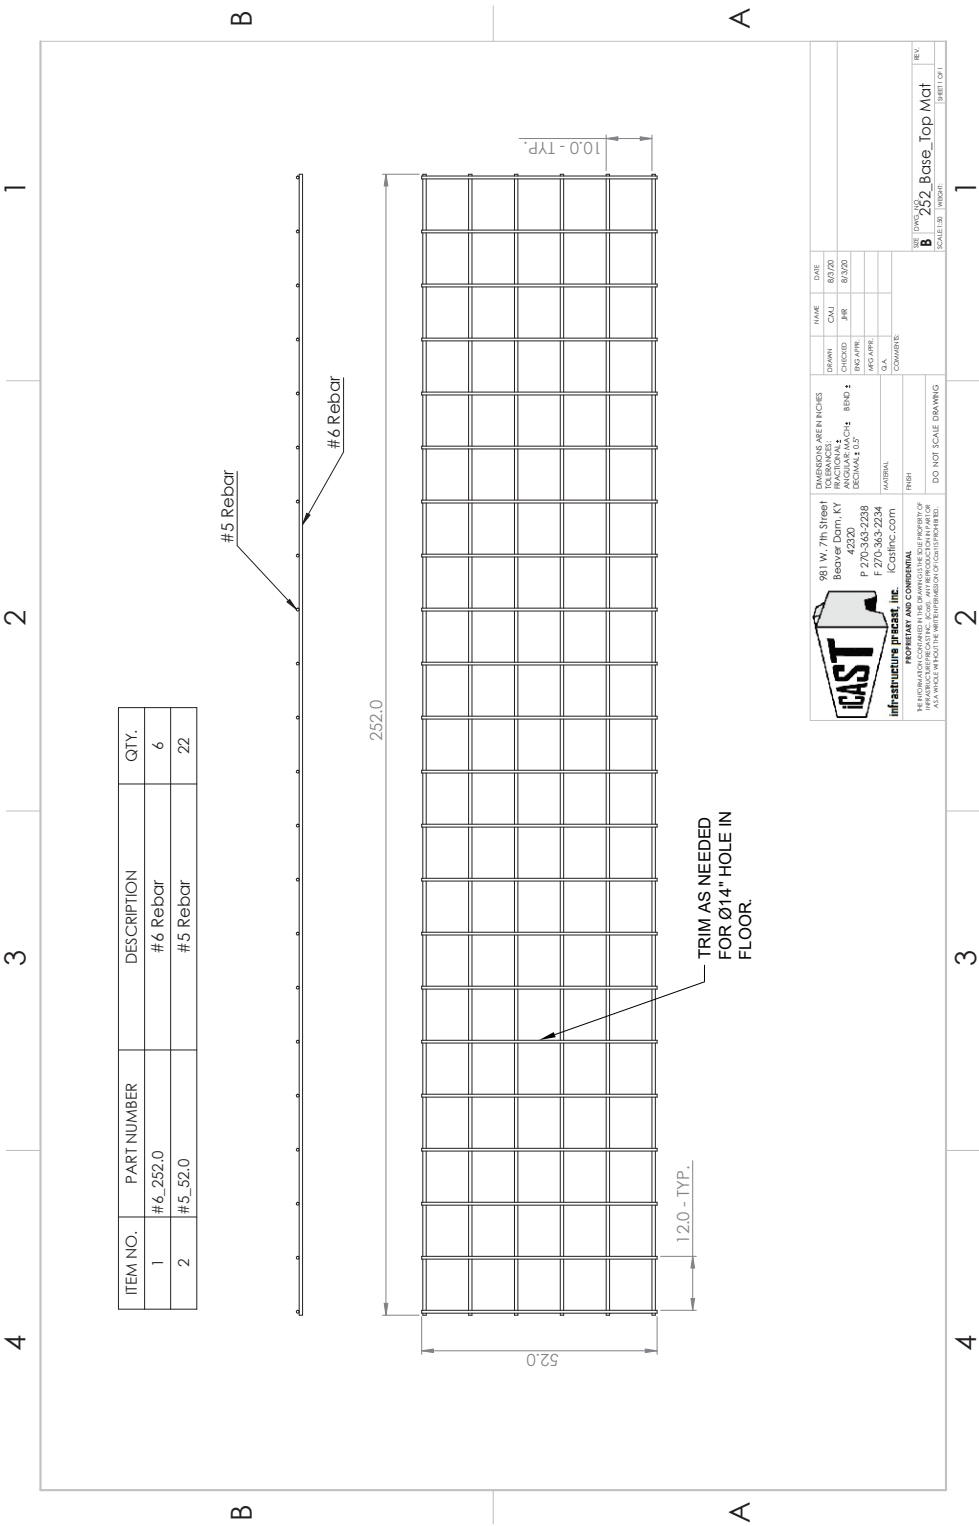

ITEM NO.	PART NUMBER	DESCRIPTION	QTY.
1	#6_252.0	#6 Rebar	6
2	#5_52.0	#5 Rebar	22

981 W. 7th Street Beverly Hills, KY 40301 P 270-363-2238 F 270-363-2234 ICasting.com	861 W. 7th Street Beverly Hills, KY 40301 P 270-363-2238 F 270-363-2234 ICasting.com	PROPRIETARY AND CONFIDENTIAL THIS DRAWING IS THE PROPERTY OF INFRASTRUCTURE PRECAST, INC. AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT THE WRITTEN PERMISSION OF INFRASTRUCTURE PRECAST, INC.	DO NOT SCALE DRAWING	DATE 8/19/2026	NAME CAJ JBR	DESIGN CHECKED BY DATE 8/19/2026	SCALE 1"=10'-0"	REV. 1
---	---	--	----------------------	-------------------	--------------------	--	--------------------	-----------

Coating (Int): Coating (Ext):	Seam Up: Tongue Seam Dn: n/a	Wall Thickness: 6" Floor Height: 6"	Height (Int): 0" Height (Ext): 0"	Weight (Net): 8241 lb Volume (Net): 2.1cu.yd
----------------------------------	---------------------------------	--	--------------------------------------	---