

Job Name: 26-1800 - Georgetown Community Park
Job Location: Georgetown, IN
Contractor: Song Construction

Plant: 100

7/24/2026 12:15:26 PM

Tech: Jared - A

PC: Jay Ross Jarvis



Structure ID: San. MH 2 SS-MH

P1 MH048BAVF

MH BASE Custom Ht

- P3) 24" - CASTING HEIGHT - 7"
P2) 48" - ECC CONE w/ 24" HOLE - 30"
P1) 48" - MH BASE Custom Ht - 33"
1) JOINT WRAP PRIMER - CONSEAL CS-75 (1 gal.)
1) 48" - MH INVERT CHANNEL - FULL HEIGHT
1) JOINT WRAP - 0.065"x6"x50' CONSEAL CS212
1) CASTING - HOE MC-375 F/C Sanitary
1) 48" - Conseal CS-102 1.00" (Double)
1) 24" - Conseal CS-102 1.00" (Double)
1) PSX - 12-08 NYLO
5) MH Step ML-10-TDS-NCR - 10"

- 0 lb
2050 lb
3588 lb
0 lb
1440 lb
0 lb
271 lb
0 lb
0 lb
8 lb
0 lb
0 lb
- Structure Notes:**
1. HOE MC-375 F/C SANITARY PROVIDED BY ICAST.
2. PER ASTM C478 SPECIFICATIONS.
3. CONCRETE = 4,000 PSI AT 28 DAYS.
4. REINFORCING PER ASTM A615 (GRADE 60).
- CONE (As .12)
- RISER/WALLS (As .12)
- FLOOR (As .31) #5 BARS AT 12" C.C.E.W.



Structure Total: 7357 lb

Rim: 703.29' Rim to Invert: 5.67' Slack: 0.04" Sump: 2" Step Position: 180°


Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	697.62'	0°	0"	8" PVC SDR35	8.5"	PSX 12-08 NYLO	12"	12.129"	0"	0"
Invert 2										
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										

RIGHT-SIDE UP VIEW (int. dimensions)

UPSIDE-DOWN VIEW (int. dimensions)

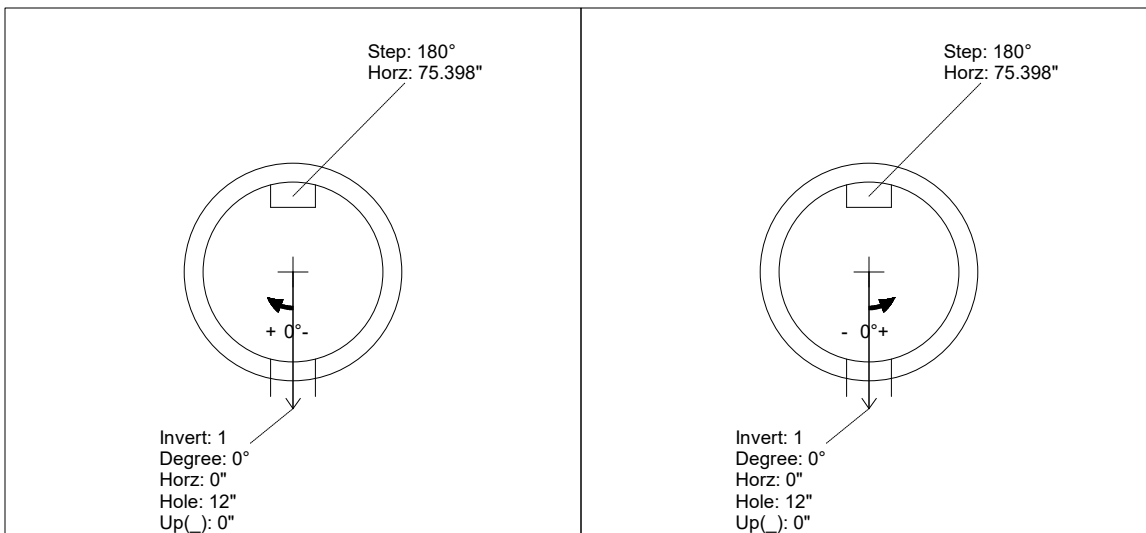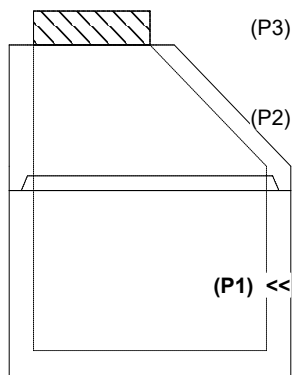

INSIDE WALL DIMENSIONS

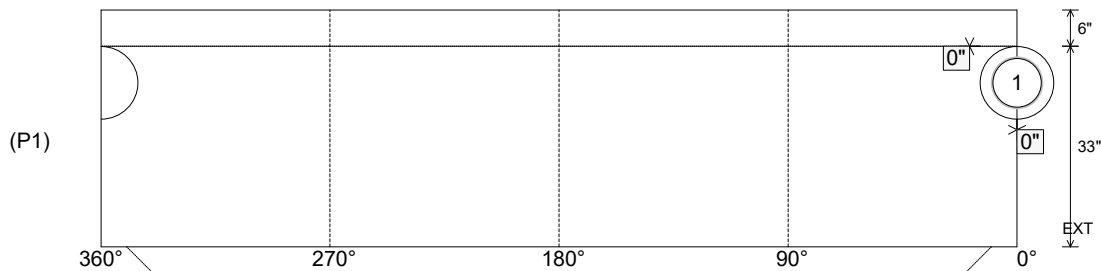

Coating (Int):
Coating (Ext):

Seam Up: Tongue
Seam Dn: n/a

Wall Thickness: 5"
Floor Height: 6"

Height (Int): 33"
Height (Ext): 39"

Weight (Net): 3588 lb
Volume (Net): 0.92cu.yd

Job Name: 26-1800 - Georgetown Community Park

Job Location: Georgetown, IN

Contractor: Song Construction

Plant: 100

7/24/2026 12:15:26 PM

Tech: Jared - A

PC: Jay Ross Jarvis



Structure ID: San. MH 2 SS-MH

P1 MH048BAVF

MH BASE Custom Ht

P3) 24" - CASTING HEIGHT - 7"

P2) 48" - ECC CONE w/ 24" HOLE - 30"

P1) 48" - MH BASE Custom Ht - 33"

1) JOINT WRAP PRIMER - CONSEAL CS-75 (1 gal.)

1) 48" - MH INVERT CHANNEL - FULL HEIGHT

1) JOINT WRAP - 0.065"x6"x50' CONSEAL CS212

1) CASTING - HOE MC-375 F/C Sanitary

1) 48" - Conseal CS-102 1.00" (Double)

1) 24" - Conseal CS-102 1.00" (Double)

1) PSX - 12-08 NYLO

5) MH Step ML-10-TDS-NCR - 10"

0 lb

2050 lb

3588 lb

0 lb

1440 lb

0 lb

271 lb

0 lb

0 lb

8 lb

0 lb

Structure Total: 7357 lb

Structure Notes: .

1. HOE MC-375 F/C SANITARY PROVIDED BY ICAST.

2. PER ASTM C478 SPECIFICATIONS.

3. CONCRETE = 4,000 PSI AT 28 DAYS.

4. REINFORCING PER ASTM A615 (GRADE 60).

- CONE (As .12)

- RISER/WALLS (As .12)

- FLOOR (As .31) #5 BARS AT 12" C.C.E.W.

INVERT CHANNEL DRAWING

FULL HEIGHT INVERT

Rim: 703.29'

Rim to Invert: 5.67'

Slack: 0.04"

Sump: 2"

Step Position: 180°

Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	697.62'	0°	0"	8" PVC SDR35	8.5"	PSX 12-08 NYLO	12"	12.129"	0"	0"
Invert 2										
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										

RIGHT-SIDE UP VIEW (int. dimensions)

UPSIDE-DOWN VIEW (int. dimensions)

INSIDE WALL DIMENSIONS

Coating (Int):

Coating (Ext):

Seam Up: Tongue

Seam Dn: n/a

Wall Thickness: 5"

Floor Height: 6"

Height (Int): 33"

Height (Ext): 39"

Weight (Net): 3588 lb

Volume (Net): 0.92cu.yd