

Contractor: Seven Earthmovers LLC

TECH: J. Horsley

Plant: 100




Slack: 0"

REINFORCING PER ASTM AS615 (GRADE 60).
- BASE WALLS (As .31) #5 BARS AT 12" C.C.E.W.
- BASE FLOOR (As .31) #5 BARS AT 12" C.C.E.W.

P2) 24" x 24" - CASTING HEIGHT - 11"
P1) 24" x 24" - BOX BASE 8inW, 8inF, Variable Ht F/n - 37"
1) CASTING - HOE KY-465 SET (CBI TY F)
1) 24" x 24" - Conseal CS-102 1.00"
1) Hole - 20

0 lb
4029 lb
465 lb
0 lb
0 lb



Structure Total: 4494 lb

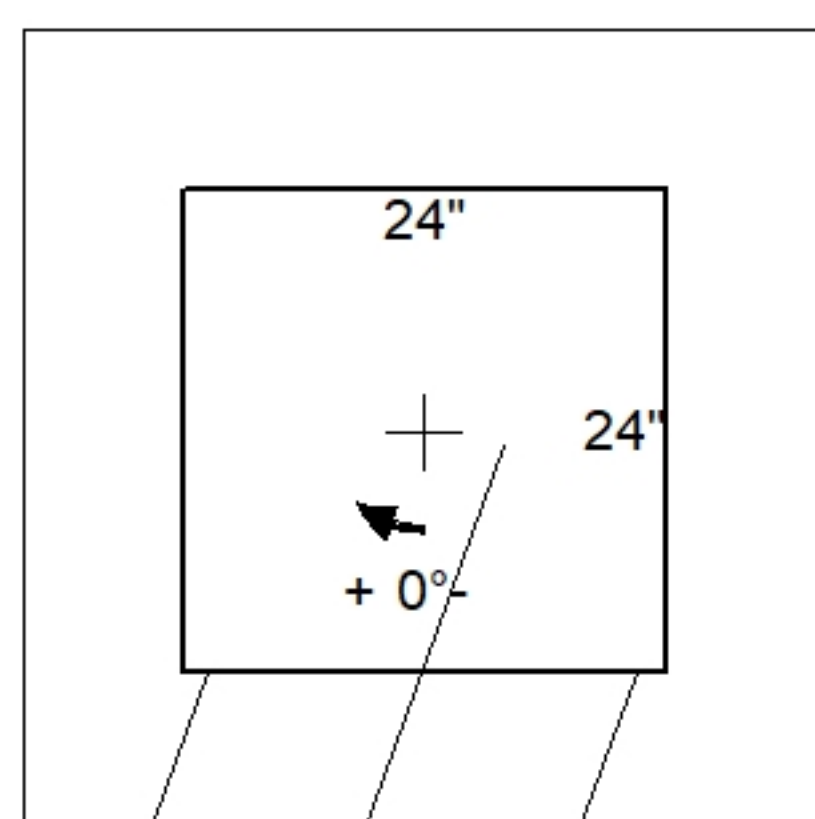

Invert: 1
Degree: 20°

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (')	Ref
Rim	885.73'							
Reducer								
Invert 1	881.73'	20°	15" ADS N-12	18"	20"	Hole 20	-2.5"	P1
Invert 2								
Invert 3								
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

Cast (Int. Dim.) - Interior Dimensions

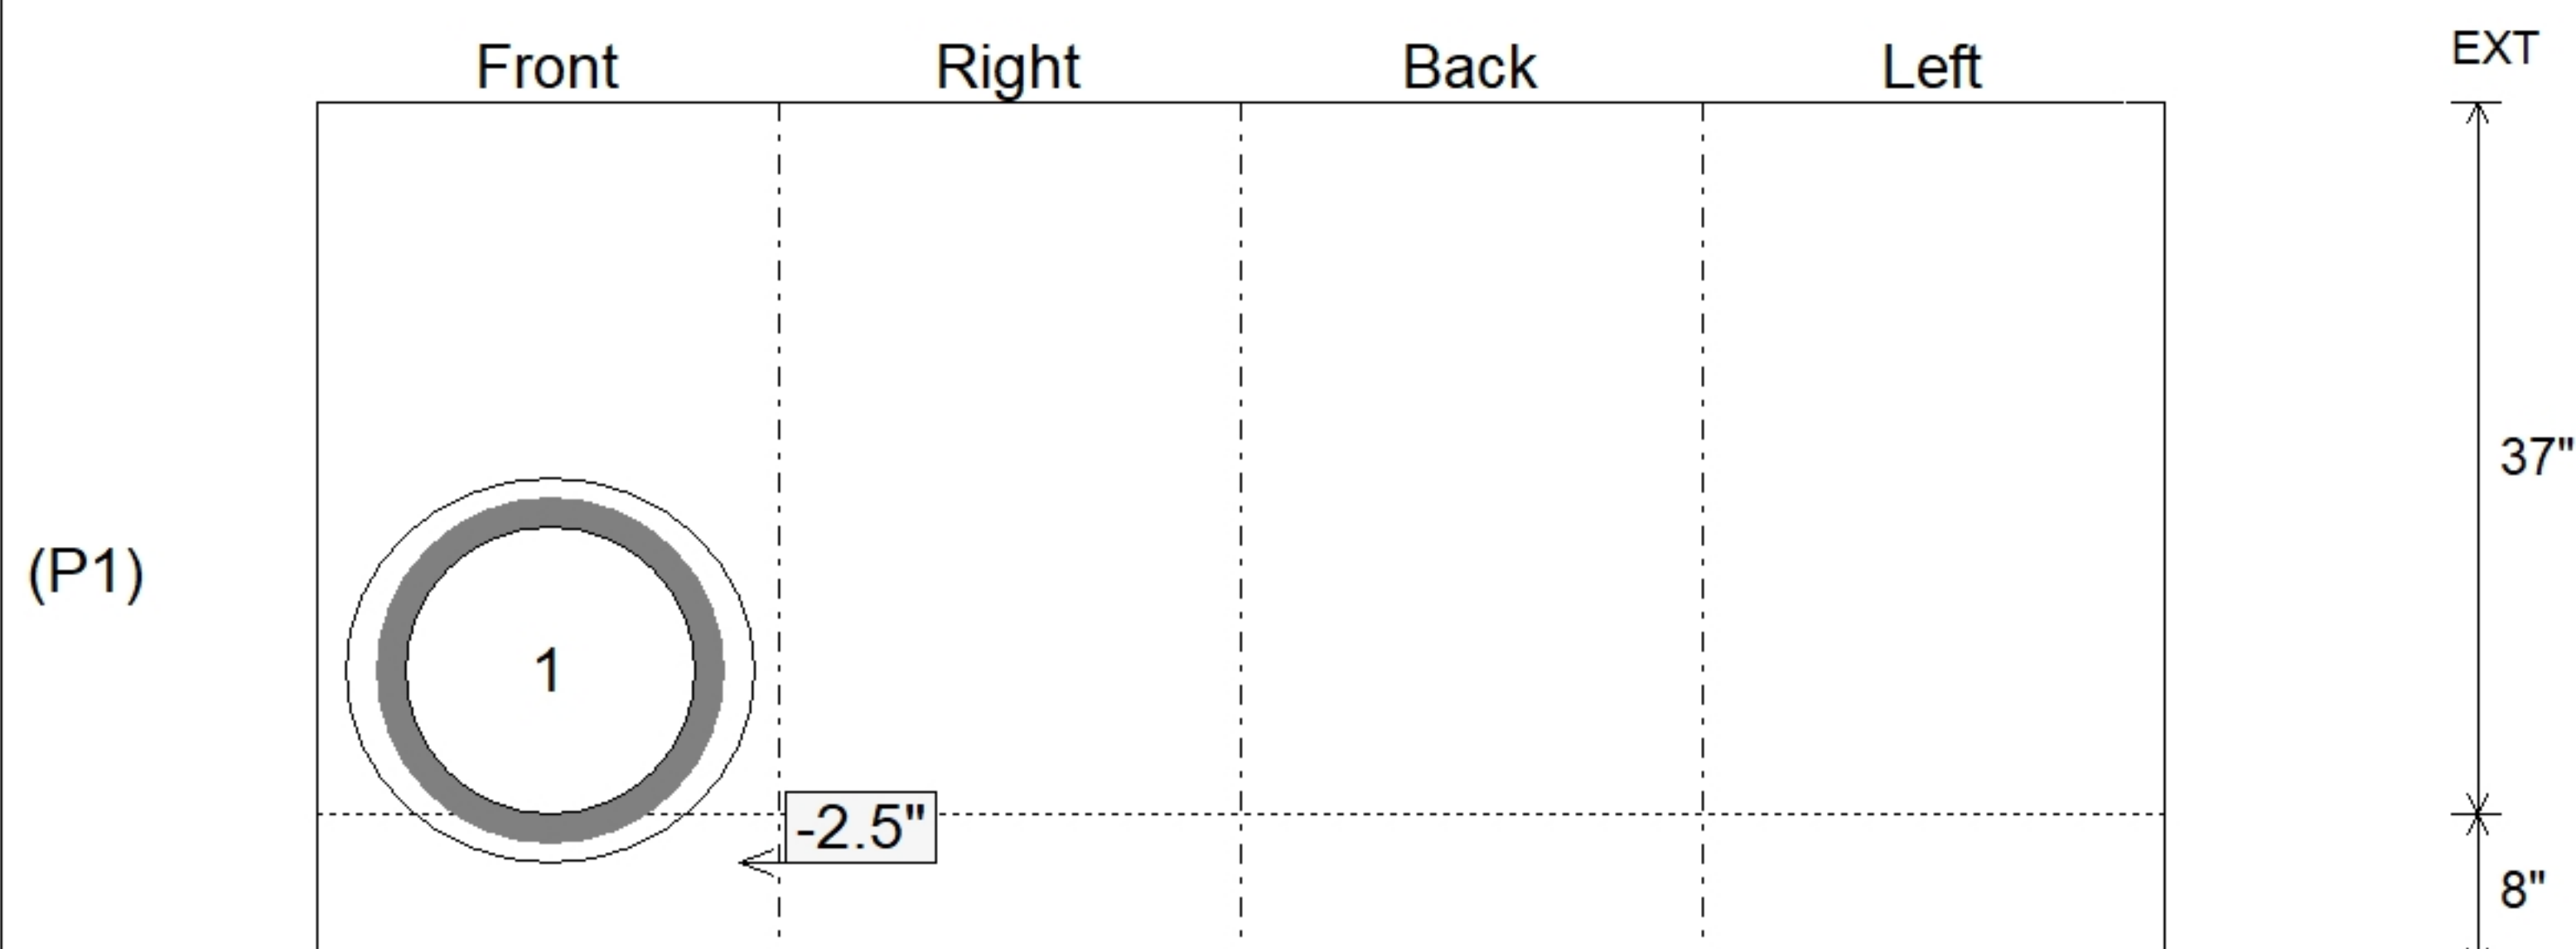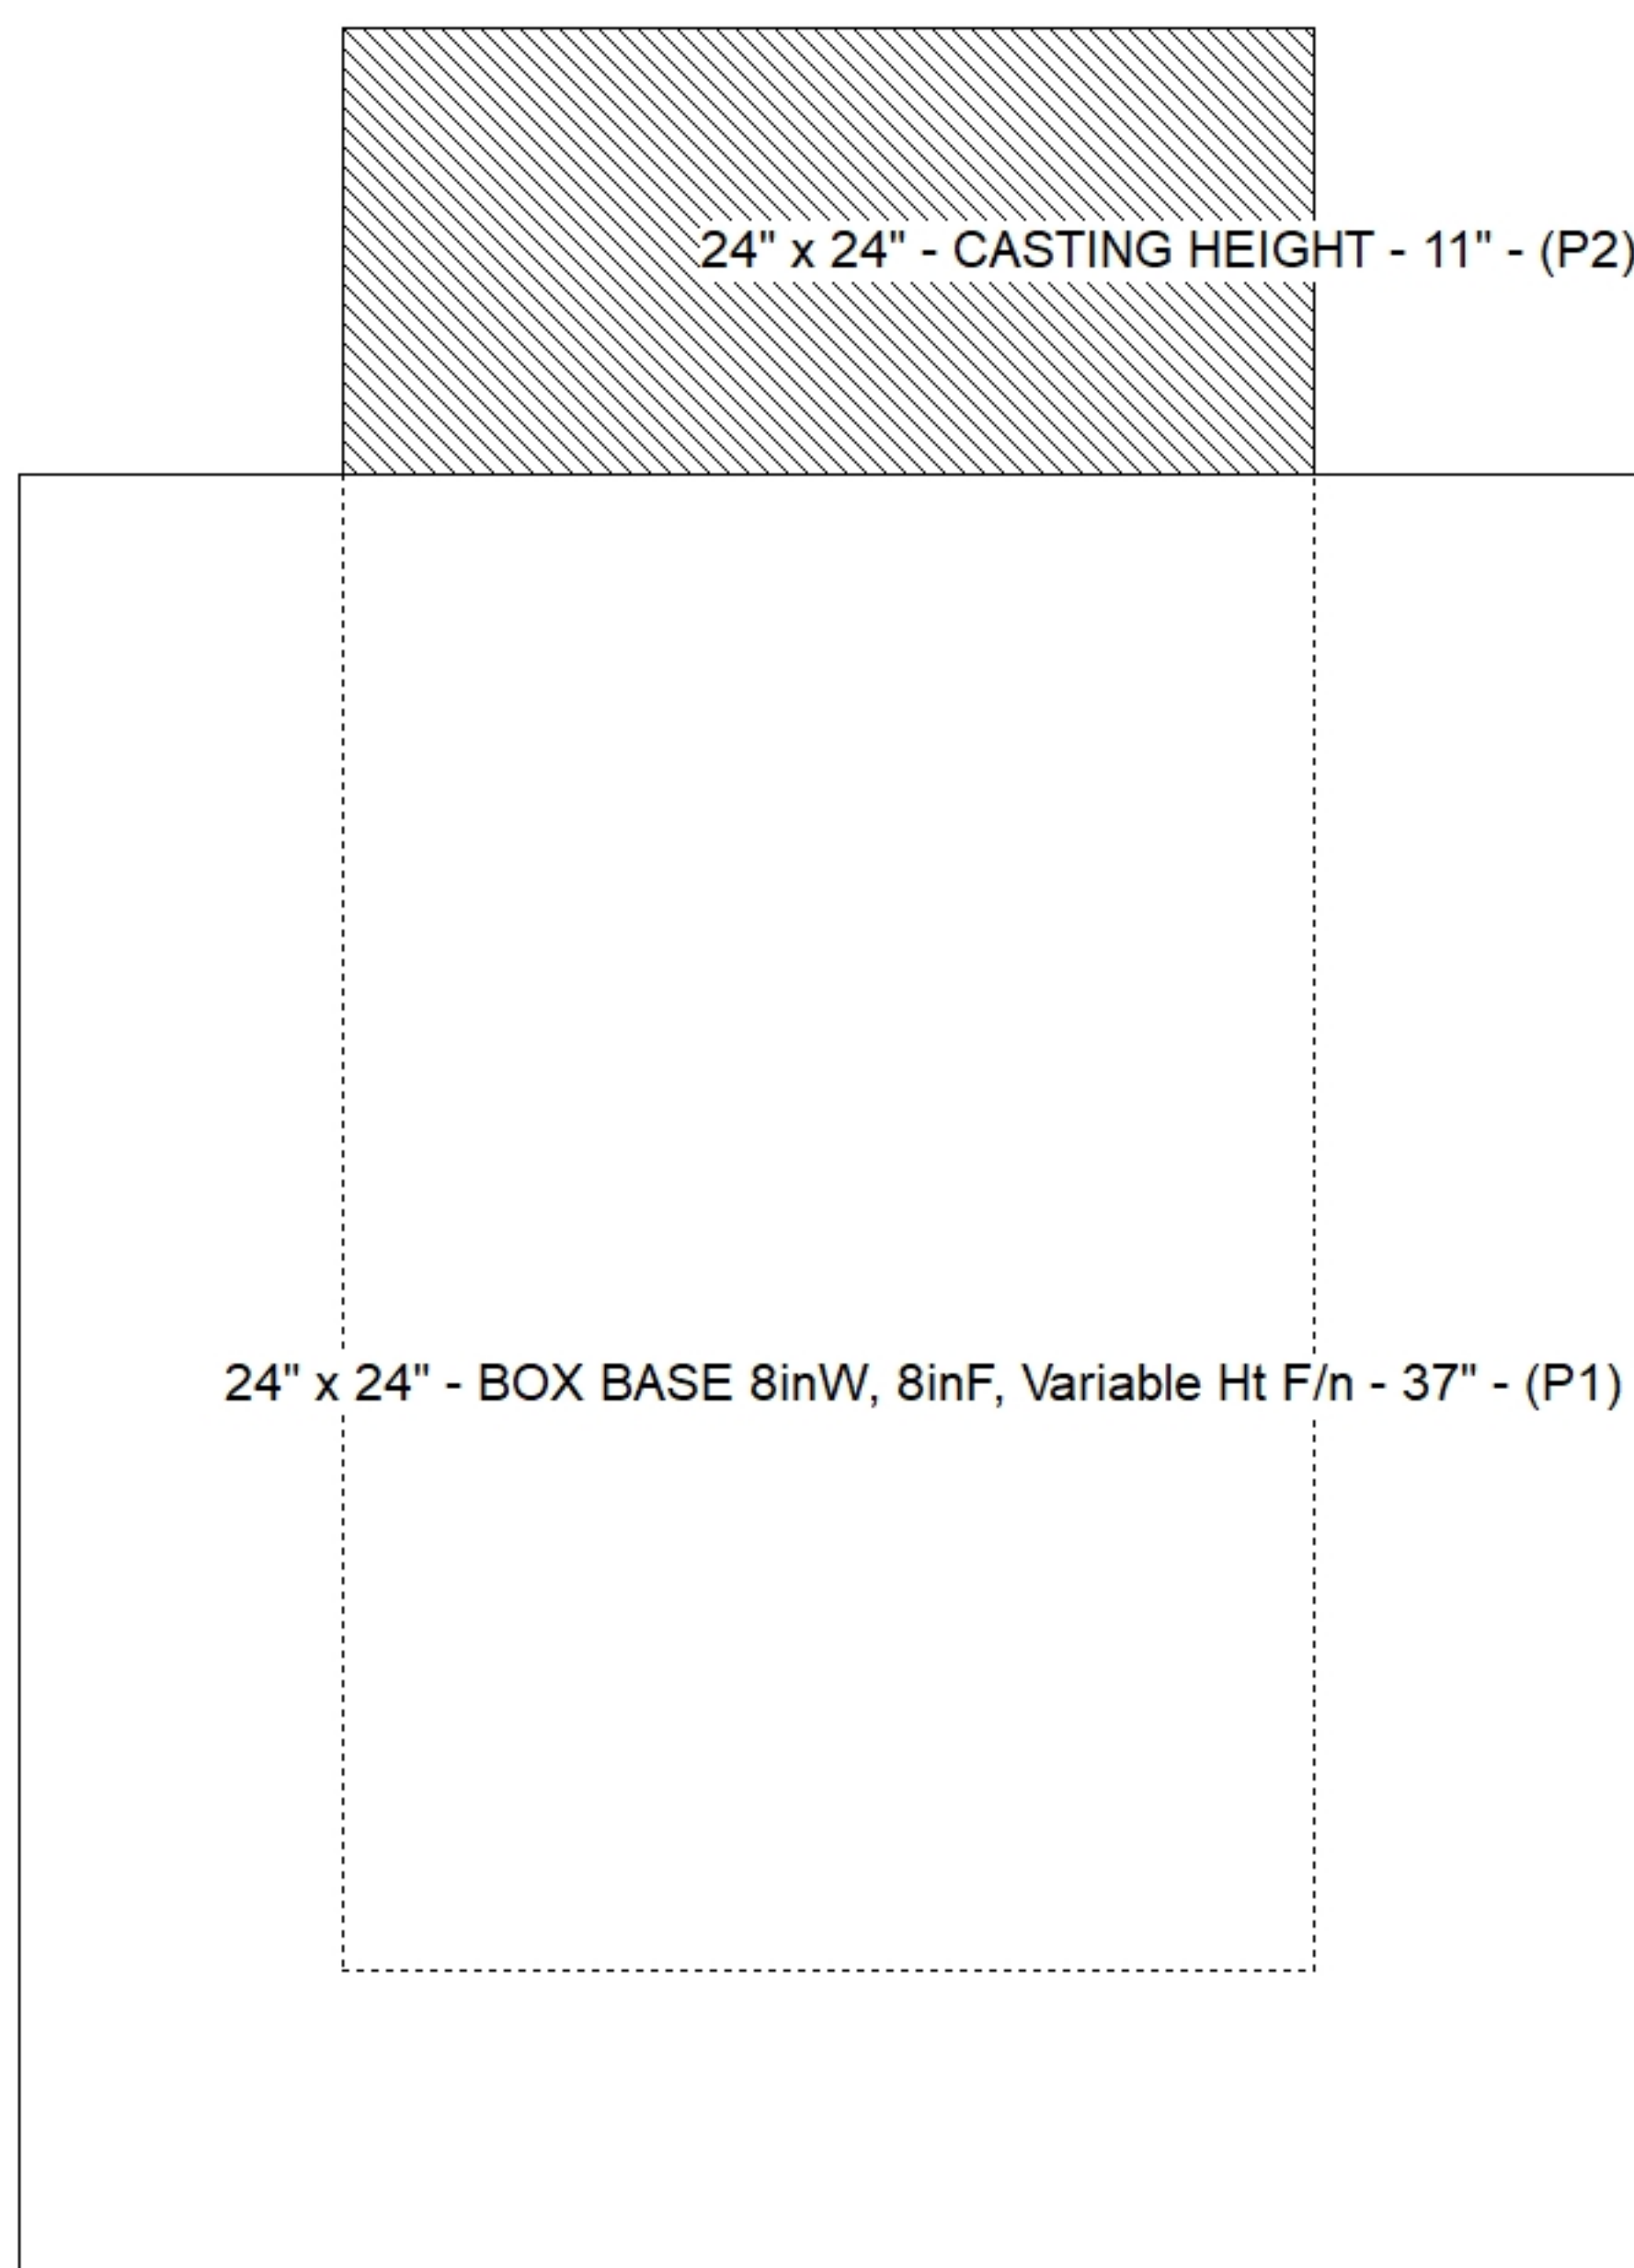

Submittal Drawing
5/19/2026 12:54:51 PM

SUBMITTAL
APPROVED BY: