

Job Name: 23-2404 Hampton Hills (Phase 1)
Job Location: Richmond, KY
Contractor: Seven Earthmovers LLC




Plant: 100
5/19/2026 12:56:32 PM

Tech: J. Horsley
PC: C. Golf



Structure ID: HW A-1 - 15 S&F HW w/ED
P1 HWSF15D 15" - SLOPED & FLARED HEADWALL w/DISS F/F

DIMENSIONS									
PIPE #	A	B	C	D	E	F	G	H	I
15"	2'-0"	3'-6"	2'-0"	1'-6"	4'-0"	3'	2'	2'-0"	4'-0"
WEIGHT									DISSIPATORS
3,161 LBS.									1 EA.

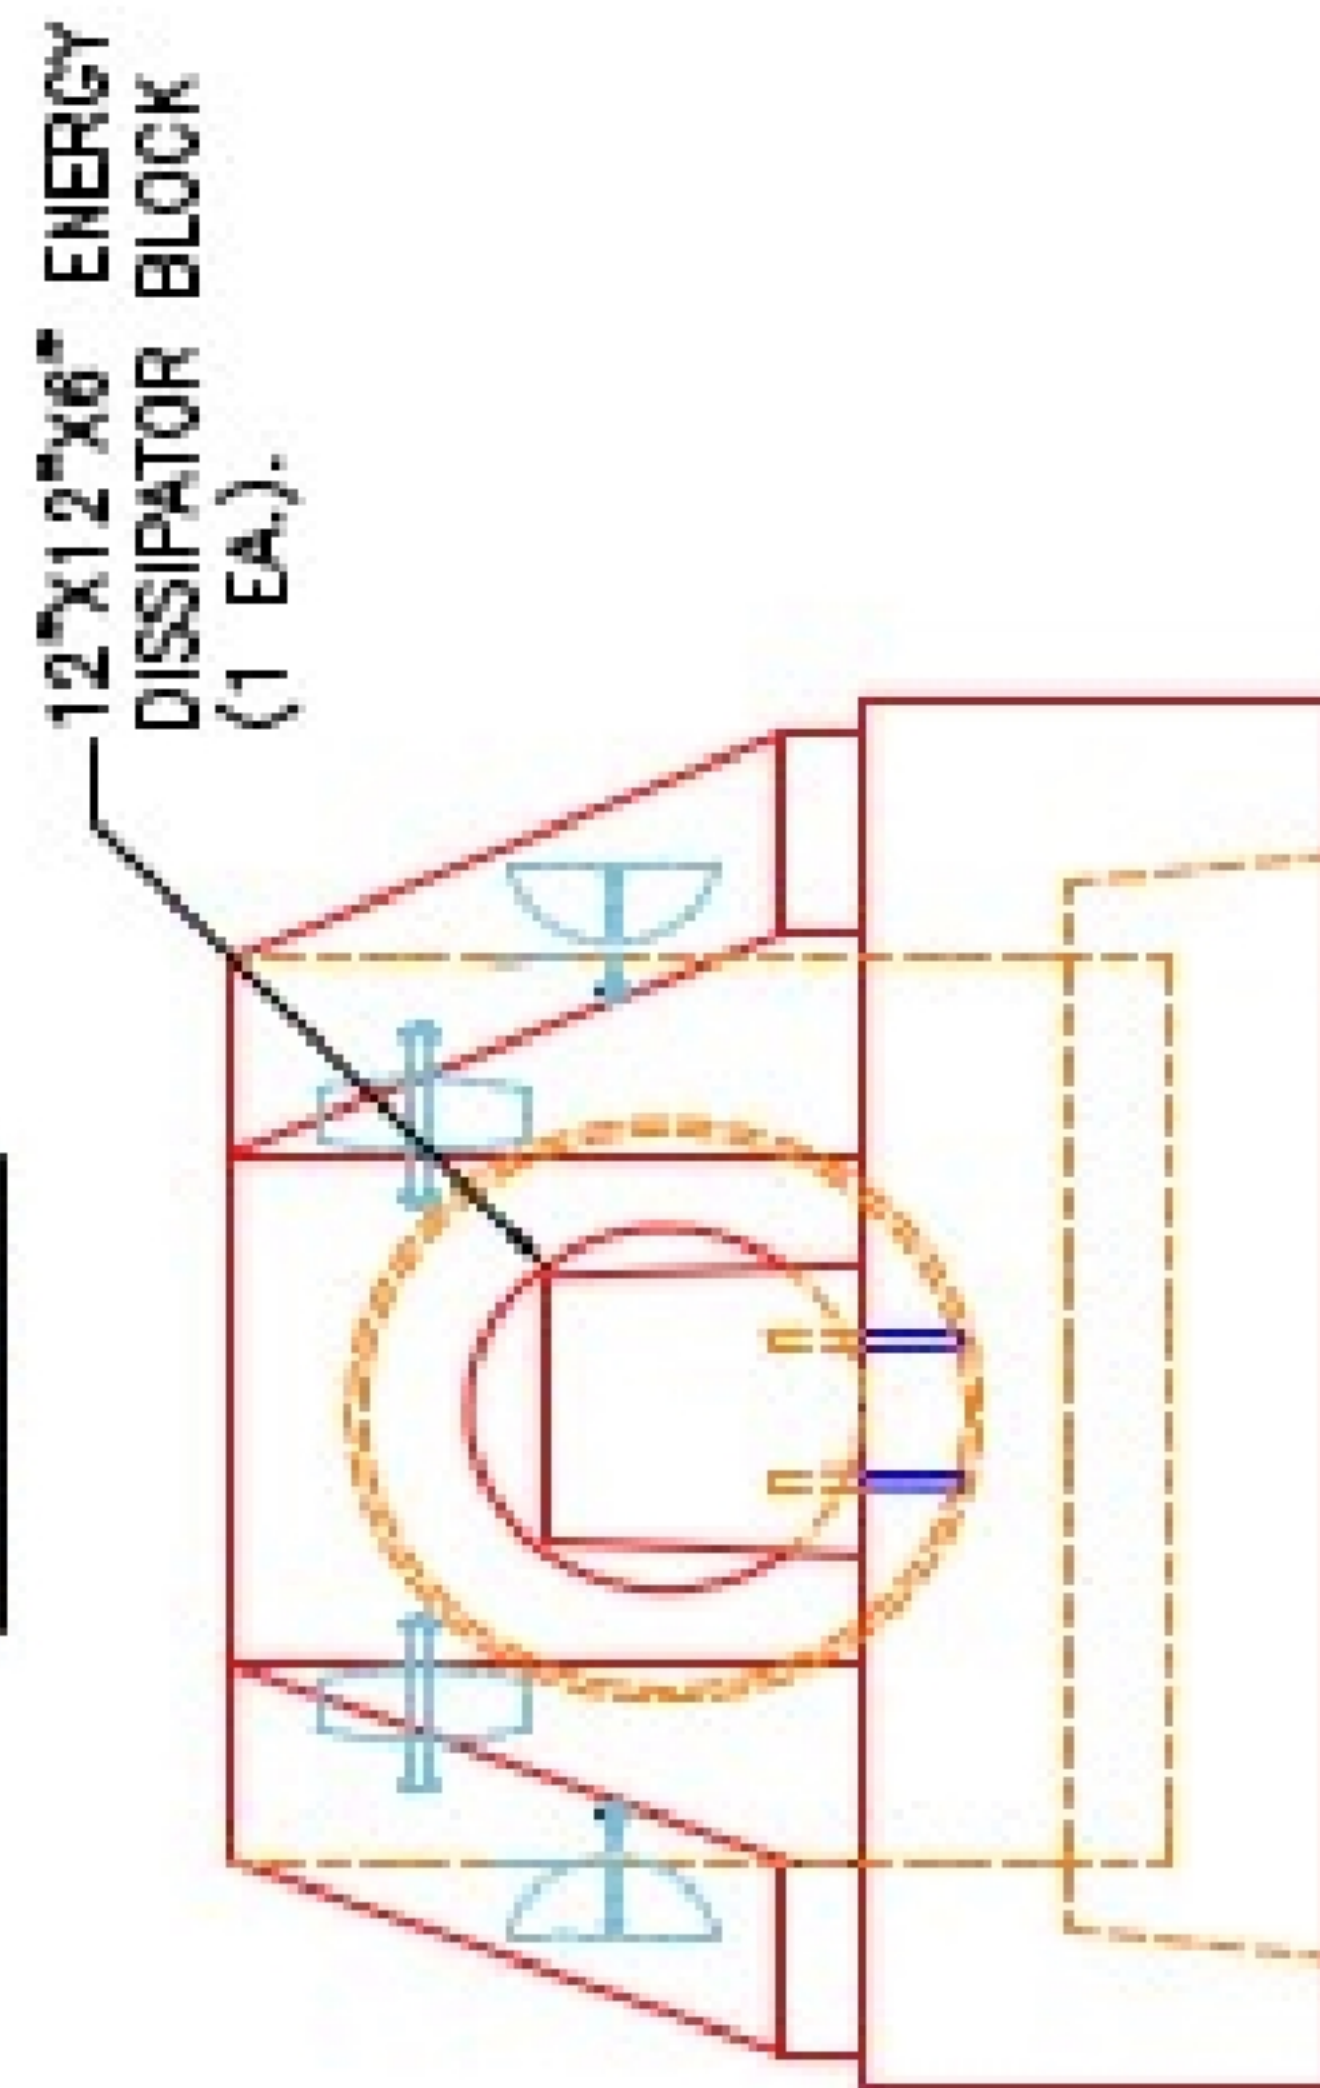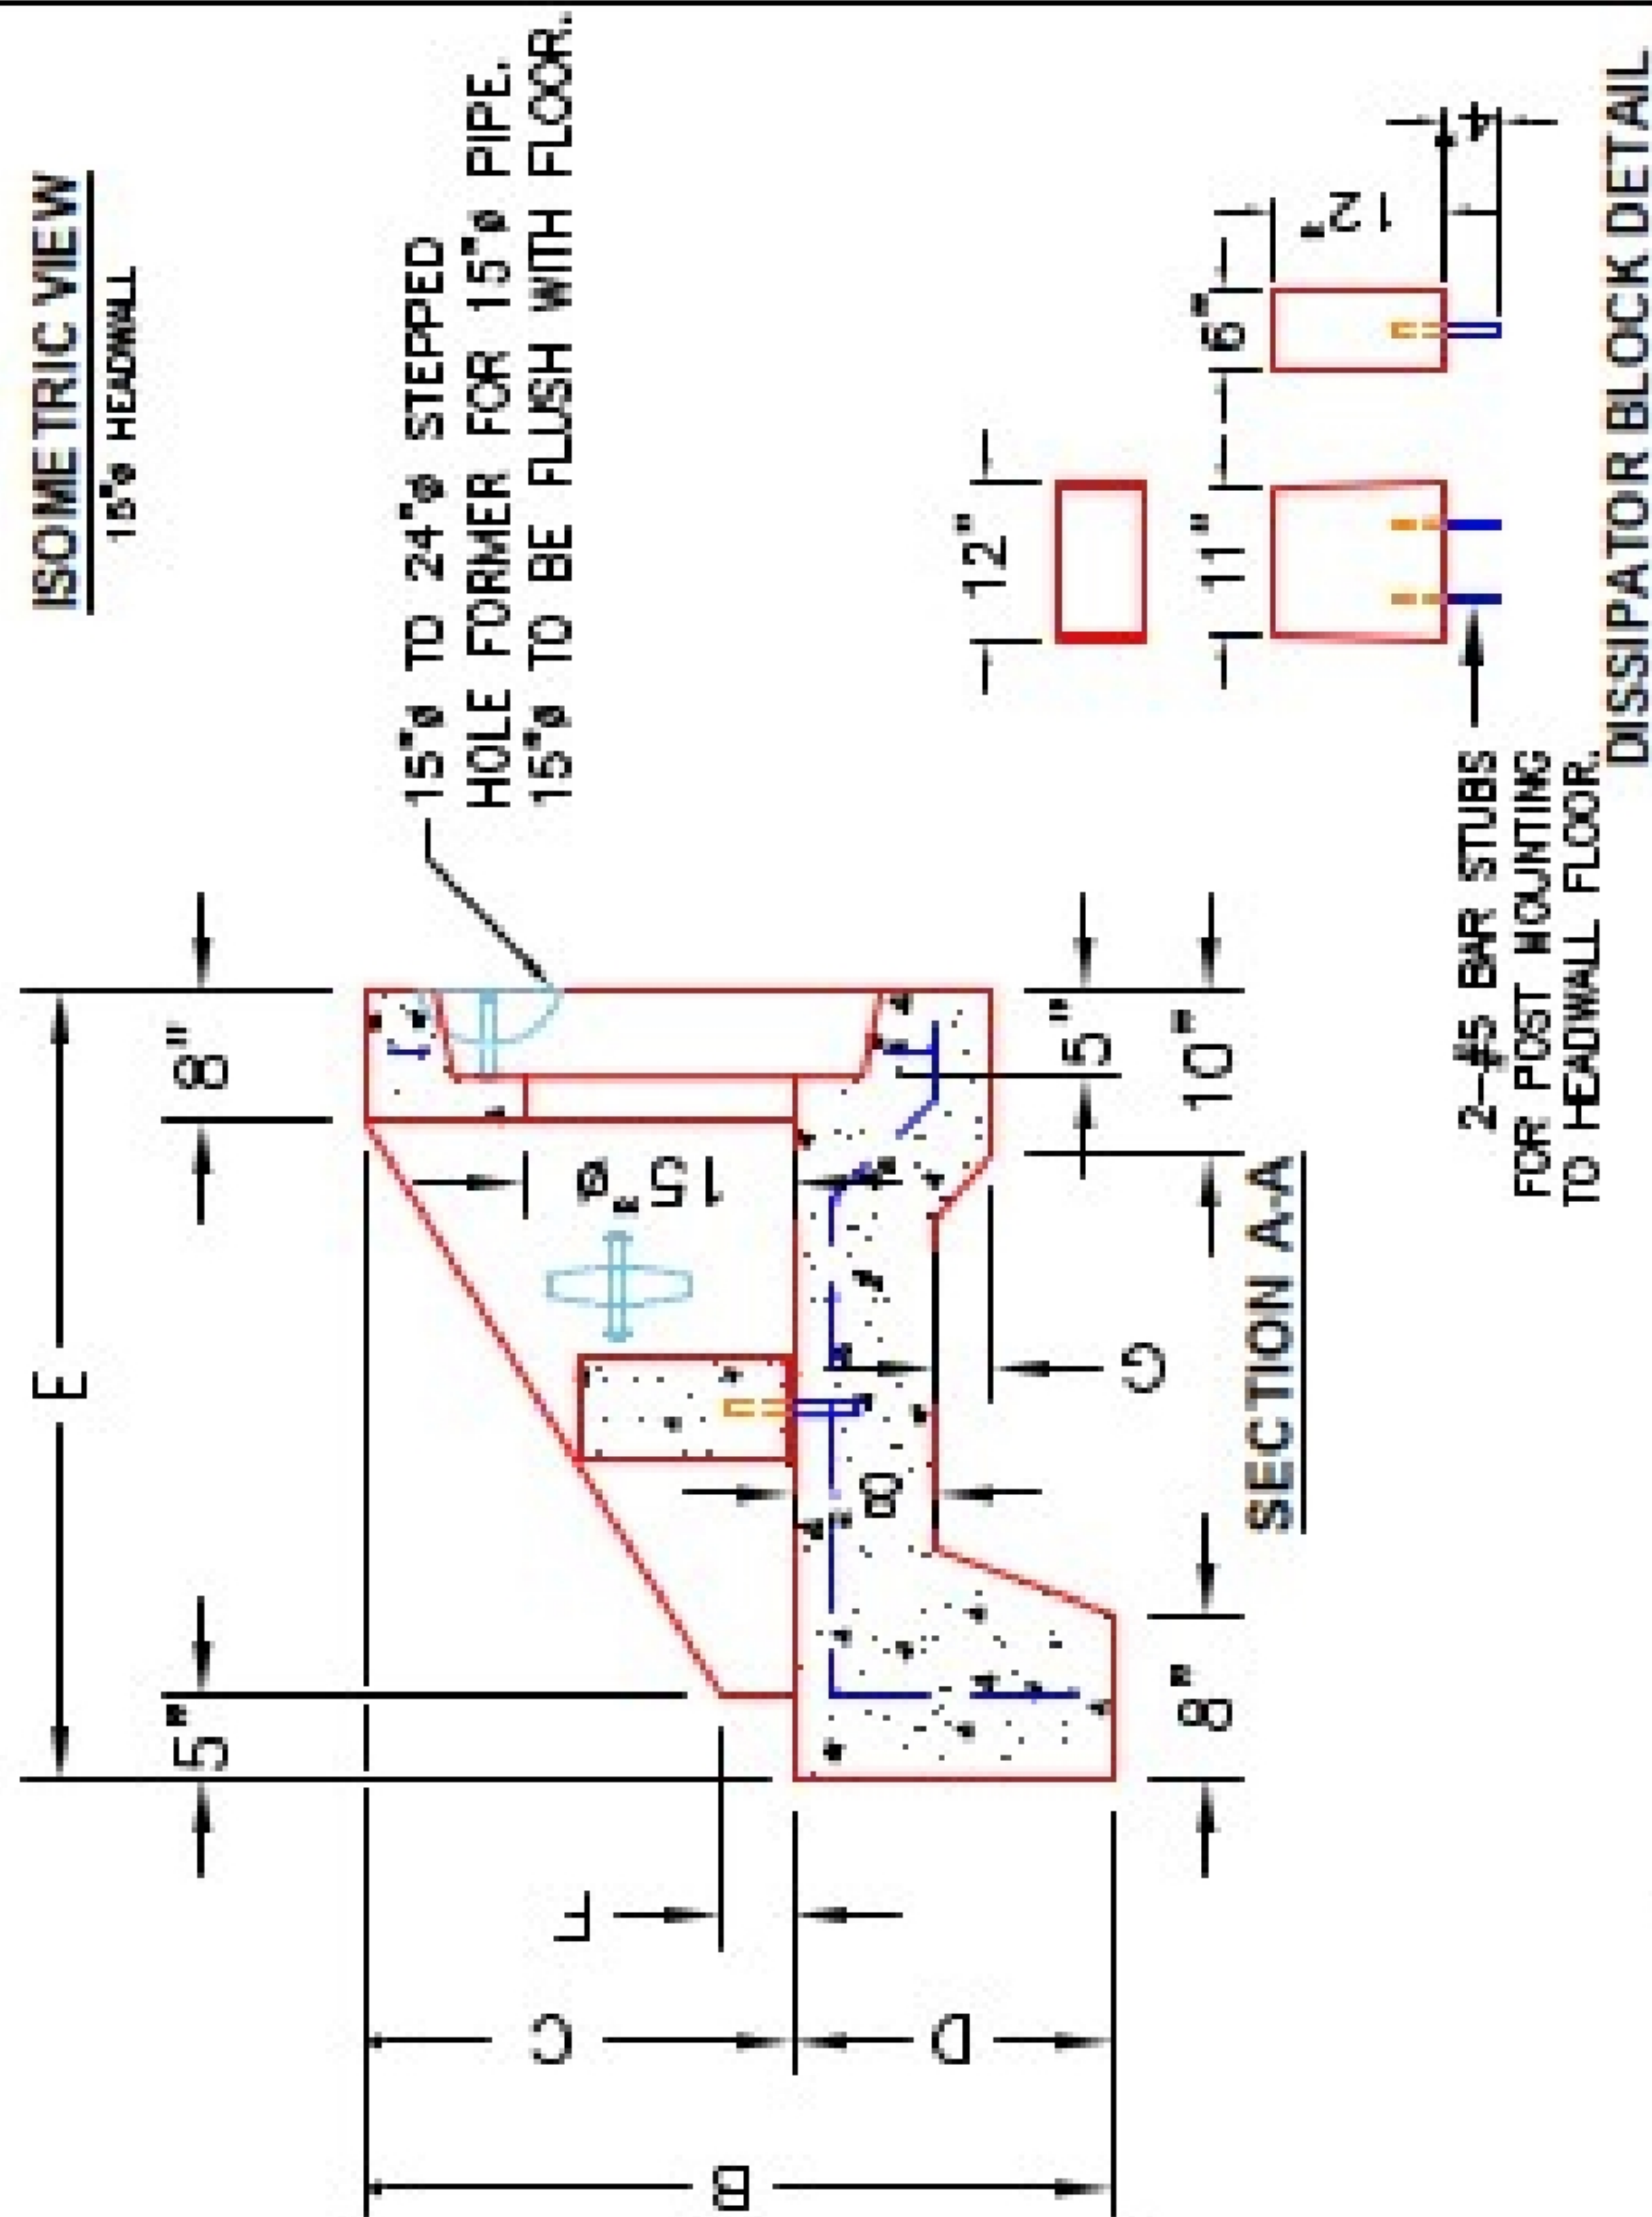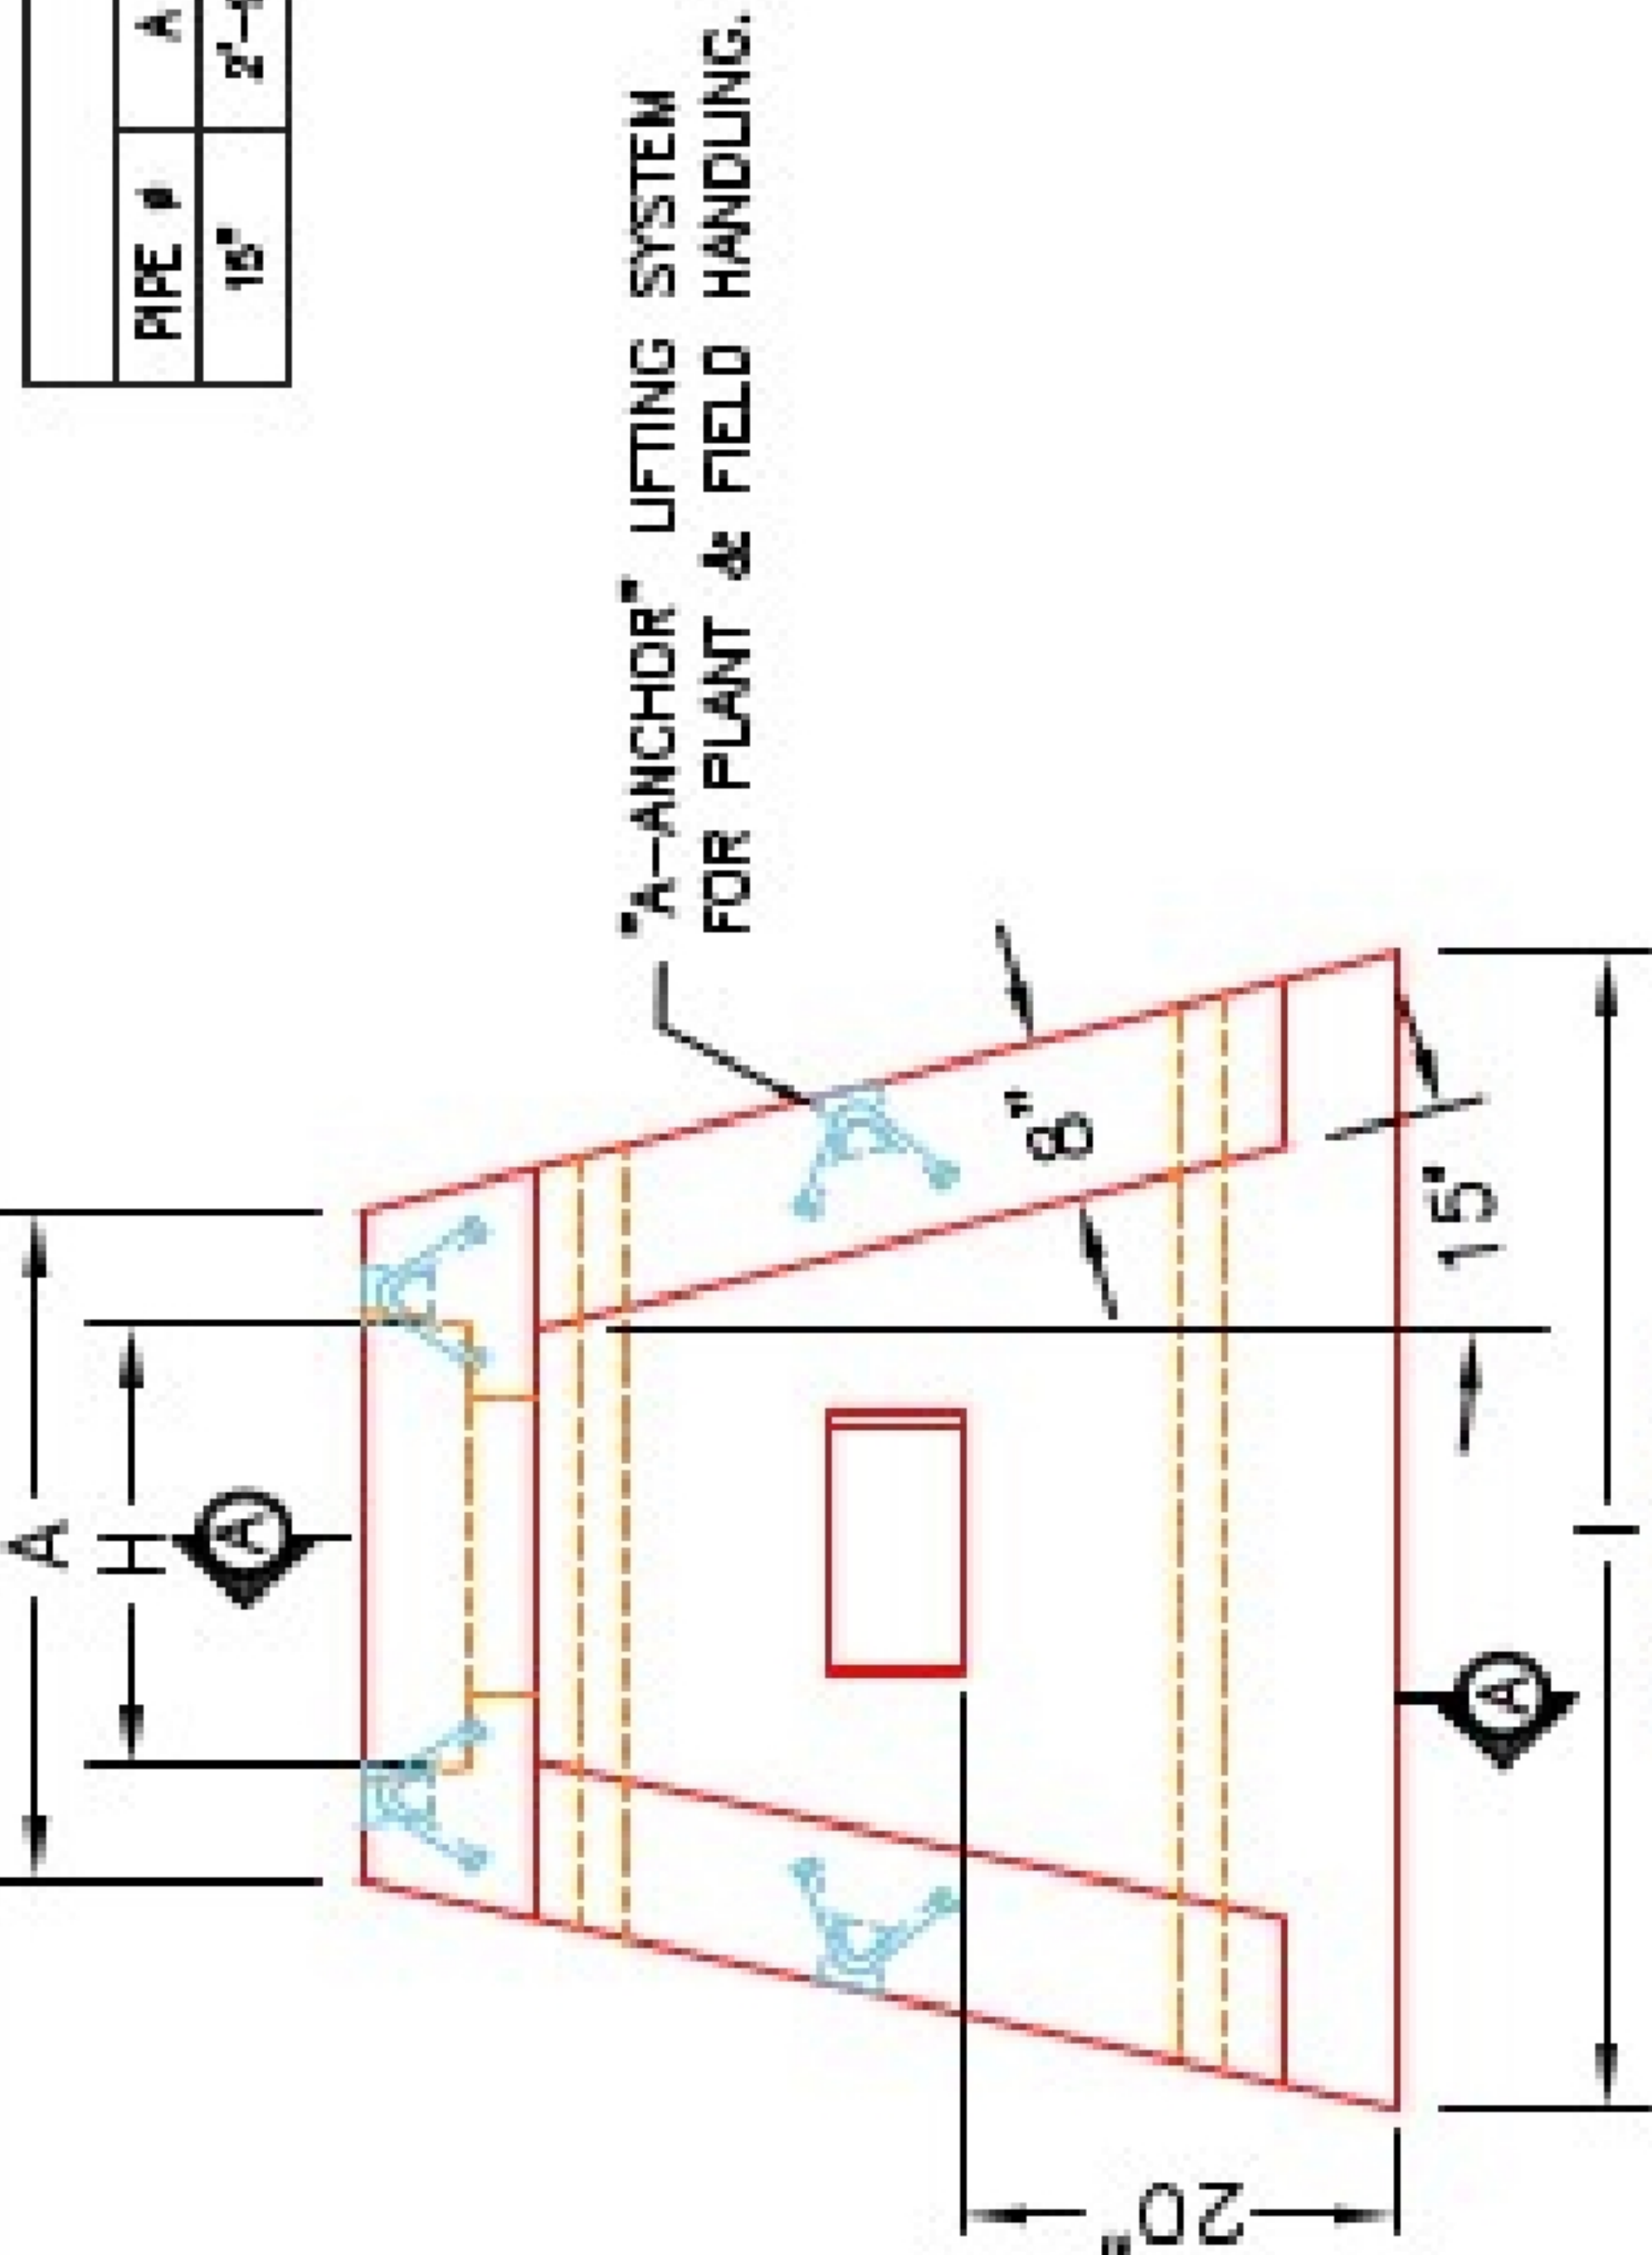

- NOTES:
1. CONCRETE: 4500 PSI @ 28 DAYS.
 2. REINFORCING: #4 BAR @ 12" C/C E.W. - GRADE 60, (WITH 2" CONCRETE COVER MINIMUM)
 3. REINFORCING BARS TO BE TACK WELDED OR TIED.
 4. DRAWING TO BE USED IN CONJUNCTION WITH KYTC STD. DRAWING RDH-020-03 AND THE STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION.
 5. 3" CHAMFER ON ALL EXPOSED EDGES.

PRODUCTION WORK ORDER		PRODUCT I.D.: HWSF15D	DESCRIPTION: KYTC 15" SLOPED & FLARED HEADWALL W/DISSIPATORS
	QUALITY CONTROL CHECKLIST		CUSTOMER: STOCK
	☐ ALL DIMENSIONS CORRECT.		PROJECT: STOCK INVENTORY
	☐ LIFTERS INSTALLED.		STRUCTURE ID: N/A
	☐ STEPPED HF CORRECT SIZE.		QUOTE/SALES ORDER NO: N/A
	☐ REINFORCING CORRECT.		CHECK: J.H. ROSS, PE
	☐ DISSIPATOR BLOCK INSTALLED.		DRAWING: N. RICHARDS
☐ EDGES CHAMFERED.		DATE: 09/06/22	SCALE: NTS
☐ ALL PATCHWORK ACCEPTABLE.		PG. 1 of 1	