




Structure ID: MIT-L - MIT Modular Wall/Footing Left

P2 CVBS

32" x 240" MIT Section B - 32" x 240" MIT Section B - 32" x 234"




- GENERAL NOTES:**
1. MANUFACTURED TO ASTM C-913 (LATEST REVISION).
 2. CONCRETE: 4,000 PSI AT 28 DAYS.
 3. REINFORCING: #5 BAR @ 12" C-C E.W. SEE REINFORCEMENT CUT SHEET FOR ADDITIONAL INFORMATION.
 4. 1/2" CHAMFER ON ALL EXPOSED EDGES.
 5. WEIGHT:
 6. **FIRST POUR - 7,250 LBS**
SECOND POUR - 3,849 LBS
TOTAL - 11,099 LBS EACH
48 TOTAL REQUIRED

FIRST POUR DRAWING

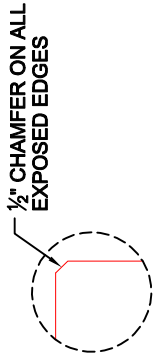

DETAIL A

ADDITIONAL 3/6" X 3/6" "L" BAR IN CORNER @ 12" C-C (NOT SHOWN ON CUT SHEET)

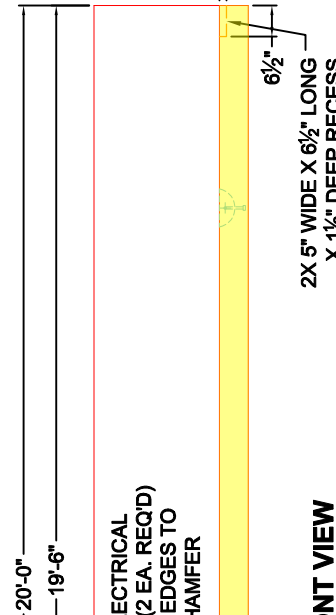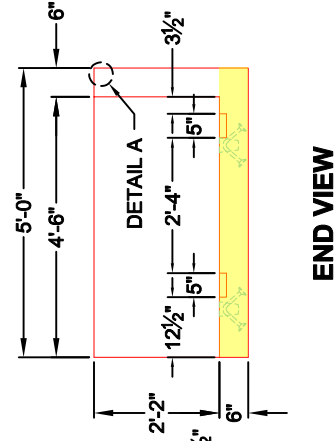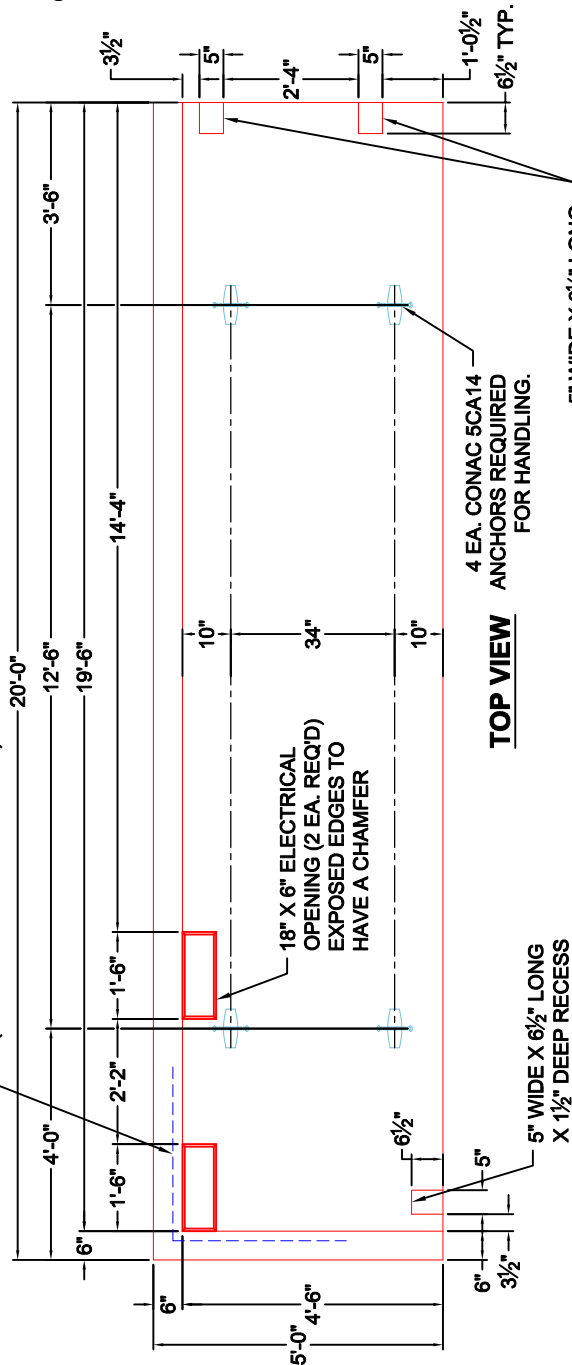

18" X 6" ELECTRICAL OPENING (2 EA. REQ'D) EXPOSED EDGES TO HAVE A CHAMFER

5" WIDE X 6 1/2" LONG X 1 1/2" DEEP RECESS

ADDITIONAL 24" X 24" "L" BAR IN CORNER @ 12" C-C (NOT SHOWN ON CUT SHEET)



Structure ID: MIT-L - MIT Modular Wall/Footing Left

P2 CVBS

32" x 240" MIT Section B - 32" x 240" MIT Section B - 32" x 234"

REINFORCEMENT CUT SHEET

- GENERAL NOTES:**
1. MANUFACTURED TO ASTM C-913 (LATEST REVISION).
 2. CONCRETE: 4,000 PSI AT 28 DAYS.
 3. REINFORCING: #5 BAR @ 12" C-C.E.W. SEE REINFORCEMENT CUT SHEET FOR ADDITIONAL INFORMATION.
 4. PER ASTM A615 (GRADE 60).
 5. 1/2" CHAMFER ON ALL EXPOSED EDGES. WEIGHT:
 6. FIRST POUR - 7,250 LBS
 SECOND POUR - 3,849 LBS
 TOTAL - 11,099 LBS EACH
 48 TOTAL REQUIRED

