

Job Name: 25-1431 - Georgetown Commons
 Job Location: Georgetown, KY
 Contractor: Winwater Hartford KY Co.

Plant: Beaver Dam
 4/24/2026 2:18:07 PM

Tech: J. Coppage
 PC: A. Chambers



Structure ID: CB 300

P1 BX3636-08BA42

BOX BASE 8inW, 8inF

- P2) 36" x 36" - CASTING HEIGHT - 3"
- P1) 36" x 36" - BOX BASE 8inW, 8inF - 42"
- 1) CASTING - HOE 595 F/G
- 1) 36" x 36" - SGL 1"x14.5' Butyl (2x)
- 1) Hole - 26

- Structure Notes:**
1. JR HOE HOE-595 PROVIDED BY ICAST.
 2. PER ASTM C913 SPECIFICATIONS.
 3. CONCRETE = 4,000 PSI AT 28 DAYS.
 4. REINFORCEING PER ASTM A615 (GRADE 60)
- WALLS (As .31) #5 BARS AT 12" C.C.E.W.
 - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.



Structure Total: 6797 lb

Rim: 873.75' Rim to Invert: 3.75' Slack: 2.5" Sump: 2.5" Step Position:


Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	870'	0°	26"	18" RCP B WALL	23"	Hole 26	26"	26"	0"	0"
Invert 2										
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										

RIGHT-SIDE UP VIEW (int. dimensions)

UPSIDE-DOWN VIEW (int. dimensions)




Invert: 1
 Degree: 0°
 Horz: 18"
 Hole: 26"
 Up(): 0"



Invert: 1
 Degree: 0°
 Horz: 18"
 Hole: 26"
 Up(): 0"

INSIDE WALL DIMENSIONS

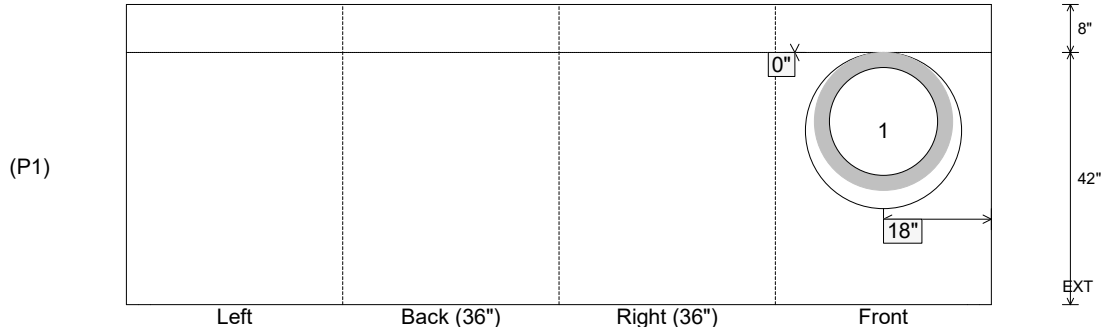

Coating (Int):
 Coating (Ext):

Seam Up: Flat
 Seam Dn: n/a

Wall Thickness: 8"
 Floor Height: 8"

Height (Int): 42"
 Height (Ext): 50"

Weight (Net): 6421 lb
 Volume (Net): 1.64cu.yd