

Job Name: 25-1431 - Georgetown Commons  
 Job Location: Georgetown, KY  
 Contractor: Winwater Hartford KY Co.

Plant: Beaver Dam

Tech: J. Coppage

4/9/2026 10:01:28 AM

PC: A. Chambers



**Structure ID: DCI 34**

**P2 MH072RSVF**

**MH RISER Custom Ht**

- P4) 24" x 36" - CASTING HEIGHT - 6"
- P3) 72" - MH FLAT TOP w/24"x36" Hole - 15"
- P2) 72" - MH RISER Custom Ht - 20"
- P1) 72" - MH BASE - 84"
- 1) CASTING - HOE 470 SET (F/G/H)
- 2) 72" - Conseal CS-102 1.00"
- 1) 24" x 36" - Conseal CS-102 1.00"
- 1) Hole - 56
- 1) Hole - 50
- 1) Hole - 20
- 7) MH Step ML-10-TDS-NCR - 10"

- Structure Notes:**
1. JR HOE HOE-470 PROVIDED BY ICAST.
  2. PER ASTM C478 SPECIFICATIONS.
  3. CONCRETE = 4,000 PSI AT 28 DAYS.
  4. REINFORCING PER ASTM A615 (GRADE 60).  
 - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W..  
 - RISER/WALLS (As .18)  
 - FLOOR (As .37) #5 BARS AT 10" C.C.E.W.


0 lb  
 4530 lb  
 2916 lb  
 13089 lb  
 394 lb  
 0 lb  
 0 lb  
 0 lb  
 0 lb  
 0 lb  
 0 lb

Structure Total: 20928 lb


Rim: 867.6' Rim to Invert: 10.35' Slack: 2.35" Sump: 3.15" Step Position: 110°

Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up (L)	Offset
Invert 1										
Invert 2										
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										


**RIGHT-SIDE UP VIEW (int. dimensions)**

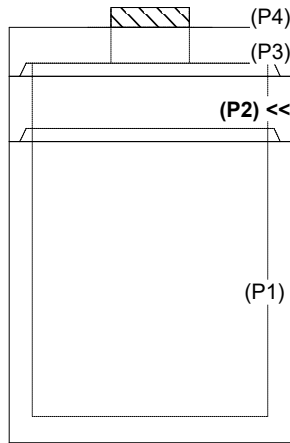

Step: 110°  
 Horz: 69.115"



**INSIDE WALL DIMENSIONS**



Coating (Int):  
 Coating (Ext):

Seam Up: Tongue  
 Seam Dn: Groove

Wall Thickness: 7"  
 Floor Height: 0"

Height (Int): 20"  
 Height (Ext): 20"

Weight (Net): 2916 lb  
 Volume (Net): 0.74cu.yd