

Job Name: 25-1431 - Georgetown Commons
 Job Location: Georgetown, KY
 Contractor: Winwater Hartford KY Co.

Plant: Beaver Dam
 4/23/2026 11:30:57 AM

Tech: J. Copping
 PC: A. Chambers




Structure ID: MH 310

P3 GR3 GRADE RING

- P4) 24" - CASTING HEIGHT - 7"
- P3) 24" - GRADE RING - 3"
- P2) 48" - ECC CONE w/ 24" HOLE - 36"
- P1) 48" - MH BASE - 36"
- 1) CASTING - HOE MC-420 F/C Storm LOU-MSD
- 1) 48" - Conseal CS-102 1.00"
- 1) Hole - 22
- 1) Hole - 20
- 6) MH Step ML-10-TDS-NCR - 10"

- Structure Notes:**
- 1. JR HOE HOE-420 PROVIDED BY ICAST
 - 2. PER ASTM C478 SPEC'S.
 - 3. CONCRETE = 4,000 PSI AT 28 DAYS.
 - 4. REINFORCING PER ASTM A615 (GRADE 60.)
 - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W..
 - RISER/WALLS (As .12)
 - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.


Structure Total: 7088 lb

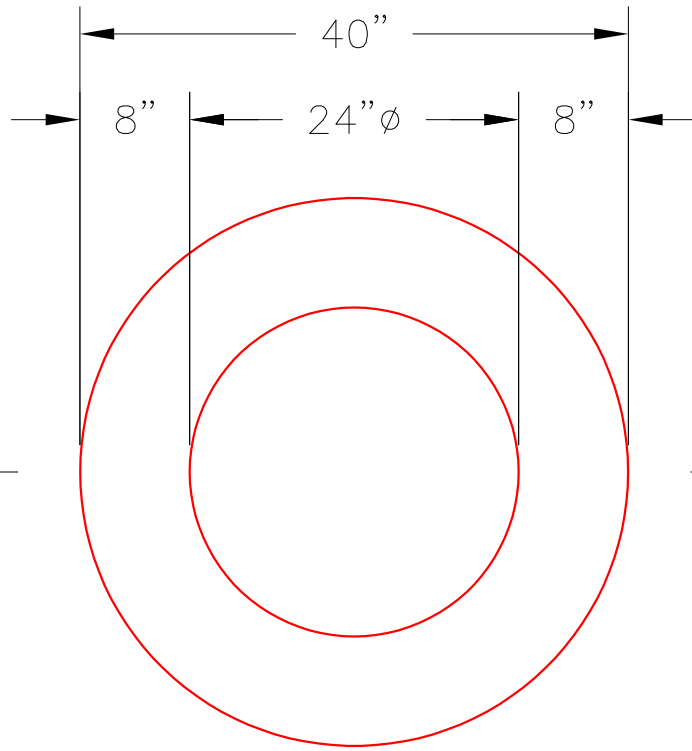


PLAN VIEW

NOTES:

- 1. GRADE RINGS MEET OR EXCEED THE FOLLOWING SPECIFICATIONS:
- CONCRETE: 4,000 PSI @ 28 DAYS.
- REINFORCING: (1) #3 HOOP CENTERED (GRADE 60)

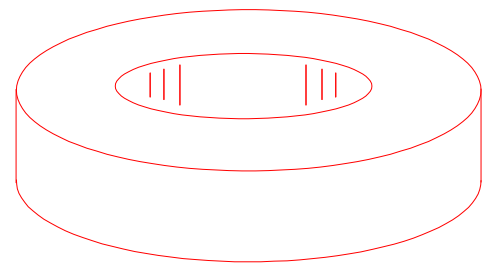

ISOMETRIC VIEW

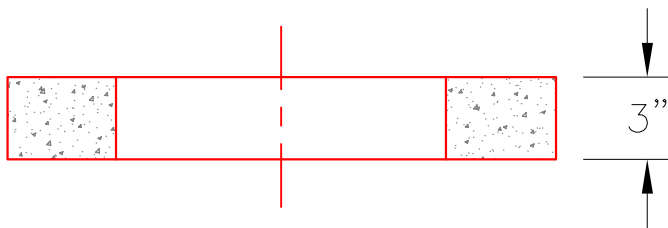

SECTION A-A

Coating (Int):
 Coating (Ext):

Seam Up: Flat
 Seam Dn: Flat

Wall Thickness: 8"

Height (Ext): 3"

Weight (Net): 202 lb
 Volume (Net): 0.05cu.yd