

Job Name: 25-1431 - Georgetown Commons
 Job Location: Georgetown, KY
 Contractor: Winwater Hartford KY Co.

Plant: Beaver Dam
 4/9/2026 10:01:03 AM

Tech: J. Copping
 PC: A. Chambers



Structure ID: MH 324


P5 GR3

GRADE RING

- P6) 24" - CASTING HEIGHT - 7"
- P5) 24" - GRADE RING - 3"
- P4) 48" - ECC CONE w/ 24" HOLE - 24"
- P3) 48" - MH RISER - 24"
- P2) 72" - MH Transition Slab 48" Hole - 15"
- P1) 72" - MH BASE - 72"
- 1) CASTING - HOE MC-420 F/C Storm LOU-MSD
- 1) 72" - Conseal CS-102 1.00"
- 2) 48" - Conseal CS-102 1.00"
- 2) Hole - 54
- 11) MH Step ML-10-TDS-NCR - 10"


0 lb	Structure Notes:
202 lb	1. JR HOE MC-420 PROVIDED BY ICAST.
1550 lb	2. PER ASTM C478 SPECIFICATIONS.
1677 lb	3. CONCRETE = 4,000 PSI AT 28 DAYS.
3864 lb	4. REINFORCING PER ASTM A615 (GRADE 60).
11420 lb	- TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W..
340 lb	- RISER/WALLS (As .18)
0 lb	- FLOOR (As .37) #5 BARS AT 10" C.C.E.W.
0 lb	
0 lb	
0 lb	

Structure Total:	19053 lb

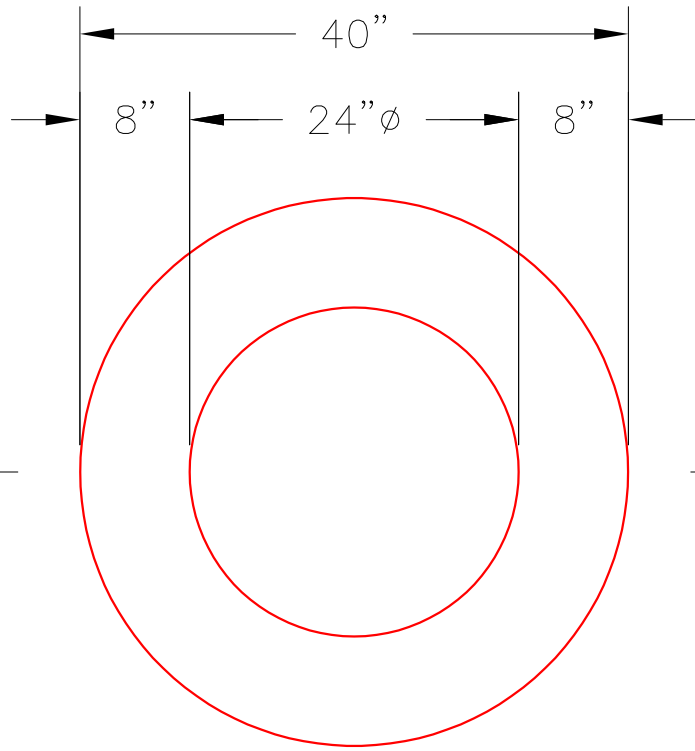


PLAN VIEW

- NOTES:**
1. GRADE RINGS MEET OR EXCEED THE FOLLOWING SPECIFICATIONS:
 - CONCRETE: 4,000 PSI @ 28 DAYS.
 - REINFORCING: (1) #3 HOOP CENTERED (GRADE 60)

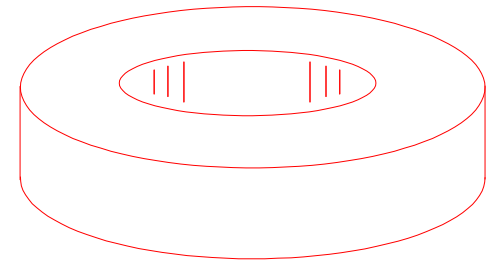

ISOMETRIC VIEW

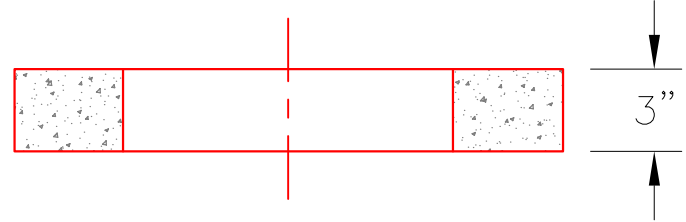

SECTION A-A

Coating (Int): Coating (Ext):	Seam Up: Flat Seam Dn: Flat	Wall Thickness: 8"	Height (Ext): 3"	Weight (Net): 202 lb Volume (Net): 0.05cu.yd
----------------------------------	--------------------------------	--------------------	------------------	---