

Job Name: 25-1431 - Georgetown Commons  
 Job Location: Georgetown, KY  
 Contractor: Winwater Hartford KY Co.

Plant: Beaver Dam

Tech: J. Coppage

4/23/2026 11:19:41 AM

PC: A. Chambers



**Structure ID: SCI 5**

**P1 BX4848-08BA60**

**BOX BASE 8inW, 8inF**

- P4) 24" x 30" - CASTING HEIGHT - 6"
- P3) 48" x 48" - CB FLAT TOP 8"W w/24"x30" HOLE - 8"
- P2) 48" x 48" - BOX RISER 8inW - 18"
- P1) 48" x 48" - BOX BASE 8inW, 8inF - 60"
- 1) CASTING - HOE 360 Set (F/G/H)
- 1) Hole - 38
- 3) Hole - 30

- Structure Notes:**
1. JR HOE HOE-360 PROVIDED BY ICAST.
  2. PER ASTM C913 SPECIFICATIONS.
  3. CONCRETE = 4,000 PSI AT 28 DAYS.
  4. REINFORCING PER ASTM A615 (GRADE 60).
    - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W..
    - RISER/WALLS (As .18)
    - FLOOR (As .37) #5 BARS AT 10" C.C.E.W.


Structure Total: 14856 lb

Rim: 866.75' Rim to Invert: 7.6' Slack: 1.1" Sump: 1.9" Step Position:


Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ( )	Offset
Invert 1	860.65'	340°	28.866"	30" HDPE	35.1"	Hole 38	38"	40.439"	17.35"	8"
Invert 2	859.15'	90°	32"	24" HDPE	27.8"	Hole 30	30"	30"	0"	0"
Invert 3	859.15'	180°	32"	24" HDPE	27.8"	Hole 30	30"	30"	0"	0"
Invert 4	859.15'	285°	30.222"	24" HDPE	27.8"	Hole 30	30"	31.058"	0"	-10"
Invert 5										
Invert 6										
Invert 7										
Invert 8										

RIGHT-SIDE UP VIEW (int. dimensions)

UPSIDE-DOWN VIEW (int. dimensions)

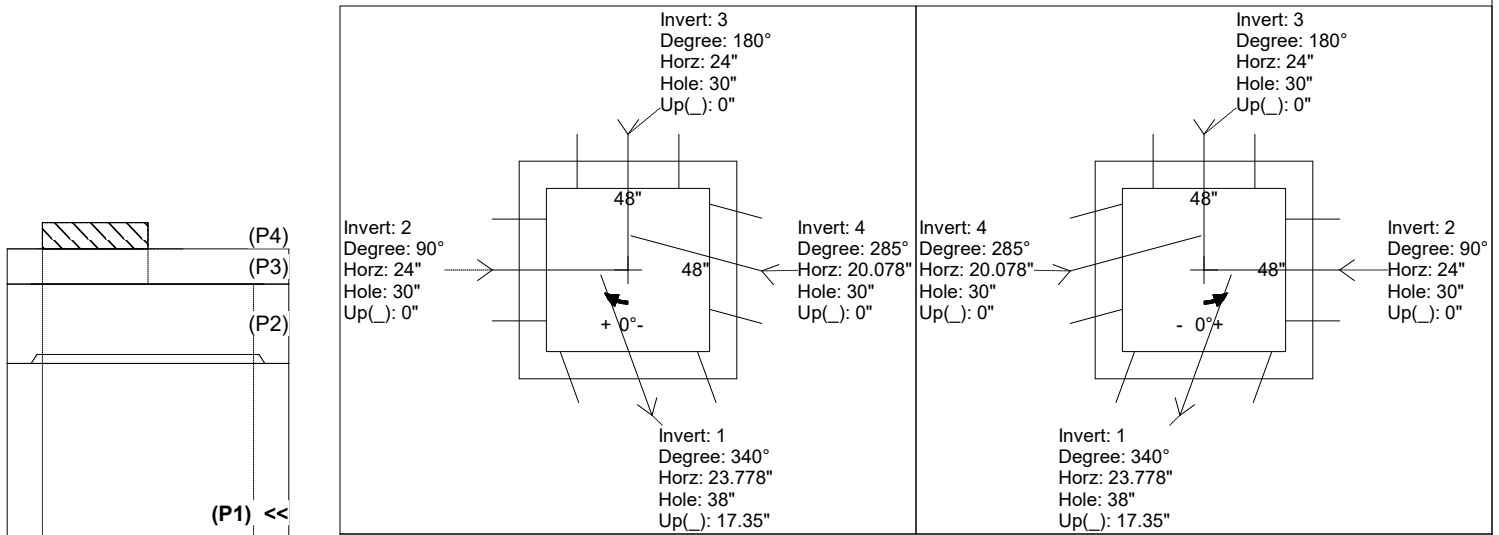

INSIDE WALL DIMENSIONS

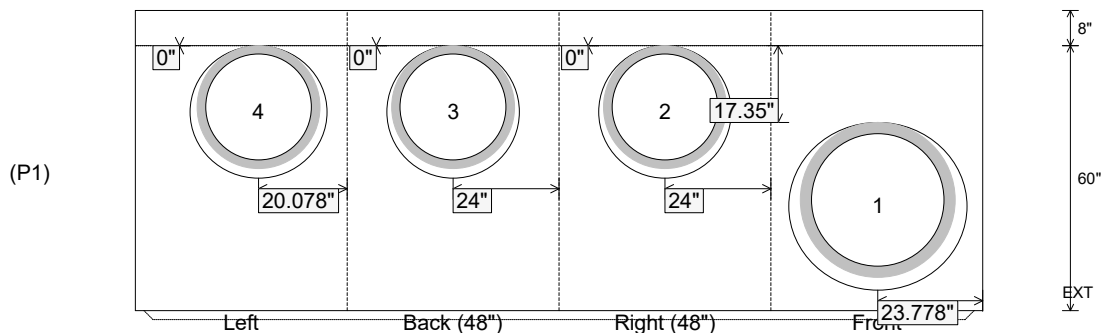

Coating (Int): Coating (Ext):	Seam Up: Tongue Seam Dn: n/a	Wall Thickness: 8" Floor Height: 8"	Height (Int): 60" Height (Ext): 68"	Weight (Net): 9521 lb Volume (Net): 2.43cu.yd
----------------------------------	---------------------------------	--	--	--