

Job Name: 25-1431 - Georgetown Commons
 Job Location: Georgetown, KY
 Contractor: Winwater Hartford KY Co.

Plant: Beaver Dam

4/23/2026 11:31:53 AM

Tech: J. Coppage

PC: A. Chambers



Structure ID: SCI 5

P2 BX4848-08R18

BOX RISER 8inW

- P4) 24" x 30" - CASTING HEIGHT - 6"
- P3) 48" x 48" - CB FLAT TOP 8"W w/24"x30" HOLE - 8"
- P2) 48" x 48" - BOX RISER 8inW - 18"
- P1) 48" x 48" - BOX BASE 8inW, 8inF - 60"
- 1) CASTING - HOE 360 Set (F/G/H)
- 1) Hole - 38
- 3) Hole - 30



- Structure Notes:
1. JR HOE HOE-360 PROVIDED BY ICAST.
 2. PER ASTM C913 SPECIFICATIONS.
 3. CONCRETE = 4,000 PSI AT 28 DAYS.
 4. REINFORCING PER ASTM A615 (GRADE 60).
 - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W..
 - RISER/WALLS (As .18)
 - FLOOR (As .37) #5 BARS AT 10" C.C.E.W.

Structure Total: 14856 lb


Rim: 866.75' Rim to Invert: 7.6' Slack: 1.1" Sump: 1.9" Step Position:

Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up (L)	Offset
Invert 1										
Invert 2										
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										

RIGHT-SIDE UP VIEW (int. dimensions)

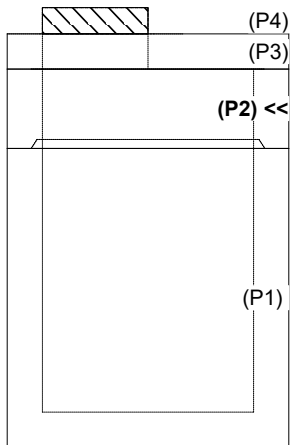

INSIDE WALL DIMENSIONS



Coating (Int): Coating (Ext):	Seam Up: Flat Seam Dn: Groove	Wall Thickness: 8" Floor Height: 0"	Height (Int): 18" Height (Ext): 18"	Weight (Net): 2707 lb Volume (Net): 0.69cu.yd
----------------------------------	----------------------------------	--	--	--