

Job Name: 25-1431 - Georgetown Commons
 Job Location: Georgetown, KY
 Contractor: Winwater Hartford KY Co.

Plant: Beaver Dam
 4/28/2026 8:56:25 AM

Tech: J. Copping
 PC: A. Chambers




Structure ID: SSMH-238

P4 GR4 GRADE RING

- P5) 24" - CASTING HEIGHT - 7"
- P4) 24" - GRADE RING - 4"
- P3) 48" - ECC CONE w/ 24" HOLE NO STEP - 36"
- P2) 48" - MH RISER NO STEPS - 48"
- P1) 48" - MH BASE - 24"
- 1) JOINT WRAP - 0.065"x6"x50' CONSEAL CS212
- 1) JOINT WRAP PRIMER - CONSEAL CS-75 (1 gal.)
- 1) 48" - MH INVERT CHANNEL - FULL HEIGHT
- 2) 48" - Conseal CS-102 1.00" (Double)
- 2) A-Lok - 0285
- 1) A-Lok - 0200


| | |
|------------------|--|
| 0 lb | Structure Notes: |
| 270 lb | 1. JR HOE MC-375 SELF SEALING SAN BY ICAST |
| 3000 lb | 2. PER ASTM C478 SPECIFICATIONS. |
| 3353 lb | 3. CONCRETE = 4,000 PSI AT 28 DAYS. |
| 2928 lb | 4. REINFORCING PER ASTM A615 (GRADE 60). |
| 0 lb | - CONE (As .12) |
| 0 lb | - RISER/WALLS (As .12) |
| 1440 lb | - FLOOR (As .31) #5 BARS AT 12" C.C.E.W. |
| 0 lb | 5. **NO STEPS** |
| 2 lb | |
| 1 lb | |
| ----- | |
| Structure Total: | 10994 lb |

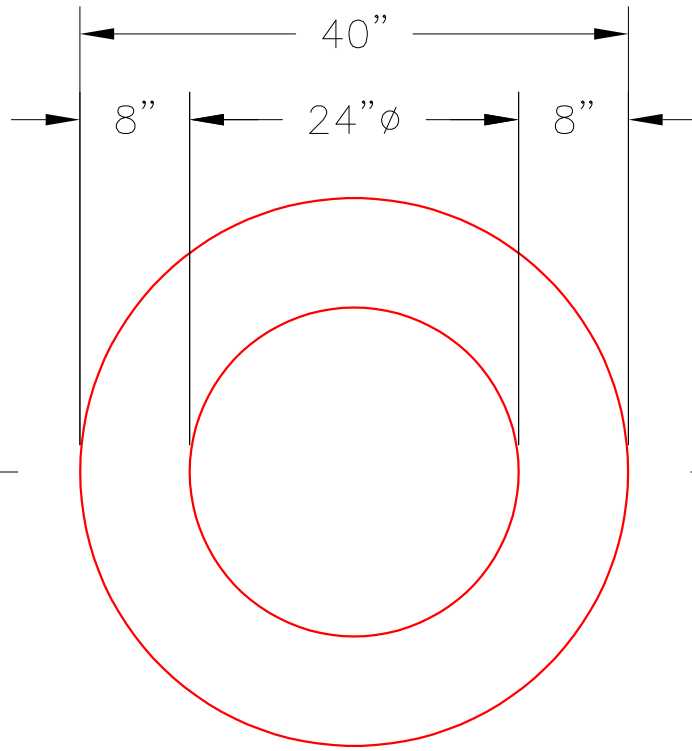


PLAN VIEW

NOTES:

1. GRADE RINGS MEET OR EXCEED THE FOLLOWING SPECIFICATIONS:
 - CONCRETE: 4,000 PSI @ 28 DAYS.
 - REINFORCING: (1) #3 HOOP CENTERED (GRADE 60)

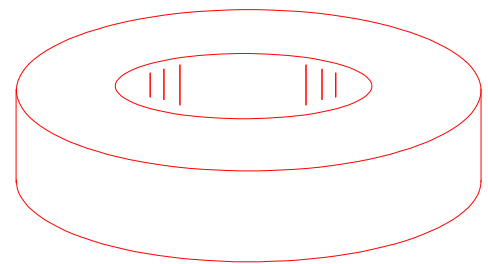

ISOMETRIC VIEW

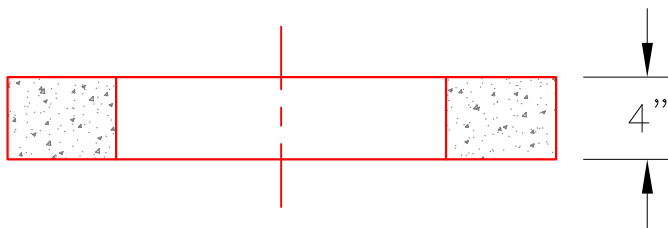

SECTION A-A

| | | | | |
|----------------------------------|--------------------------------|--------------------|------------------|---|
| Coating (Int): Coating (Ext): | Seam Up: Flat Seam Dn: Flat | Wall Thickness: 8" | Height (Ext): 4" | Weight (Net): 270 lb Volume (Net): 0.07cu.yd |
|----------------------------------|--------------------------------|--------------------|------------------|---|