

Job Name: 25-1601C Spring Creek Parkway
Job Location: Clarksville, TN
Contractor: Byard Construction, LLC

Plant: Beaver Dam
8/7/2026 1:08:04 PM

Tech: J. Coppage
PC: A. Chambers



Structure ID: 12in GR

P1 GR28x34x6x12

GRADE RING


P7) 28" x 34" - GRADE RING - 12"
P6) 28" x 34" - GRADE RING - 12"
P5) 28" x 34" - GRADE RING - 12"
P4) 28" x 34" - GRADE RING - 12"
P3) 28" x 34" - GRADE RING - 12"
P2) 28" x 34" - GRADE RING - 12"
P1) 28" x 34" - GRADE RING - 12"
7) 28" x 34" - Conseal CS-102 1.00"

894 lb
894 lb
894 lb
894 lb
894 lb
894 lb
894 lb
0 lb


Structure Total: 6259 lb

Structure Notes:


1. PER ASTM C913 SPECIFICATIONS.
 2. CONCRETE = 4,000 PSI AT 28 DAYS.
 3. REINFORCING PER ASTM A615 (GRADE 60).
- AS SHOWN BELOW

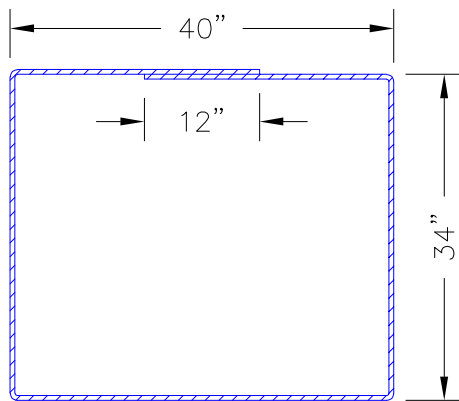


#4 BAR REINFORCING

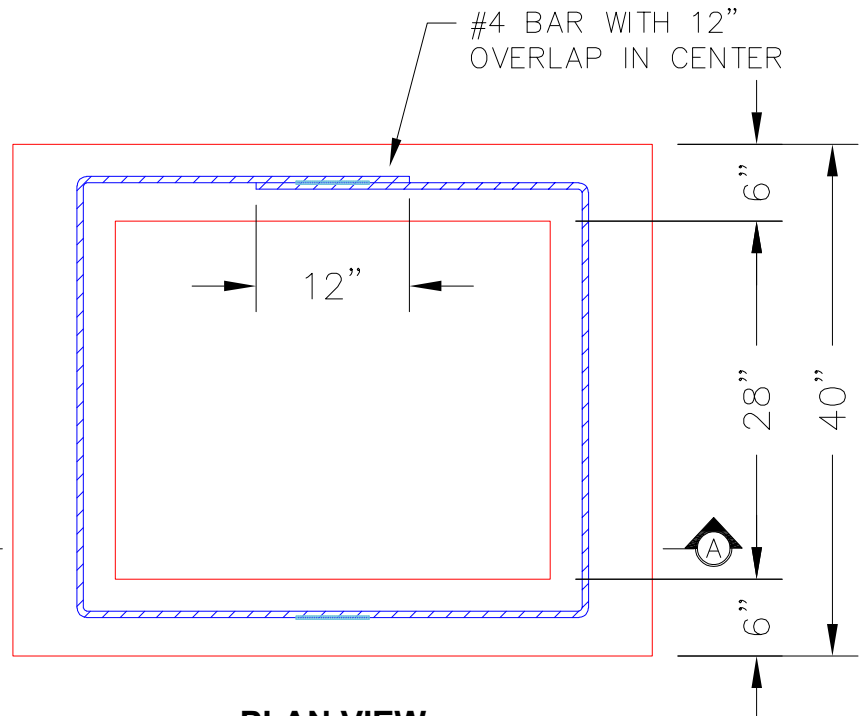

PLAN VIEW

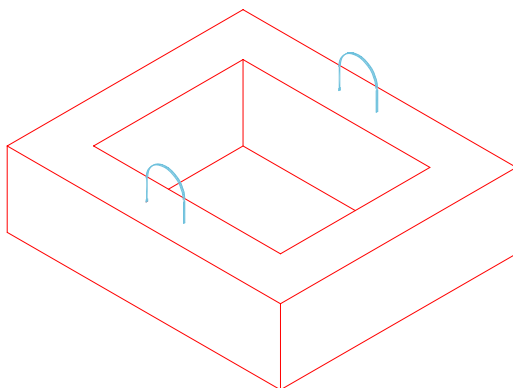

ISOMETRIC VIEW

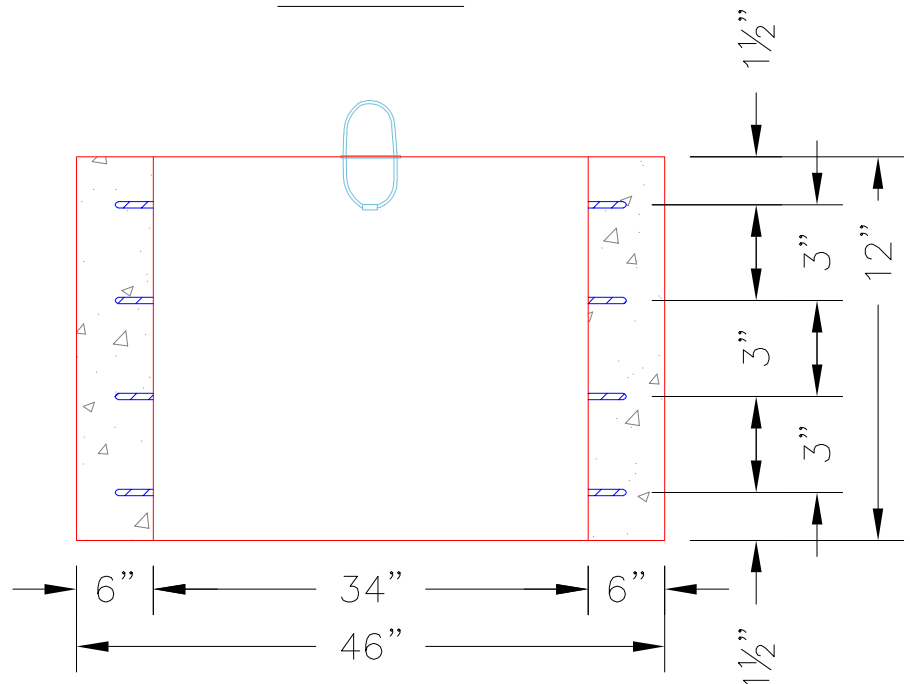

SECTION A-A

Coating (Int):
Coating (Ext):

Seam Up: Flat
Seam Dn: Flat

Wall Thickness: 6"

Height (Ext): 12"

Weight (Net): 894 lb
Volume (Net): 0.23cu.yd