

Job Name: 25-1601C Spring Creek Parkway
Job Location: Clarksville, TN
Contractor: Byard Construction, LLC

Plant: Beaver Dam

8/7/2026 1:07:54 PM

Tech: J. Coppage

PC: A. Chambers



Structure ID: 3in GR

P10 GR28x34x6x3


GRADE RING

P13) 28" x 34" - GRADE RING - 3"
P12) 28" x 34" - GRADE RING - 3"
P11) 28" x 34" - GRADE RING - 3"
P10) 28" x 34" - GRADE RING - 3"
P9) 28" x 34" - GRADE RING - 3"
P8) 28" x 34" - GRADE RING - 3"
P7) 28" x 34" - GRADE RING - 3"
P6) 28" x 34" - GRADE RING - 3"
P5) 28" x 34" - GRADE RING - 3"
P4) 28" x 34" - GRADE RING - 3"
P3) 28" x 34" - GRADE RING - 3"
P2) 28" x 34" - GRADE RING - 3"
P1) 28" x 34" - GRADE RING - 3"
13) 28" x 34" - Conseal CS-102 1.00"


Structure Notes:
1. PER ASTM C913 SPECIFICATIONS.
2. CONCRETE = 4,000 PSI AT 28 DAYS.
3. REINFORCING PER ASTM A615 (GRADE 60).
- AS SHOWN BELOW

224 lb
224 lb
224 lb
224 lb
224 lb
224 lb
224 lb
224 lb
224 lb
224 lb
224 lb
224 lb
224 lb
224 lb
224 lb
0 lb


Structure Total: 2906 lb

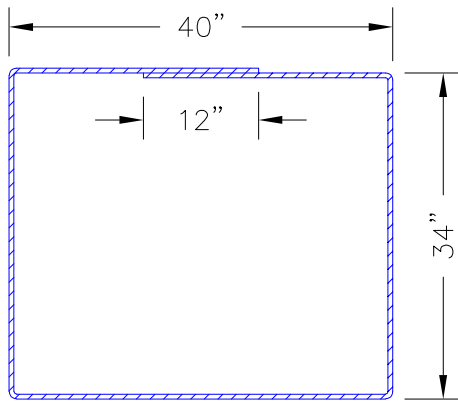

#4 BAR REINFORCING

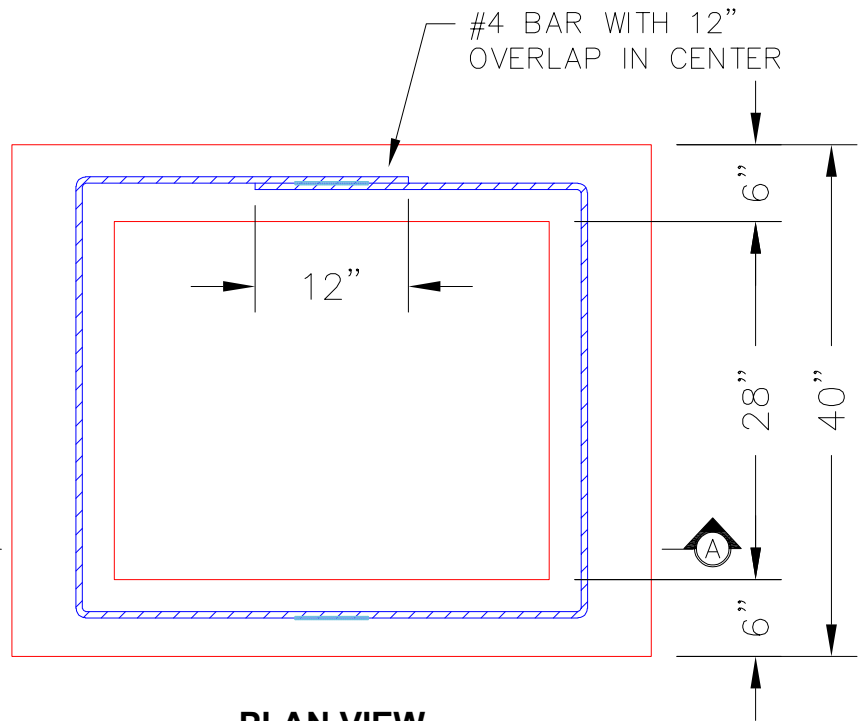


PLAN VIEW

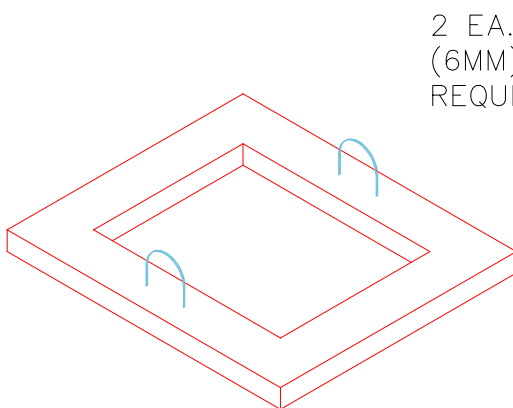

ISOMETRIC VIEW

2 EA. CONAC .8 TON $8\frac{1}{16}$ "
(6MM) WIRE ROPE ANCHORS
REQUIRED—MINIMUM.

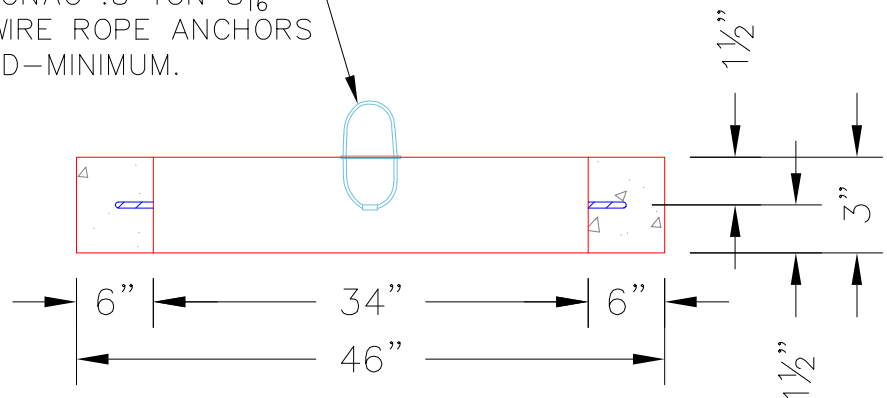

SECTION A-A

Coating (Int):
Coating (Ext):

Seam Up: Flat
Seam Dn: Flat

Wall Thickness: 6"

Height (Ext): 3"

Weight (Net): 224 lb
Volume (Net): 0.06cu.yd