

Plant: Beaver Dam

---

7/21/2026 8:50:25 AM

|       |              |
|-------|--------------|
| Tech: | S. Felletter |
| PC:   | A. Chambers  |



**GRADE RING 6"W F/F**

[illegible]

**Structure Notes:**

1. PER ASTM C913 SPECIFICATIONS.
2. CONCRETE = 4,000 PSI AT 28 DAYS.


REINFORCING PER ASTM A615 (GRADE 60).

- WALLS (As .31) #5 BARS AT 12" C.C.E.W.

NOTES:

1. MANUFACTURED TO ASTM C-478 (LATEST REVISION).
2. CONCRETE = 4,000 PSI @ 28 DAYS.
3. REINFORCING: #4 BAR AS SHOWN (GRADE 60 KSI).
4. LIFTS: 2 EA. CONAC .8 TON WIRE ROPE ANCHORS REQUIRED.

Structure Total: 9449 lb

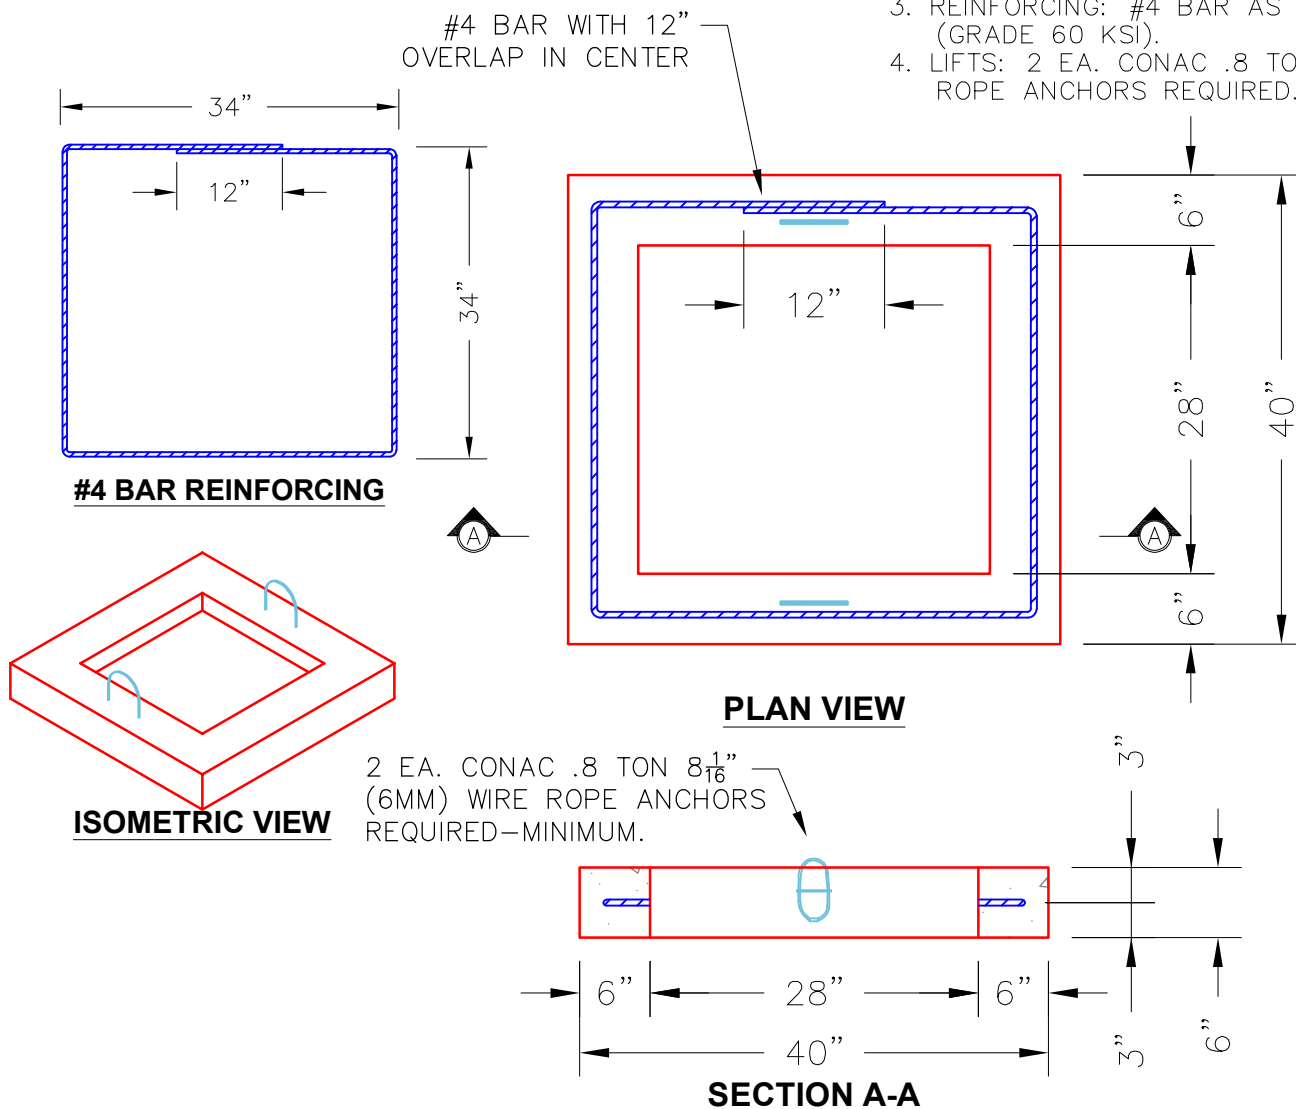

|                        |
|------------------------|
| Weight (Net): 411 lb   |
| Volume (Net): 0.1cu.yd |