

Job Name: 25-2290 - AutoZone 9385 Job Location: Louisville, KY Contractor: Cornell Harbison Excavating	Plant: 100 2/23/2026 10:31:15 AM	Tech: J. Horsley - A PC: Jay Ross Jarvis	
--	-------------------------------------	---	--

Structure ID: 4-3

P1 BX2424-08BAVF

BOX BASE 8inW, 8inF, Variable Ht F/n

P2) 24" x 24" - CASTING HEIGHT - 4"
P1) 24" x 24" - BOX BASE 8inW, 8inF, Variable Ht F/n - 38"
1) 24" x 24" - Conseal CS-102 1.00"
1) Hole - 20

0 lb
4128 lb
0 lb
0 lb

Structure Total: 4128 lb



Structure Notes:
1. PER ASTM C-913 SPECIFICATIONS
2. CONCRETE: 4,000 PSI AT 28 DAYS
3. REINFORCEMENT: #5 BAR @ 12" C.C. E.W. (GRADE 60) - 2" MIN. REBAR CLEARANCE (TYP)
4. NO STORM INVERT
5. NO STEPS
6. HOE 280T FRAME & GRATE SUPPLIED BY OTHERS

Rim: 459.5' Rim to Invert: 3.5' Slack: 0" Sump: 0" Step Position:


Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	456'	0°	20"	15" HDPE	17.6"	Hole 20	20"	20"	-1.25"	0"
Invert 2										
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										

RIGHT-SIDE UP VIEW (int. dimensions)

UPSIDE-DOWN VIEW (int. dimensions)

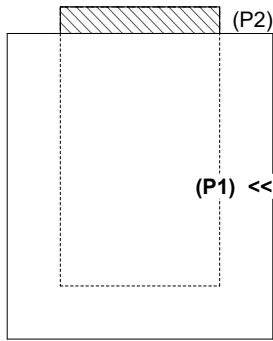

INSIDE WALL DIMENSIONS

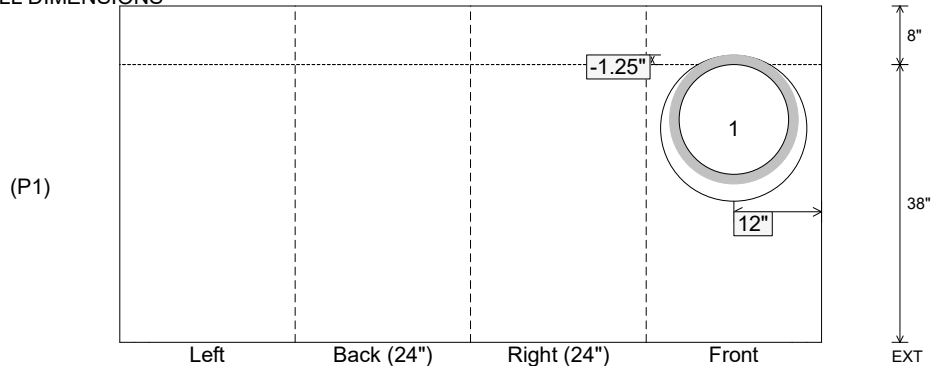

Coating (Int): Coating (Ext):	Seam Up: Flat Seam Dn: n/a	Wall Thickness: 8" Floor Height: 8"	Height (Int): 38" Height (Ext): 46"	Weight (Net): 4128 lb Volume (Net): 1.05cu.yd
----------------------------------	-------------------------------	--	--	--