
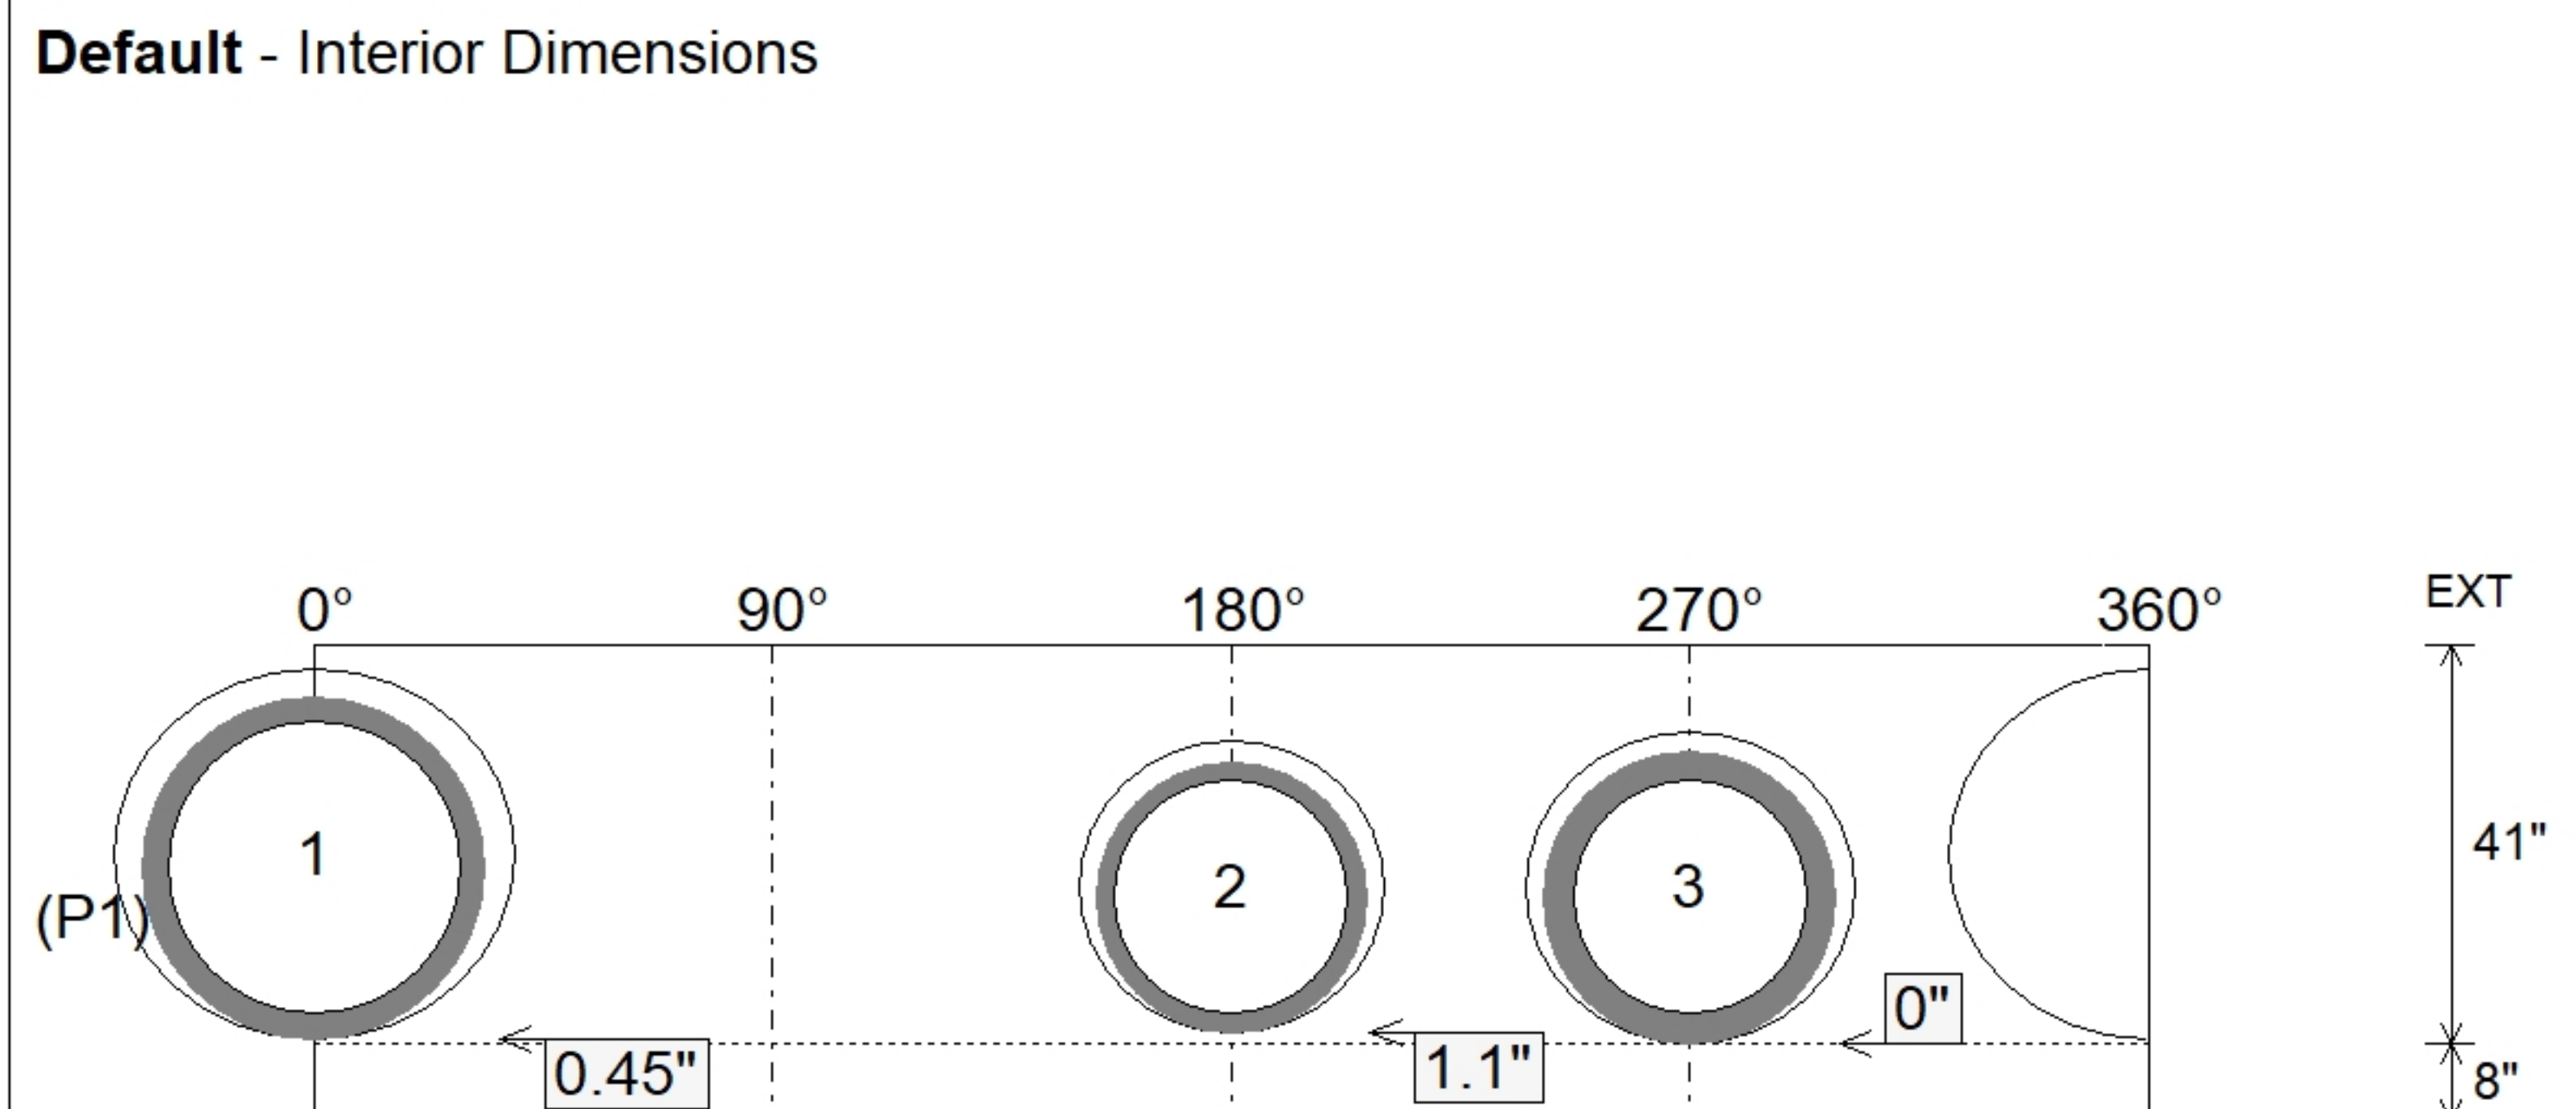


Structure Notes: PLAN LABEL: I 1. HOE 525 SET (F/G/H) PROVIDED BY ICAST. 2. PER ASTM C478 SPECIFICATIONS. 3. CONCRETE = 4,000 PSI AT 28 DAYS. 4. REINFORCING PER ASTM A615 (GRADE 60). - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W.. - RISER/WALLS (As .18) - FLOOR (As .37) #5 BARS AT 10" C.C.E.W.	STRUCTURE SUMMARY: P3) 24" x 36" - CASTING HEIGHT - 6" 0 lb P2) 60" - MH FLAT TOP w/24"x36" Hole - 8" 2153 lb P1) 60" - MH BASE Custom Ht - 41" 5610 lb 1) CASTING - HOE 525 SET (F/G/H) 442 lb 1) 60" - Conseal CS-102 1.00" 0 lb 1) 24" x 36" - Conseal CS-102 1.00" 0 lb 1) Hole - 38 0 lb 1) Hole - 30 0 lb 1) Hole - 32 0 lb 3) MH Step ML-10-TDS-NCR - 10" 0 lb ----- Structure Total: 8205 lb
--	--

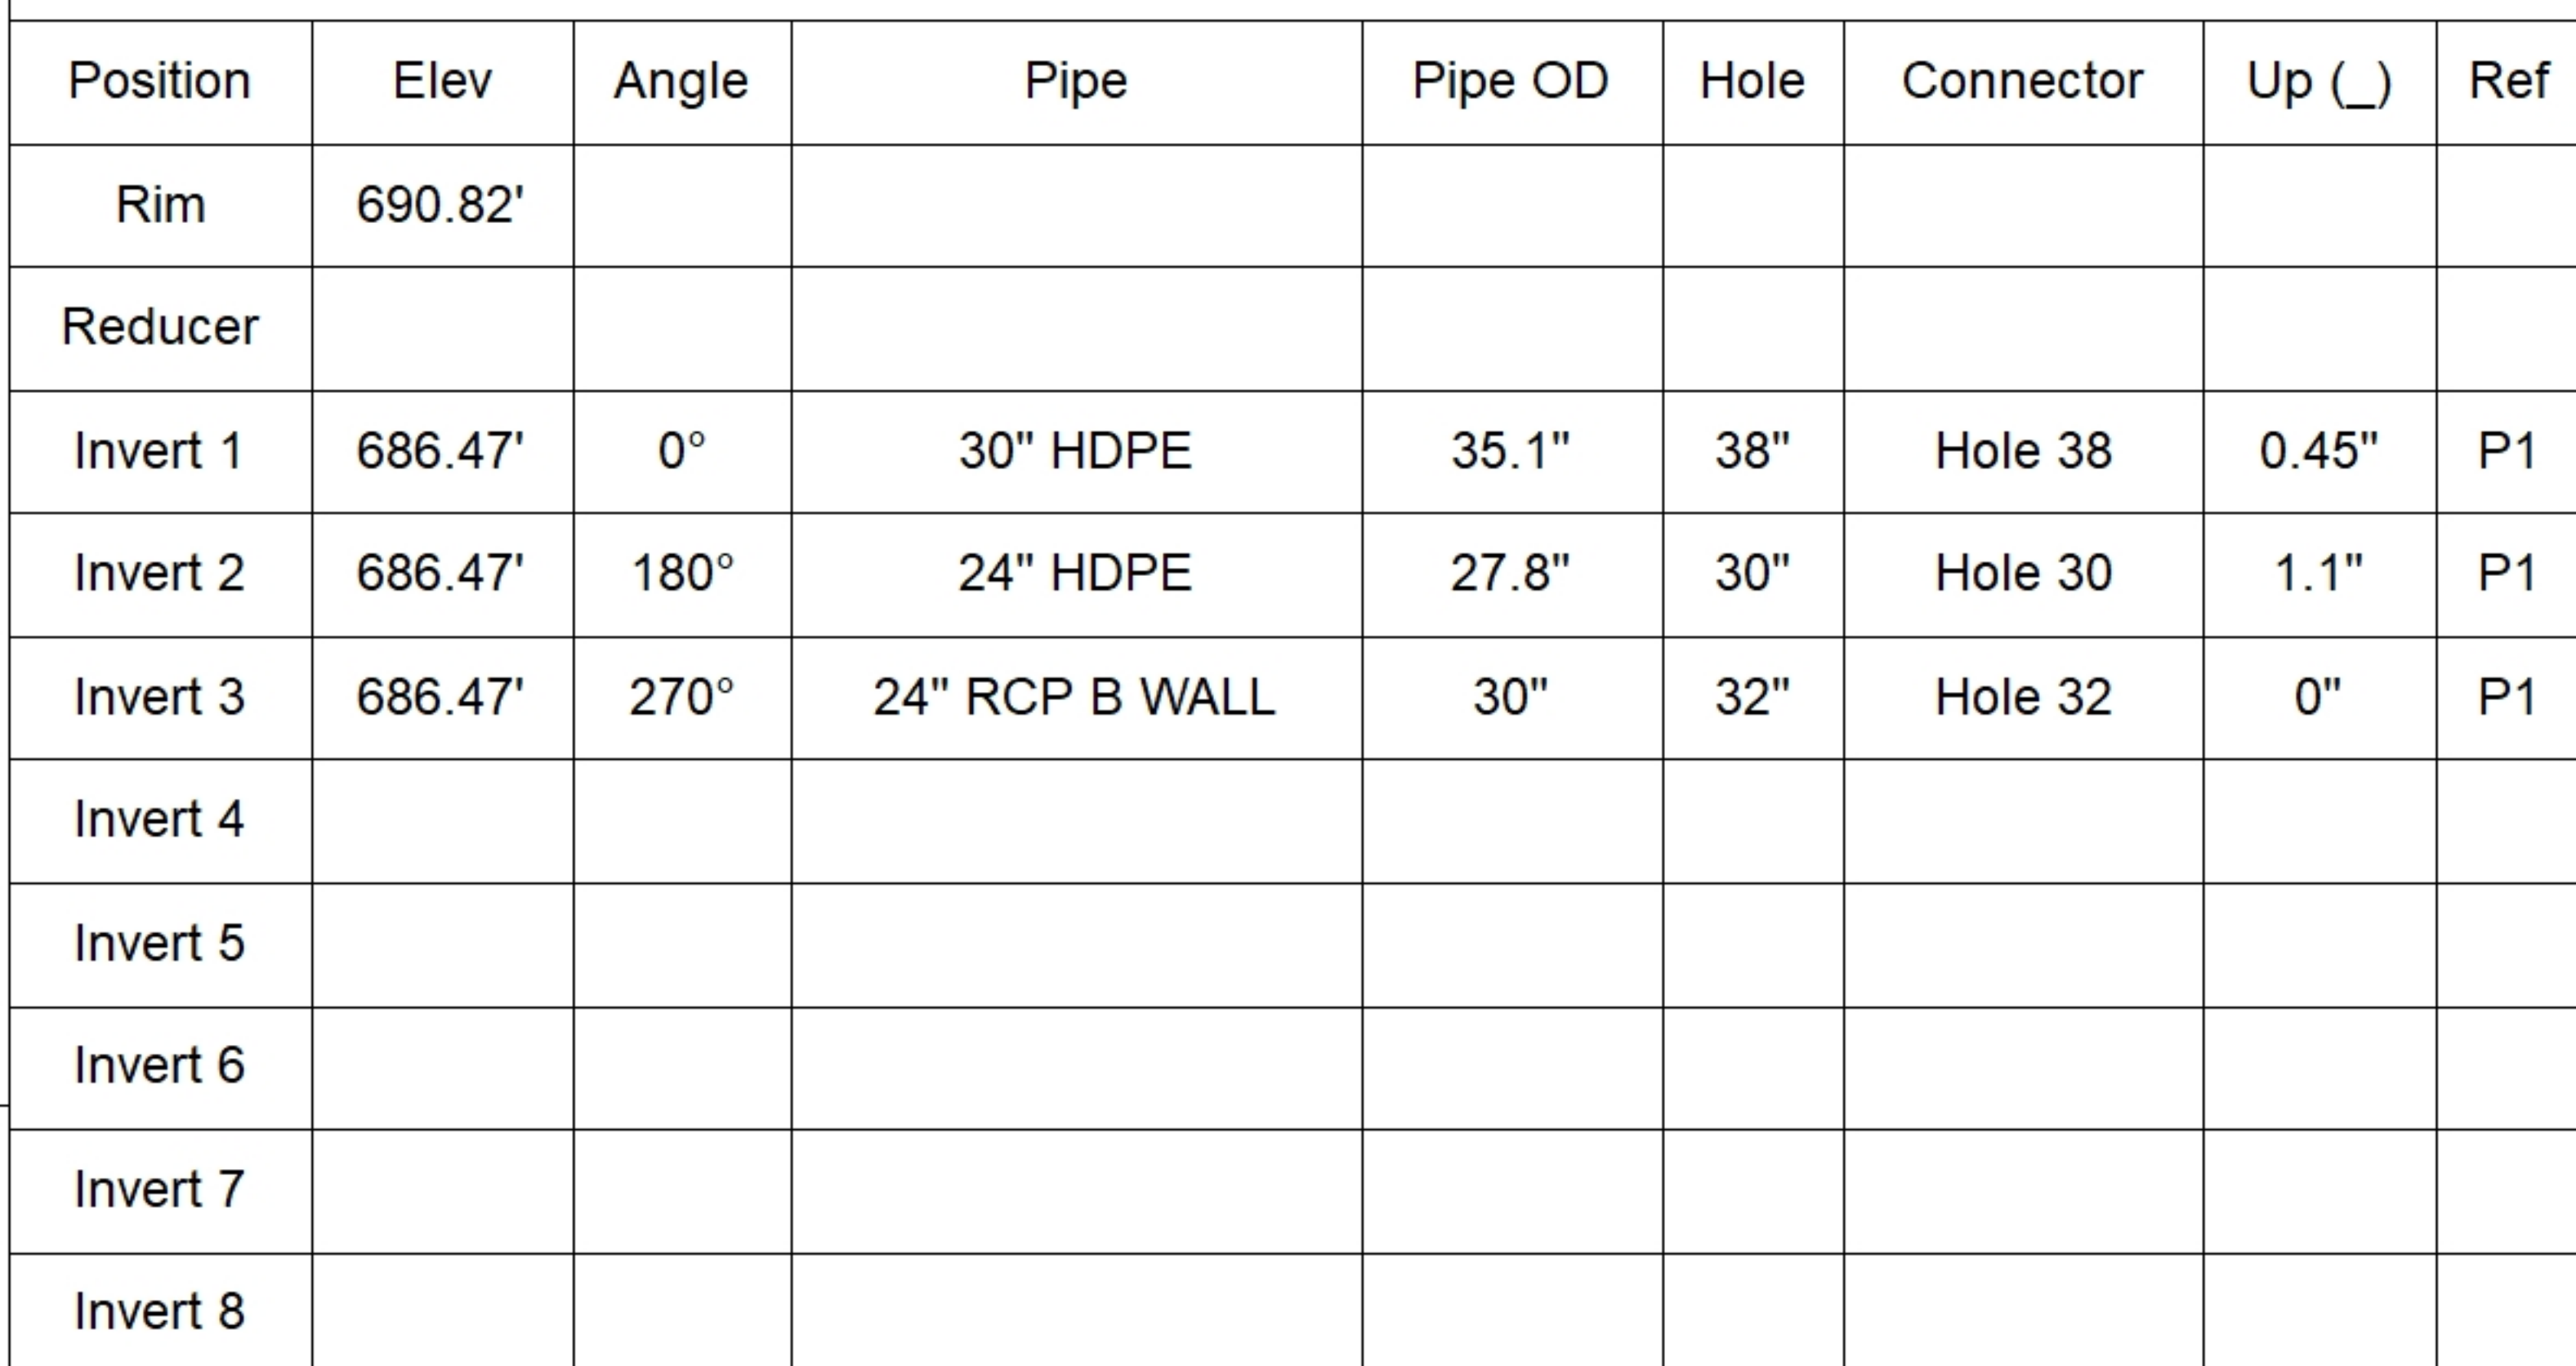

SUBMITTAL
APPROVED BY: