




Structure Notes: PLAN LABEL: M

1. HOE 525 SET (F/G/H) PROVIDED BY ICAST.
2. PER ASTM C913 SPECIFICATIONS.
3. CONCRETE = 4,000 PSI AT 28 DAYS.
4. NO INVERT CHANNEL.
5. REINFORCING PER ASTM A615 (GRADE 60).
 - WALLS (As .12) #5 BARS AT 12" C.C.E.W.
 - FLOOR (As .12) #5 BARS AT 12" C.C.E.W.
6. PLEASE VERIFY THE REQUIRED TOP OF FRAME ELEVATION AS THE STRUCTURE SCHEDULE AND PLAN VIEW VALUES DIFFER. SCHEDULE VALUES WERE USED IN THIS SUBMITTAL.


P2) 24" x 36" - CASTING HEIGHT - 6"
P1) 24" x 36" - BOX BASE 8inW, 8inF, Variable Ht - 31"
1) CASTING - HOE 525 SET (F/G/H)
1) 24" x 36" - Conseal CS-102 1.00"
1) Hole - 18

0 lb
4389 lb
442 lb
0 lb
0 lb


Structure Total: 4831 lb

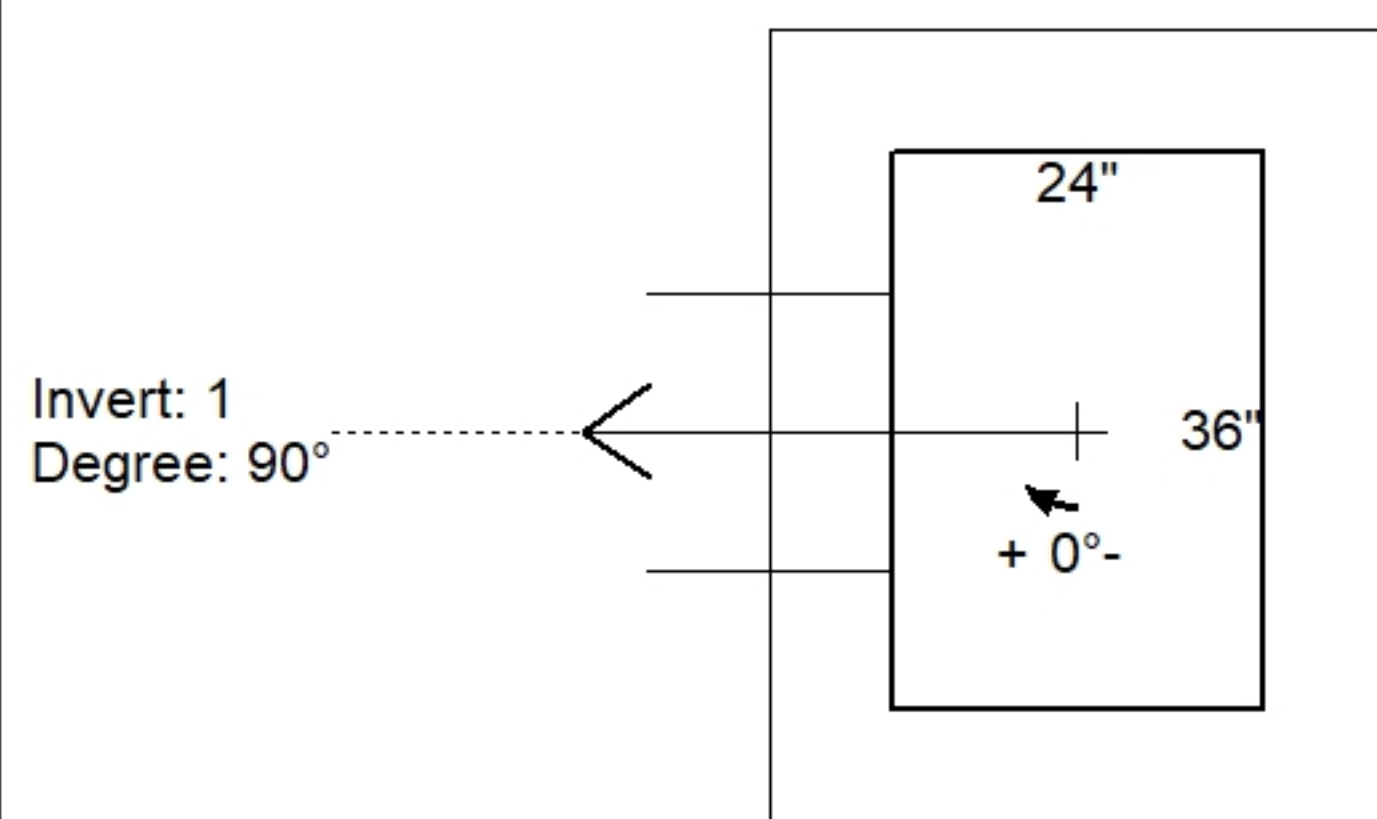

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (↓)	Ref
Rim	689.72'							
Reducer								
Invert 1	686.56'	90°	12" RCP B WALL	16"	18"	Hole 18	-2"	P1
Invert 2								
Invert 3								
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

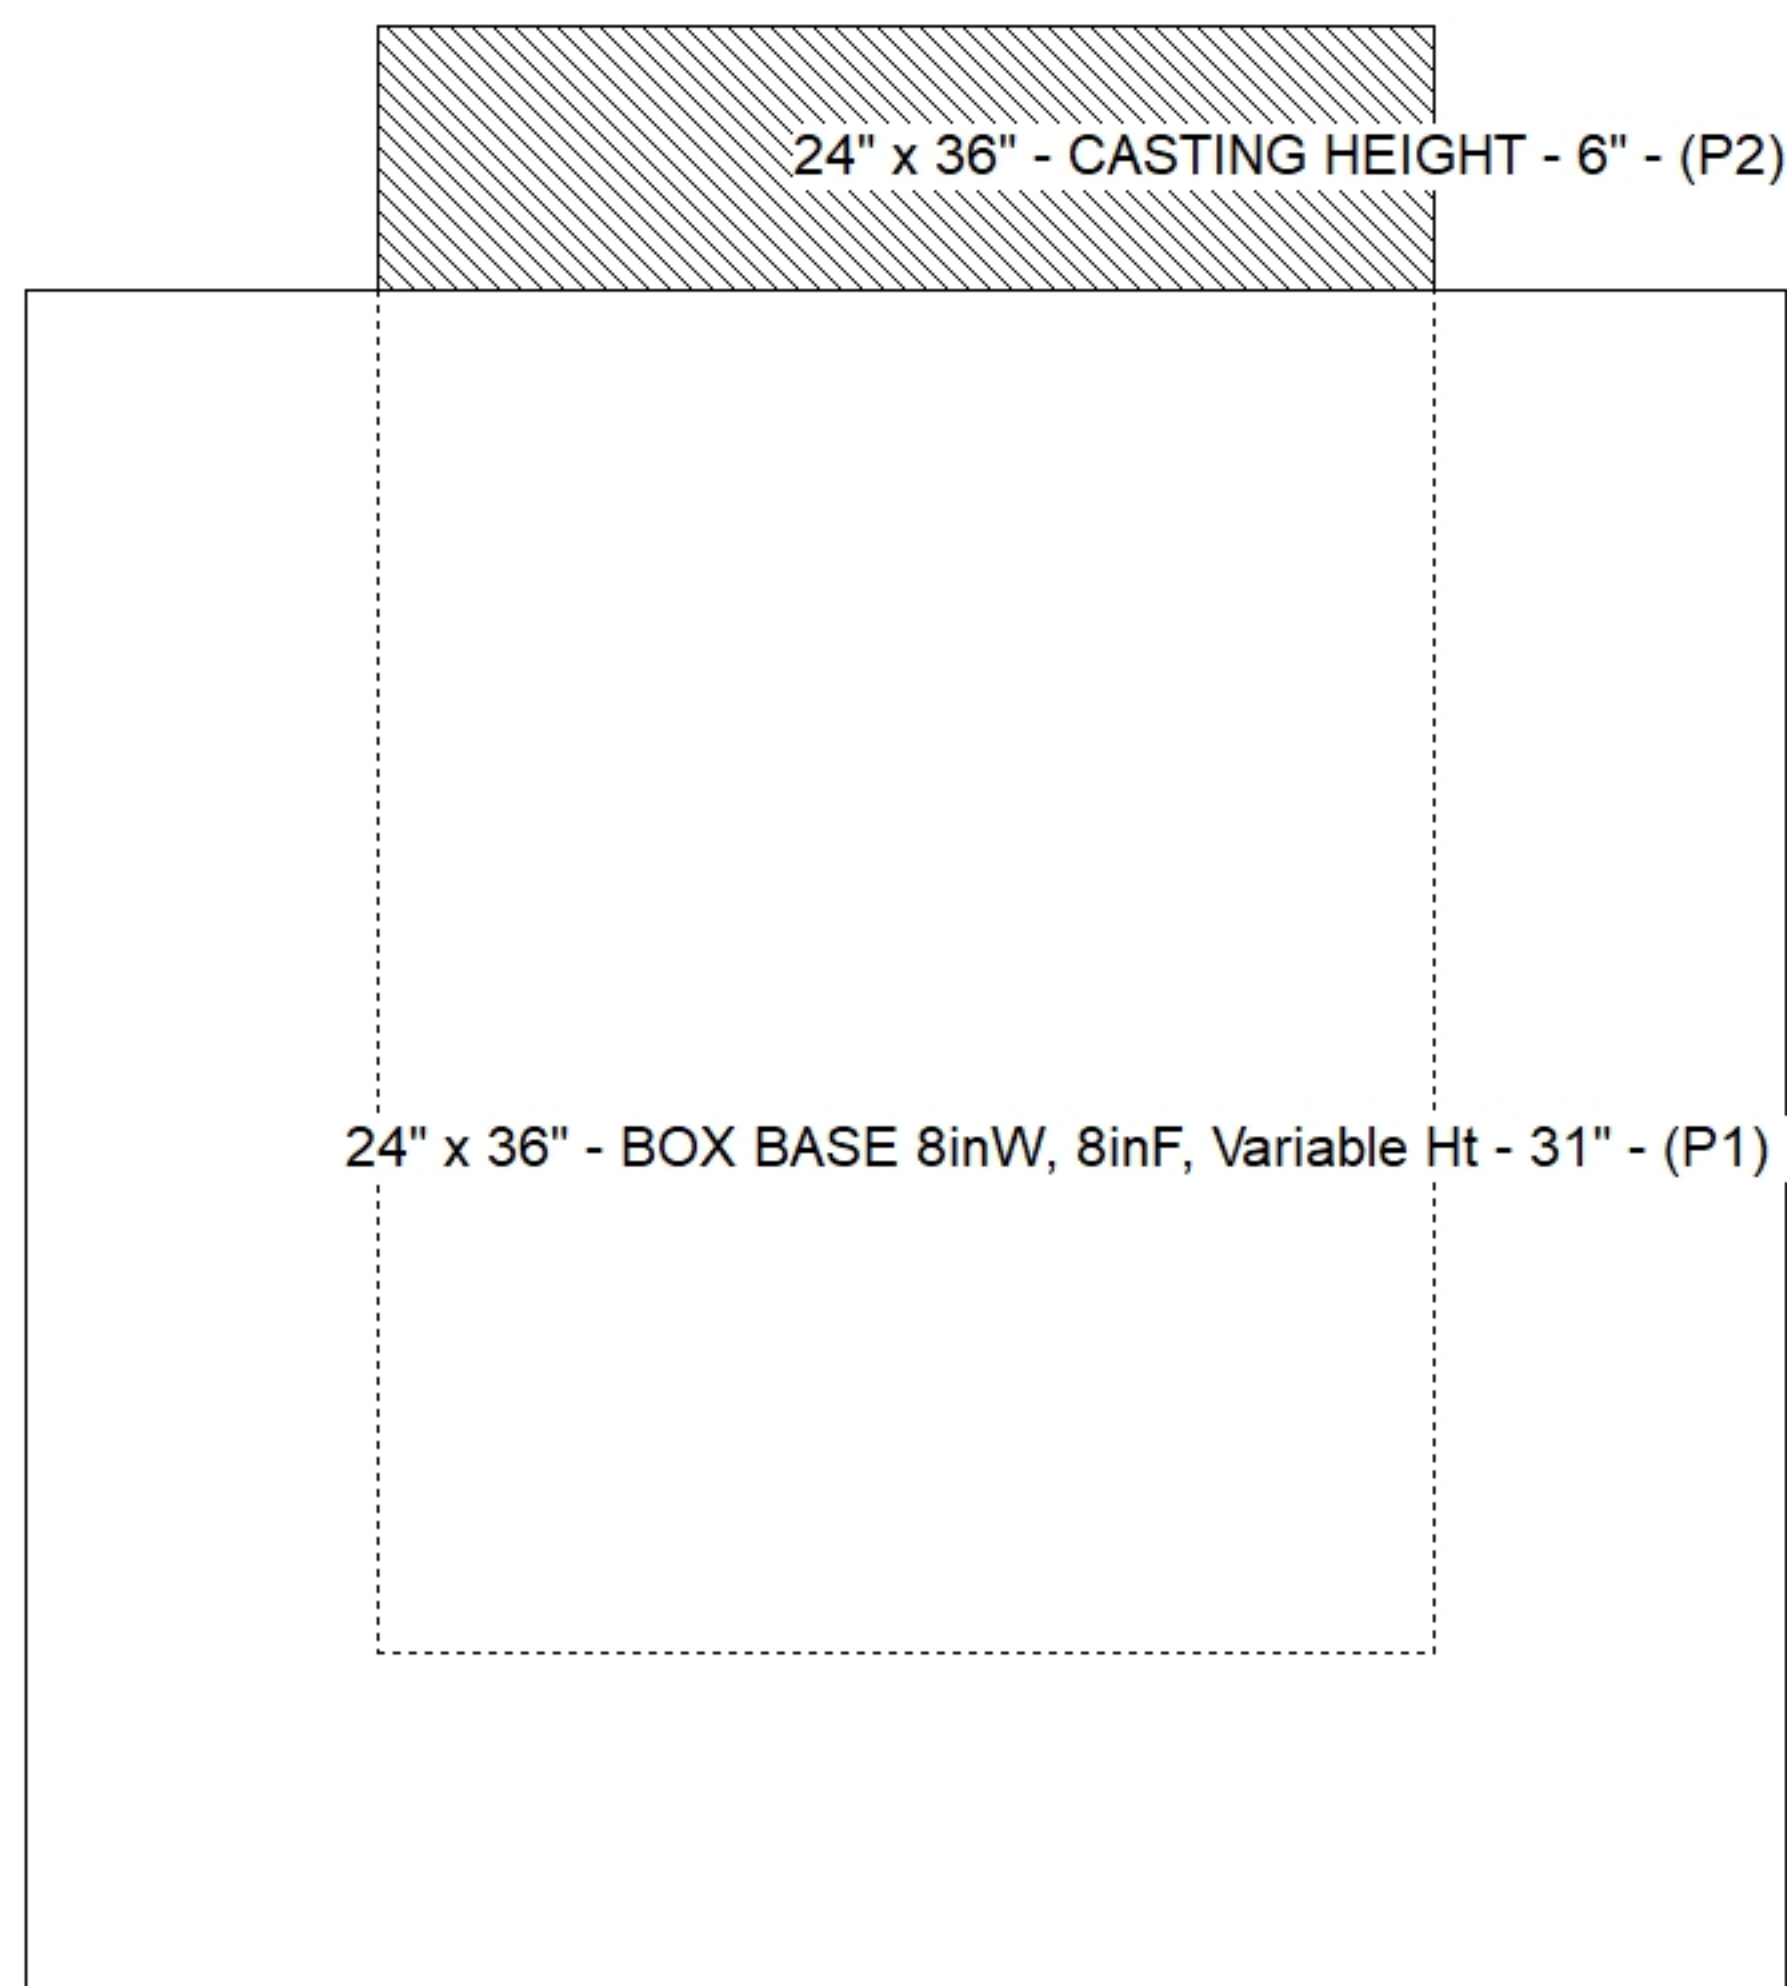

Default - Interior Dimensions

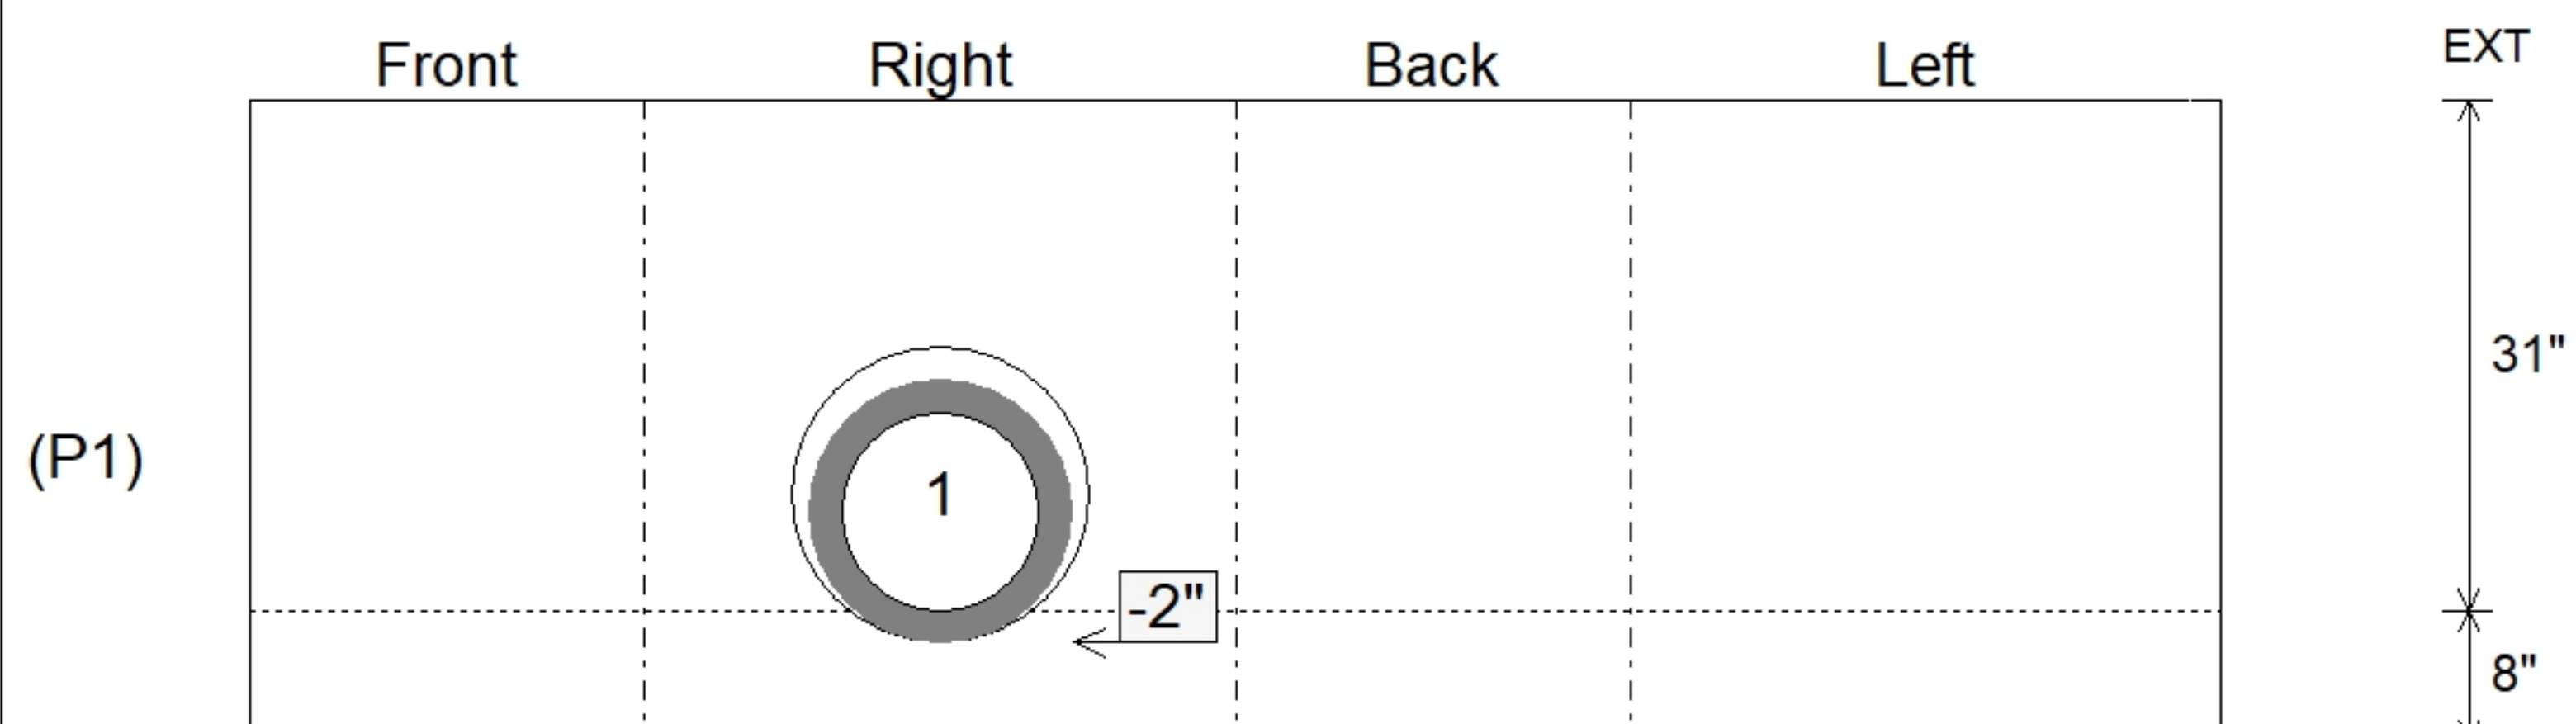

SUBMITTAL
APPROVED BY: