




Structure Notes: PLAN LABEL: Y

1. HOE 525 SET (F/G/H) PROVIDED BY ICAST.
2. PER ASTM C478 SPECIFICATIONS.
3. CONCRETE = 4,000 PSI AT 28 DAYS.
4. REINFORCING PER ASTM A615 (GRADE 60).
 - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W..
 - RISER/WALLS (As .12)
 - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.

The diagram shows a circular structure with four rectangular components arranged around a central vertical axis. The components are labeled as follows:

- Invert: 1**
Degree: 0°
- Invert: 2**
Degree: 96°
- Invert: 3**
Degree: 178°
- Step: 270°**

A central vertical axis is shown with arrows pointing up and down. A small rectangular component is located at the bottom of the axis, labeled "+ 0°".

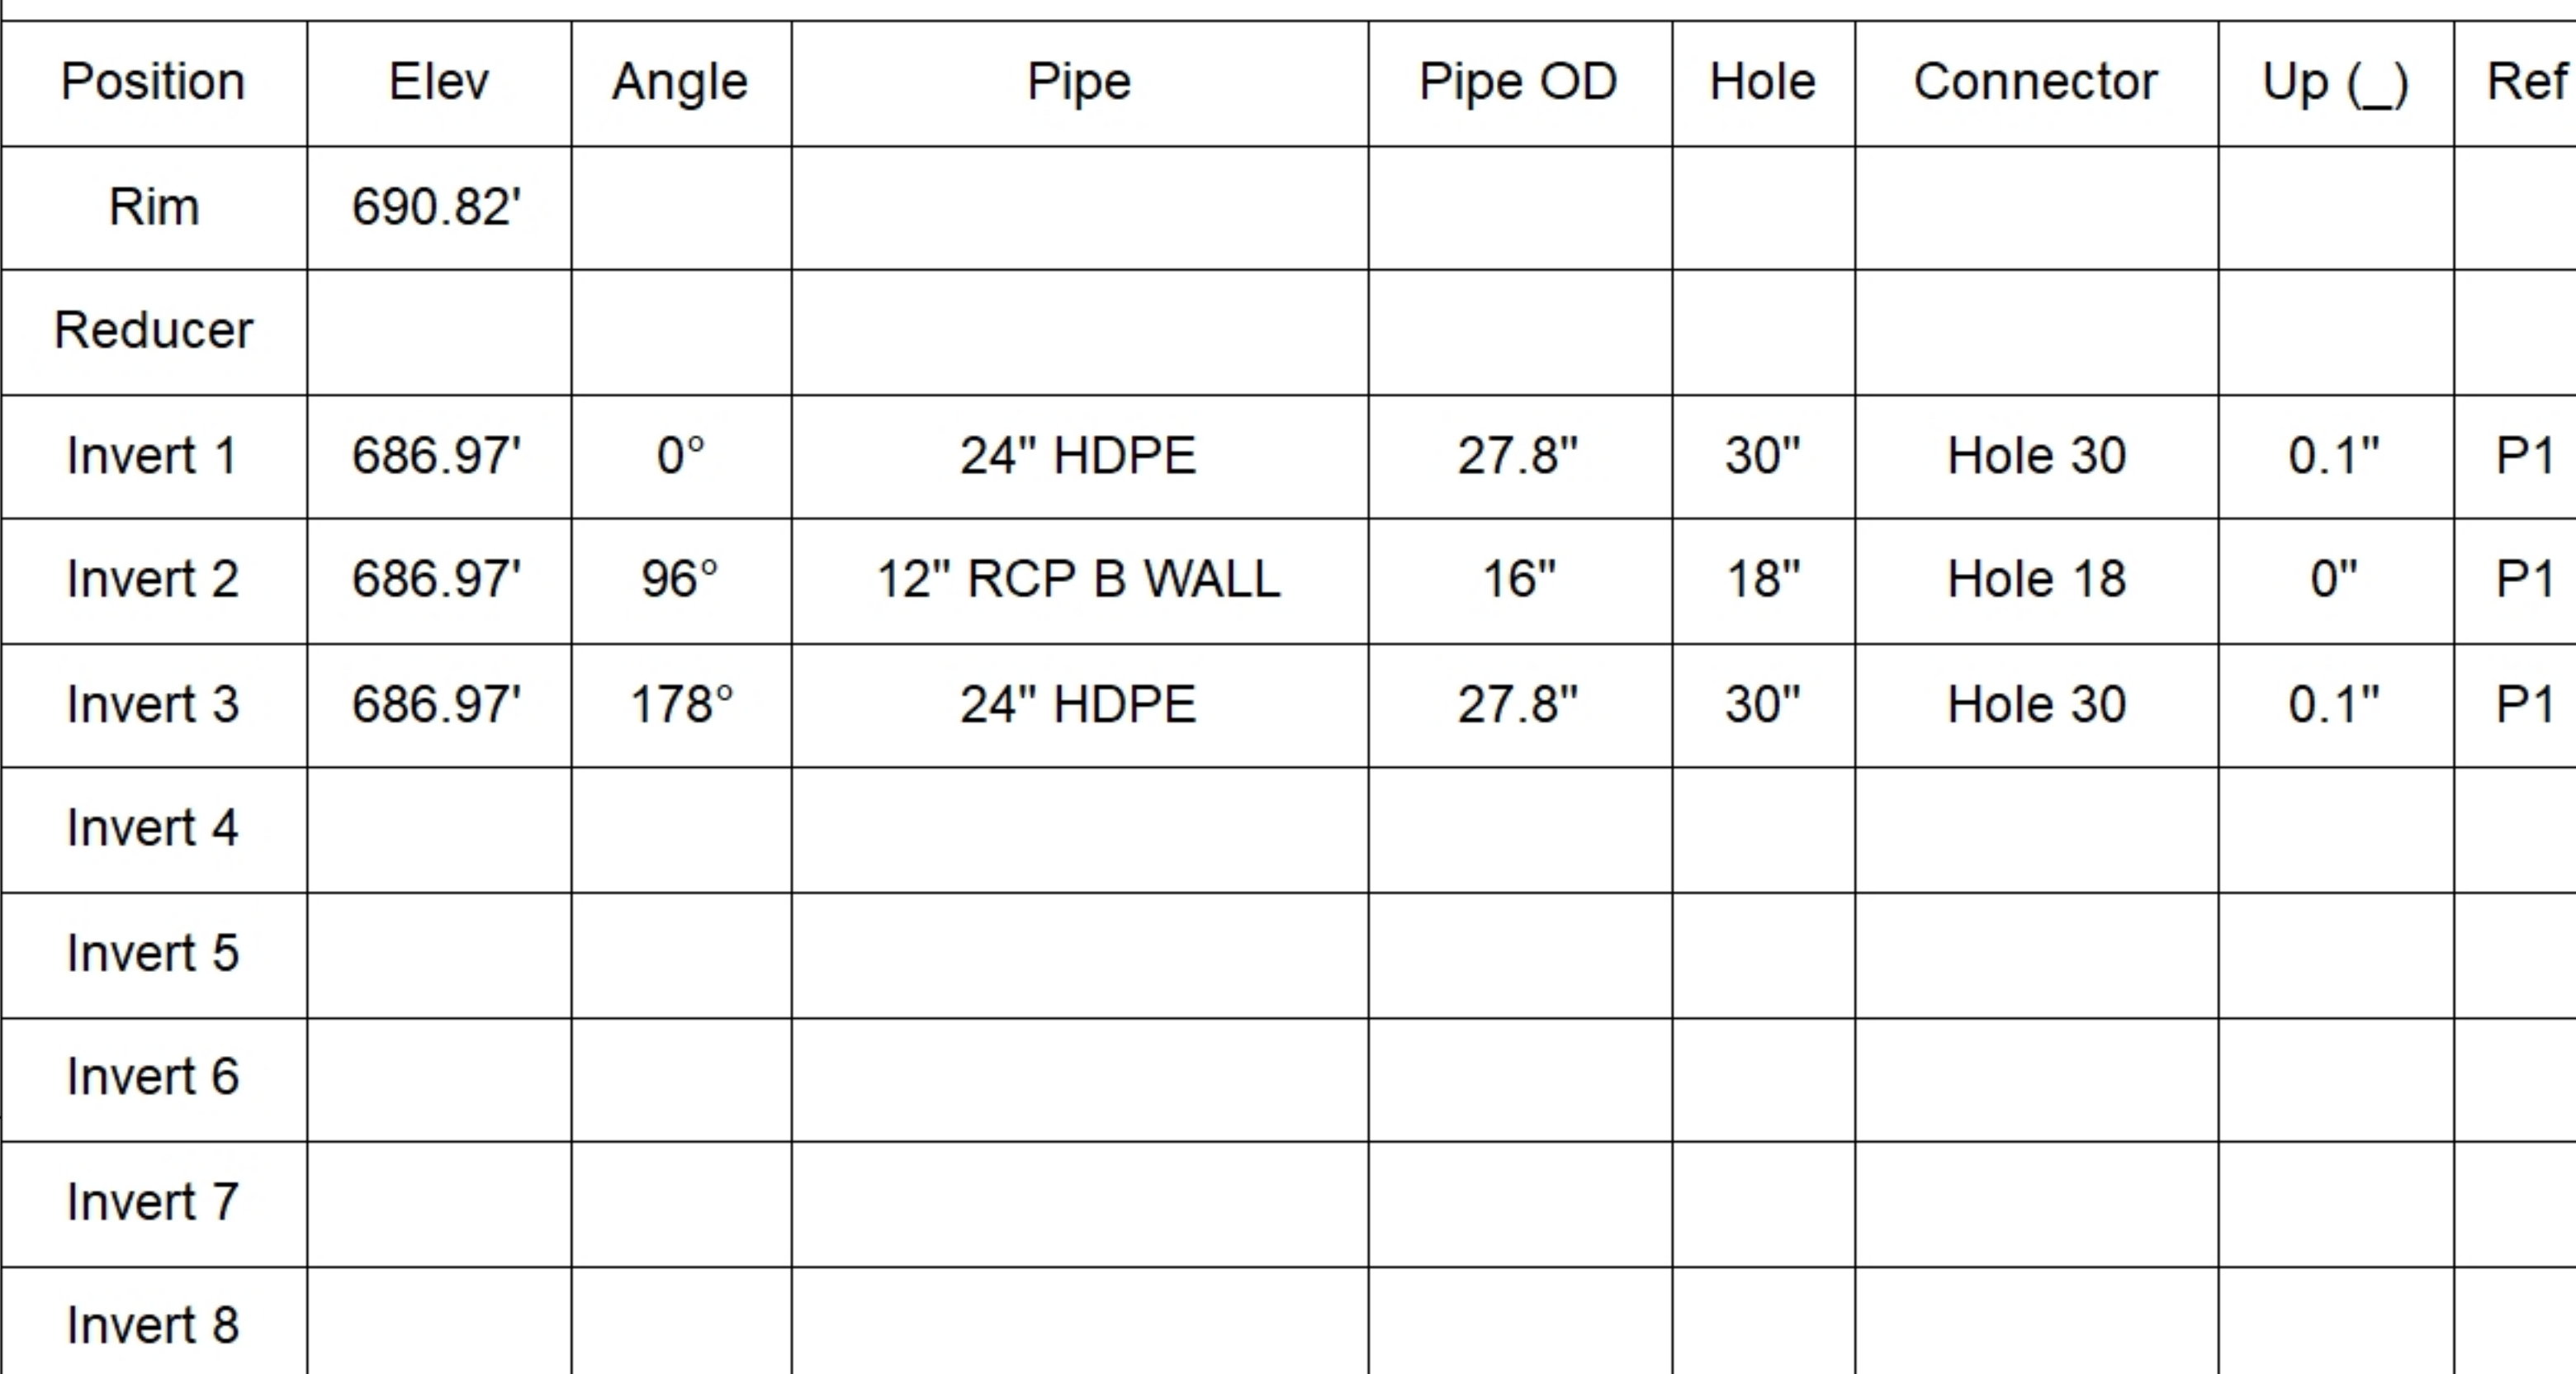

SUBMITTAL
APPROVED BY: