

Contractor: Byard Construction, LLC

Plant: 100




Slack: 0.05"

1. JBS 3080-V SET (F/G/H) PROVIDED BY ICAST.
2. PER ASTM C913 SPECIFICATIONS.
3. CONCRETE = 4,000 PSI AT 28 DAYS.
4. NO INVERT CHANNEL.
5. REINFORCING PER ASTM A615 (GRADE 60).
 - WALLS (As .12) #5 BARS AT 12" C.C.E.W.
 - FLOOR (As .12) #5 BARS AT 12" C.C.E.W.

P2) 24" x 36" - CASTING HEIGHT - 6.5"
P1) 24" x 36" - BOX BASE 6inW, 6inF, Variable Ht - 50"
1) CASTING - JBS 3080-V SET (F/G/H)
1) 24" x 36" - Conseal CS-102 1.00"
1) Hole - 34
1) Hole - 30

0 lb
3682 lb
500 lb
0 lb
0 lb
0 lb

Structure Total: 4182 lb

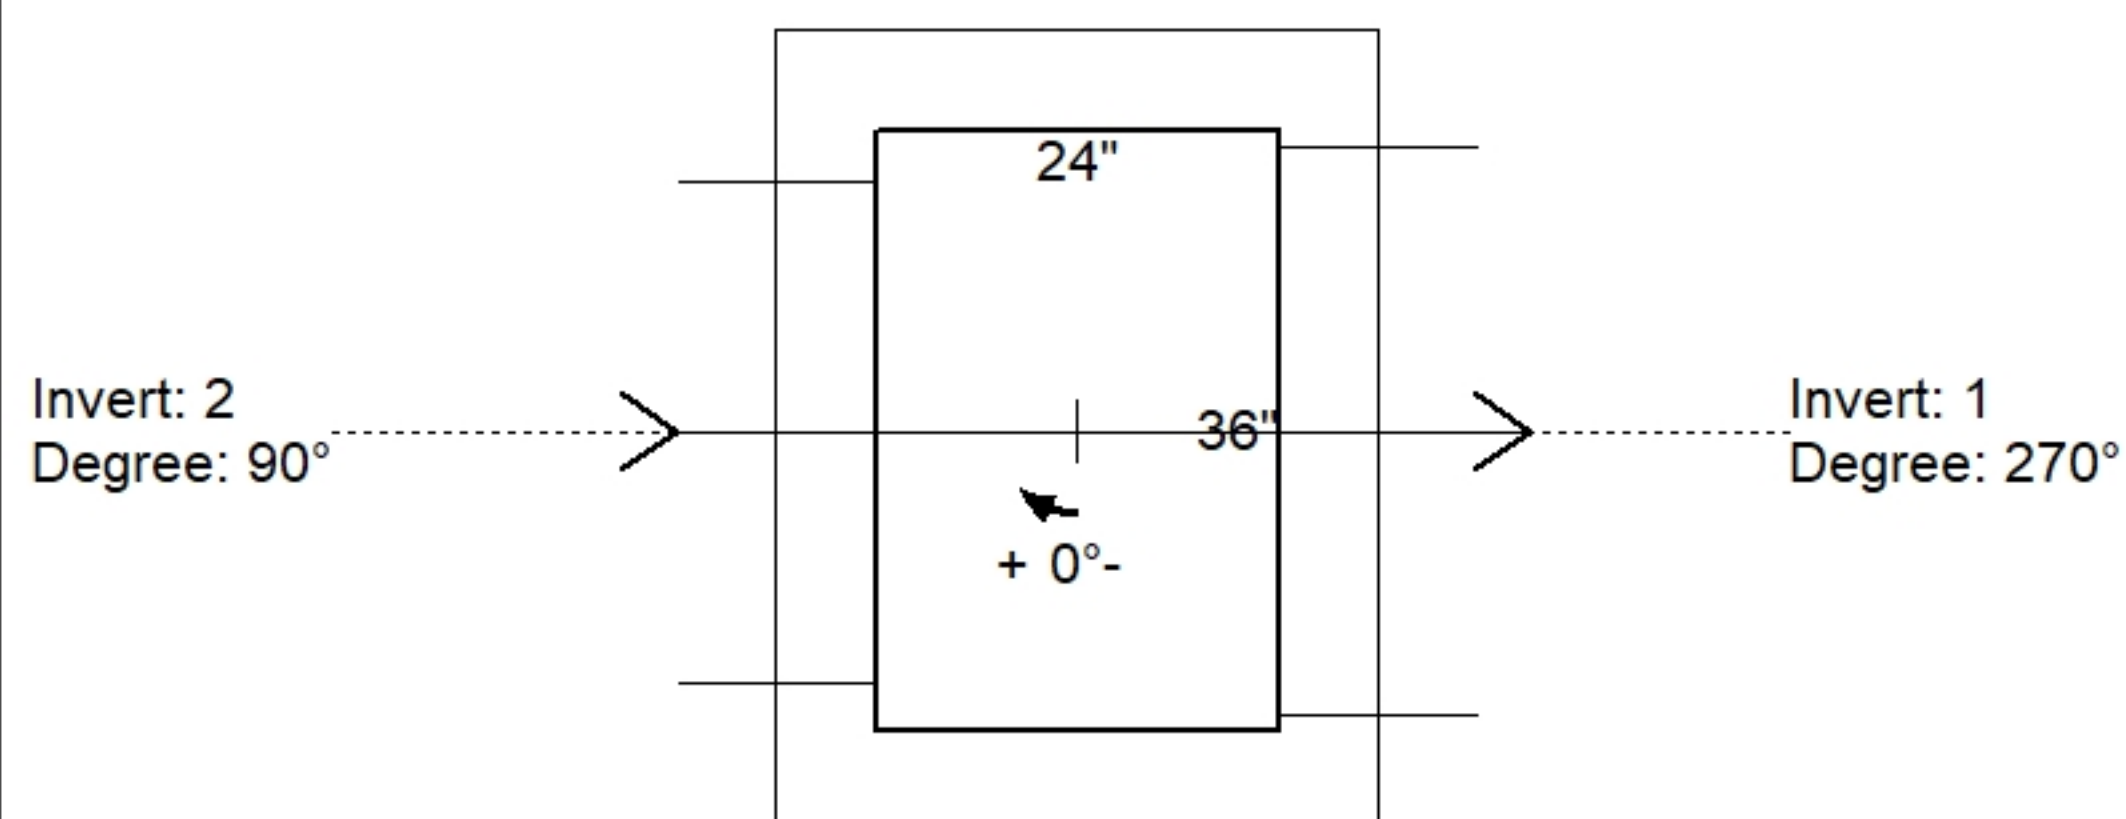


Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up ()	Ref
Rim	446.41'							
Reducer								
Invert 1	441.76'	270°	30" CMP	31"	34"	Hole 34	0.25"	P1
Invert 2	441.86'	90°	24" HDPE	27.8"	30"	Hole 30	0.05"	P1
Invert 3								
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

24" x 36" - CASTING HEIGHT - 6.5" - (P2)

24" x 36" - BOX BASE 6inW, 6inF, Variable Ht - 50" - (P1)

Default - Interior Dimensions

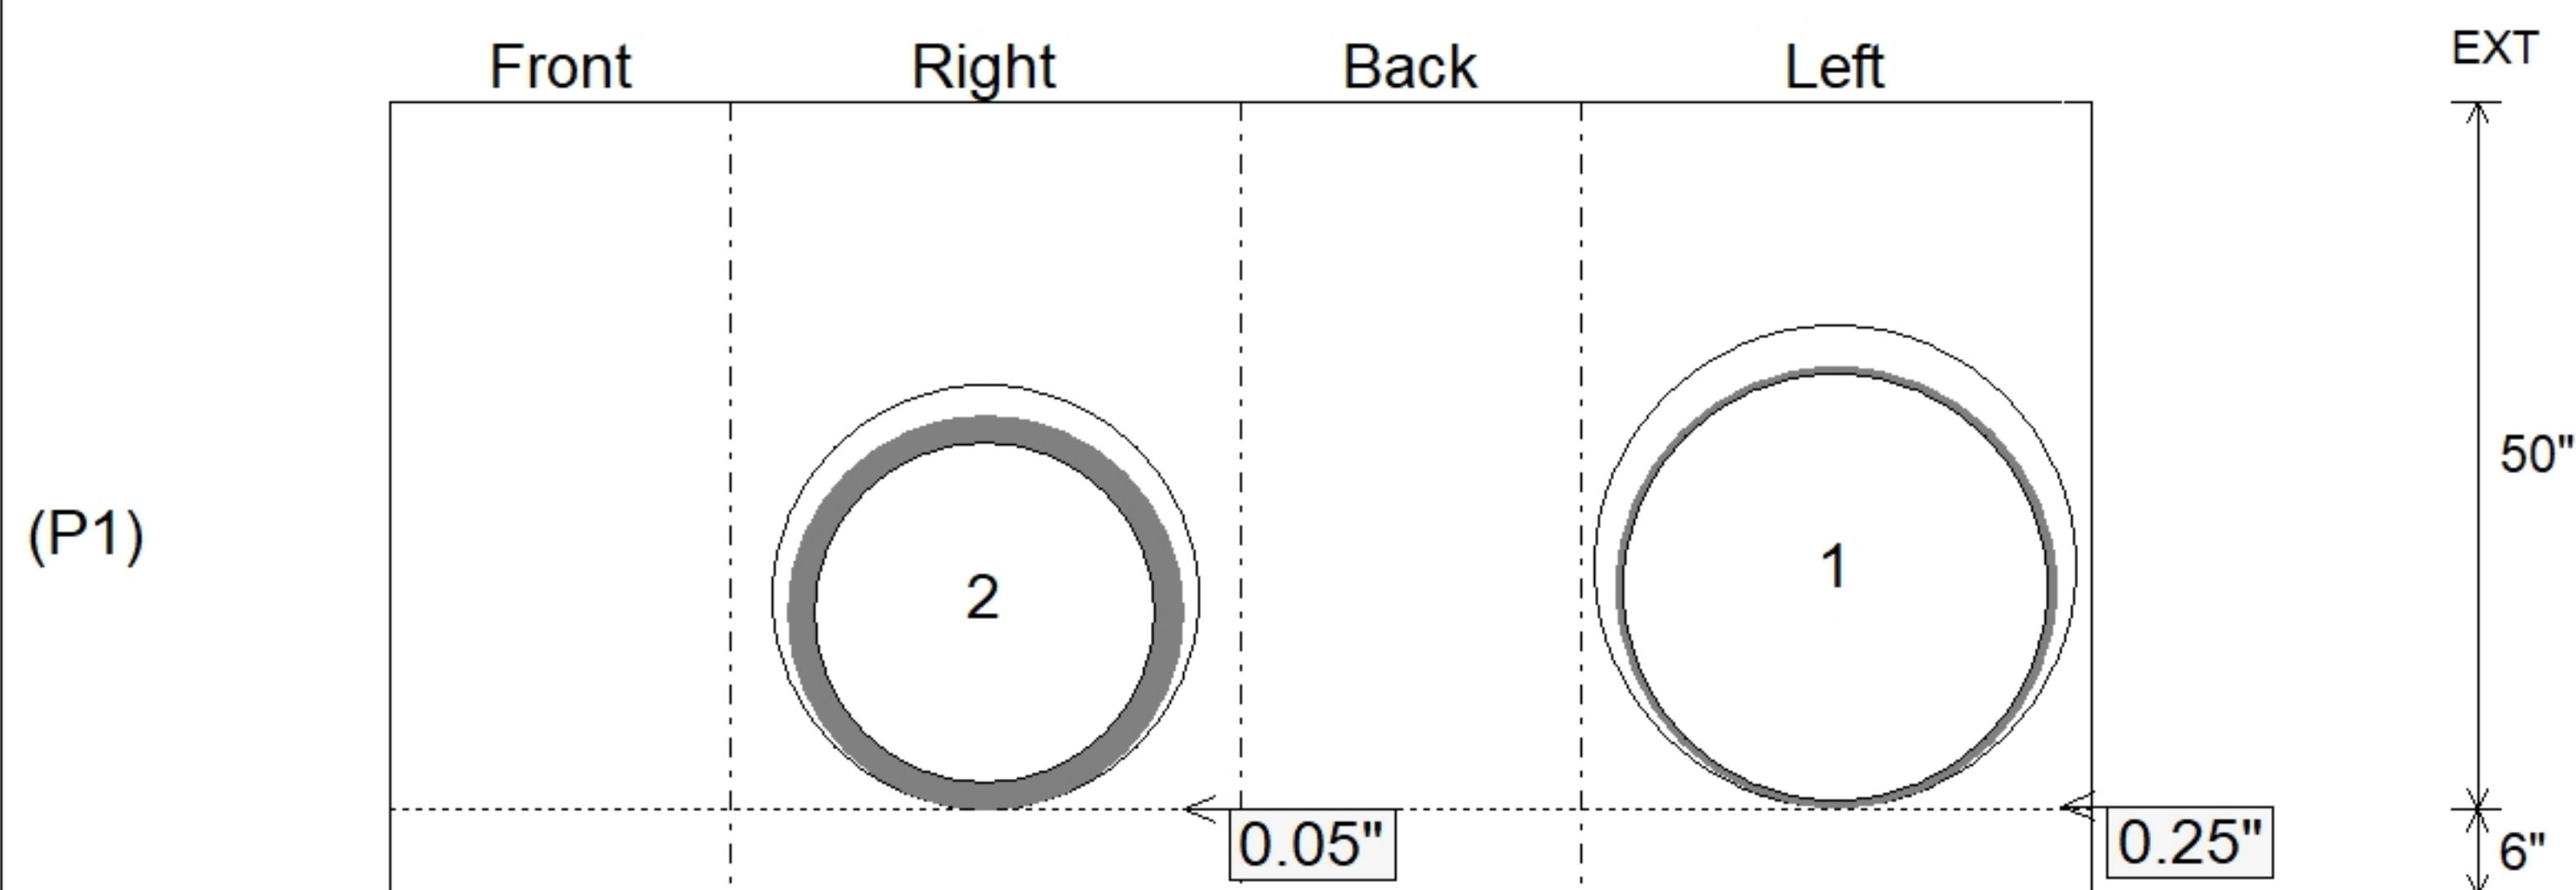

SUBMITTAL
APPROVED BY: