

Contractor: Byard Construction, LLC

Plant: 100




Slack: 0.04"

1. JBS 3080-V SET (F/G/H) PROVIDED BY ICAST.
2. PER ASTM C913 SPECIFICATIONS.
3. CONCRETE = 4,000 PSI AT 28 DAYS.
4. NO INVERT CHANNEL.
5. REINFORCING PER ASTM A615 (GRADE 60).
 - WALLS (As .12) #5 BARS AT 12" C.C.E.W.
 - FLOOR (As .12) #5 BARS AT 12" C.C.E.W.

P2) 24" x 36" - CASTING HEIGHT - 6.5"
P1) 24" x 36" - BOX BASE 6inW, 6inF, Variable Ht - 41"
1) CASTING - JBS 3080-V SET (F/G/H)
1) 24" x 36" - Conseal CS-102 1.00"
1) Hole - 22
1) Hole - 24

0 lb
3423 lb
500 lb
0 lb
0 lb
0 lb

Structure Total: 3923 lb

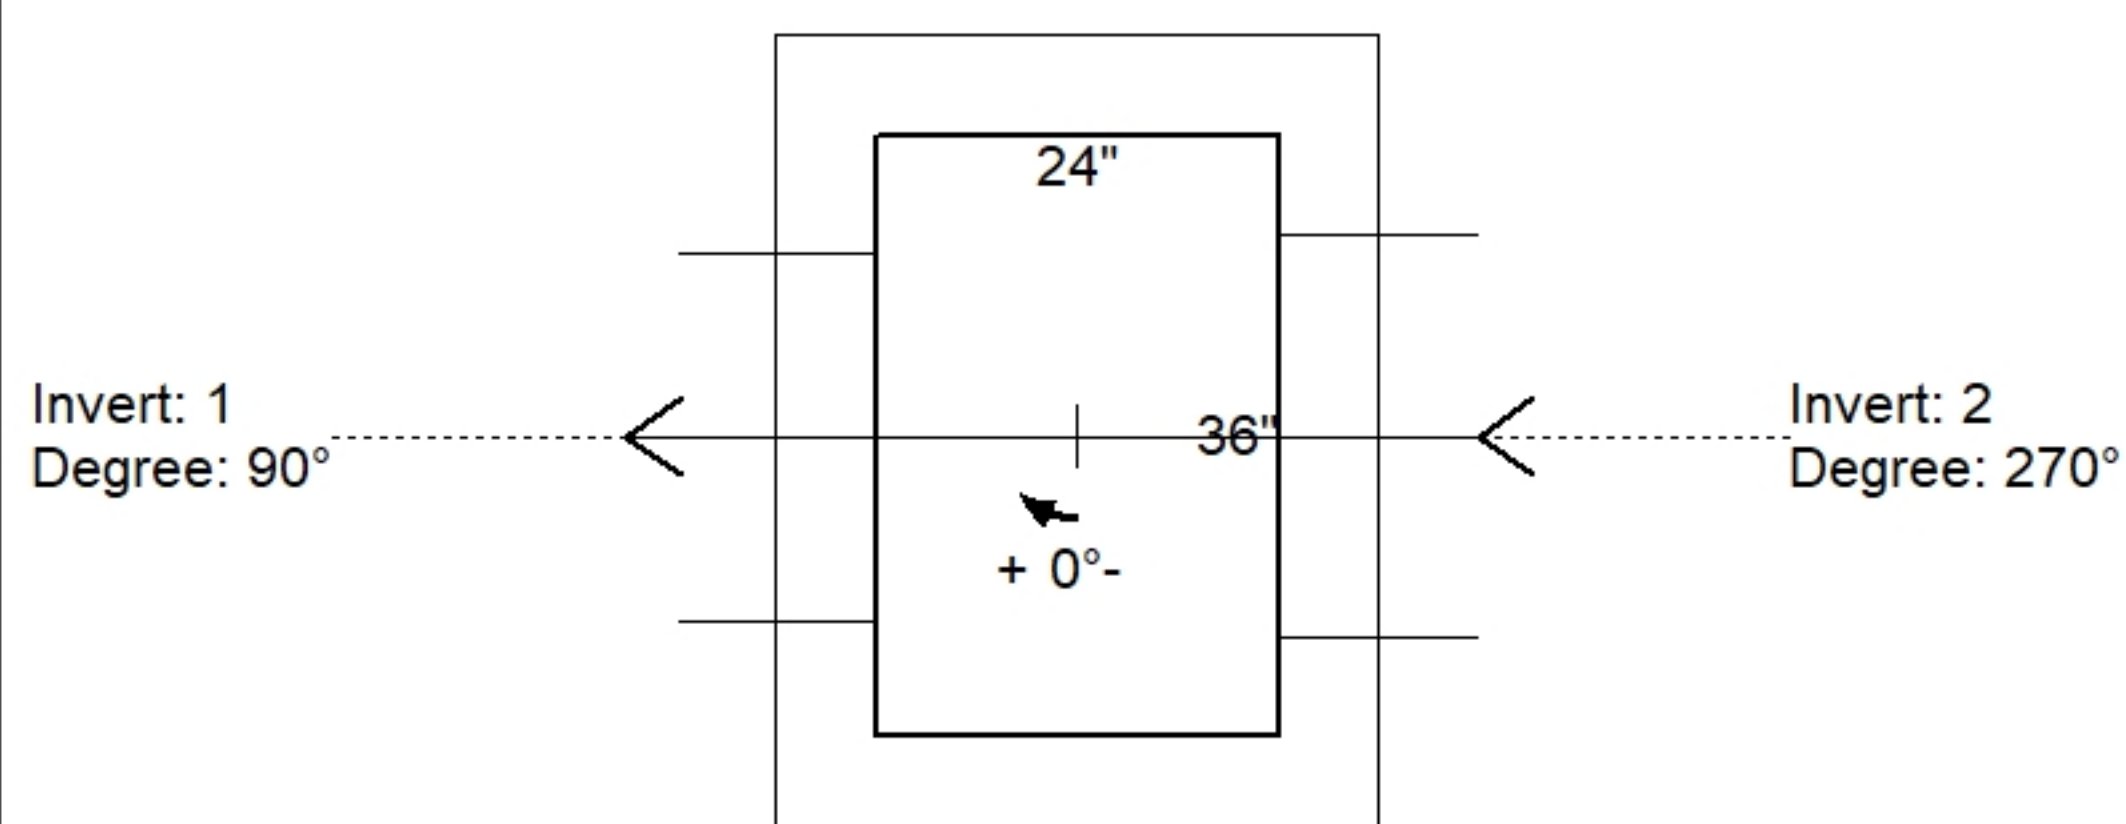


Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (␣)	Ref
Rim	426.18'							
Reducer								
Invert 1	422.26'	90°	18" CMP	19"	22"	Hole 22	0"	P1
Invert 2	422.36'	270°	18" CMP	19"	24"	Hole 24	1.2"	P1
Invert 3								
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

24" x 36" - CASTING HEIGHT - 6.5" - (P2)

24" x 36" - BOX BASE 6inW, 6inF, Variable Ht - 41" - (P1)

Default - Interior Dimensions

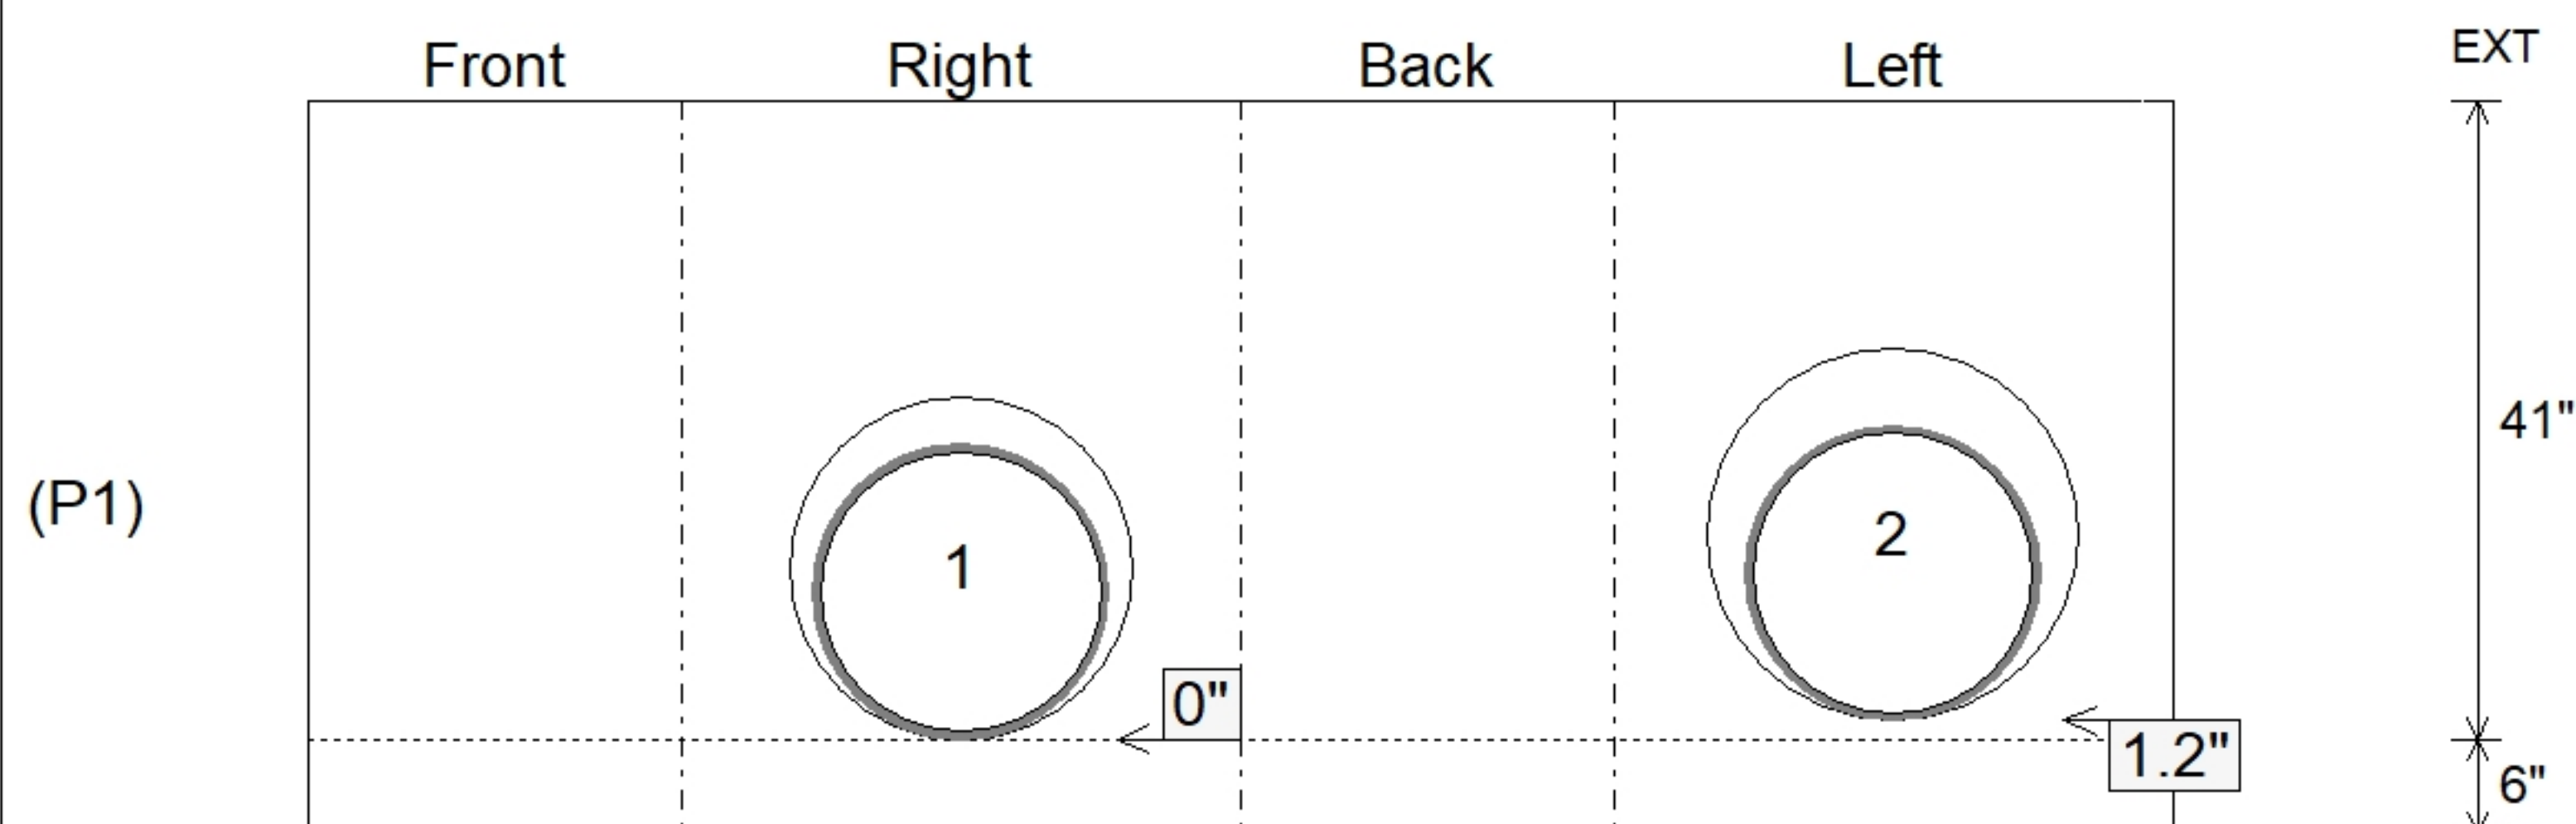

SUBMITTAL
APPROVED BY: