

Job Name: 25-2621 Night Hawk Place Lot 2G Storm
 Job Location: Radcliff, KY
 Contractor: City of Radcliff

Plant: Beaver Dam

Tech: C.Russ

9/25/2025 2:38:02 PM

PC: J.Jarvis



Structure ID: DBI F

P1 MH060BA36

MH BASE F/n

- P3) 24" x 36" - CASTING HEIGHT - 4"
- P2) 60" - MH FLAT TOP SPEC. HT. (6") w/24"x36" Hole F/F - 6"
- P1) 60" - MH BASE F/n - 36"
- 1) 60" - SGL 1"x14.5' Butyl (2x)
- 1) DOGHOUSE INVRTD - 38"x36"
- 1) Hole - 30
- 3) MH Step ML-10-TDS-NCR - 10"

0 lb
 1135 lb
 5475 lb
 0 lb
 0 lb
 0 lb
 0 lb

 Structure Total: 6610 lb



- Structure Notes:**
1. PER ASTM C478 SPECIFICATIONS.
 2. CONCRETE = 4,000 PSI AT 28 DAYS.
 3. MCB-260-BH BY ICAST
 4. REINFORCING PER ASTM A615 (GRADE 60).
 - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W..
 - RISER/WALLS (As .18)
 - FLOOR (As .37) #5 BARS AT 10" C.C.E.W.

Rim: 737.07' Rim to Invert: 3.65' Slack: 0.85" Sump: 3.05" Step Position: 90°


Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	733.42'	0°	0"	30" HDPE	35.1"	DOGHOUSE INVRTD 38"x36"	38" x 36"	41.151"	0.5"	0"
Invert 2	733.42'	180°	113.097"	24" HDPE	27.8"	Hole 30	30"	31.416"	1.15"	0"
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										

RIGHT-SIDE UP VIEW (int. dimensions)

UPSIDE-DOWN VIEW (int. dimensions)

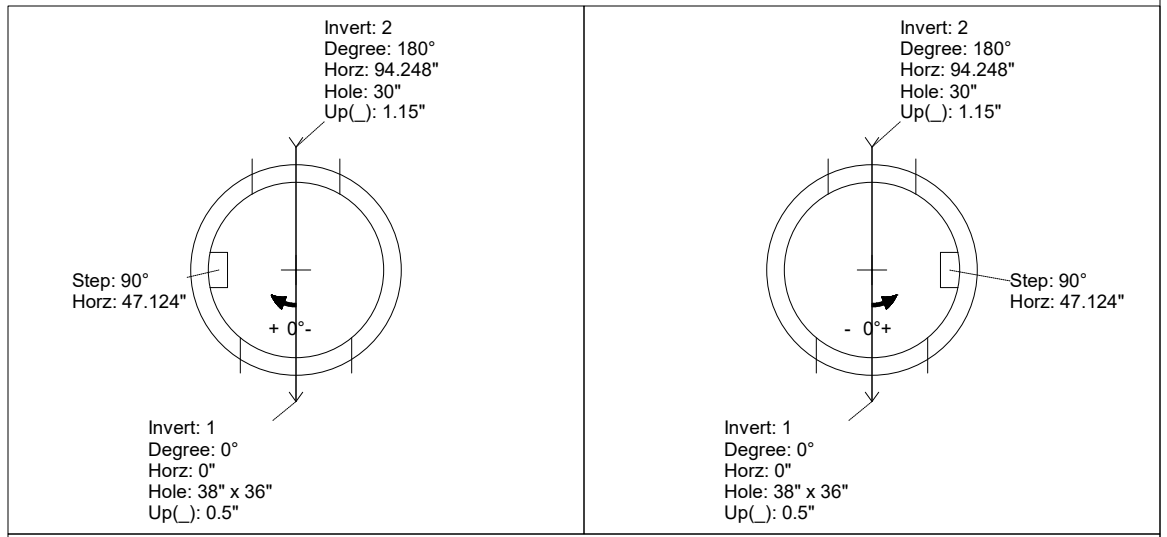

INSIDE WALL DIMENSIONS

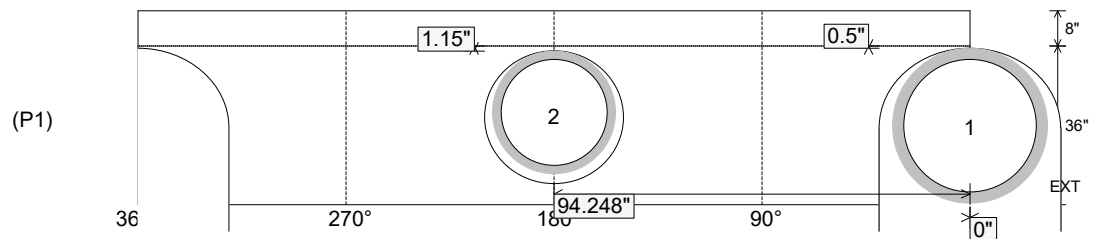

Coating (Int):
 Coating (Ext):

Seam Up: Flat
 Seam Dn: n/a

Wall Thickness: 6"
 Floor Height: 8"

Height (Int): 36"
 Height (Ext): 44"

Weight (Net): 5475 lb
 Volume (Net): 1.4cu.yd