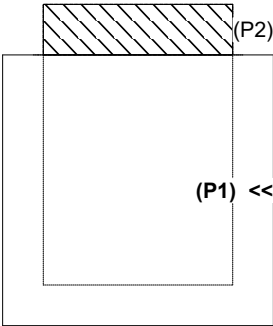
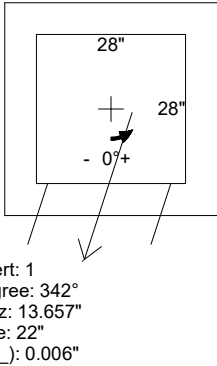
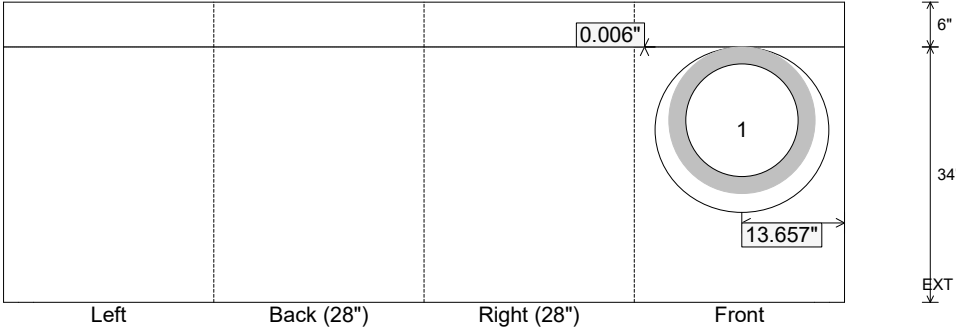


Job Name: 25-2647 Nichols West Job Location: Gallatin, TN Contractor: Hayes Pipe Supply					Plant: Beaver Dam 10/1/2026 10:33:20 AM		Tech: J. Coppage PC: E. Bradley																
Structure ID: D20																							
P1		BX28280606VH																					
P2) 28" x 28" - CASTING HEIGHT - 7.50" P1) 28" x 28" - BOX BASE 6inW, 6inF, Variable Ht - 34" 1) 28" x 28" - Conseal CS-102 1.00" 1) Hole - 22"					0 lb 2932 lb 0 lb 0 lb ----- Structure Total: 2932 lb		Structure Notes: 1. (JBS 3300 SINGLE SET PROVIDED BY OTHERS) 2. PER ASTM C913 SPECIFICATIONS. 3. CONCRETE = 4,000 PSI AT 28 DAYS. 4. REINFORCING PER ASTM A615 (GRADE 60). - WALLS (As .31) #5 BARS AT 12" C.C.E.W. - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.																
Rim: 526.6'					Rim to Invert: 3.3'		Slack: 0.356"		Sump: 2.256"		Step Position:												
Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset													
Invert 1	523.3'	342°	17.707"	15" RCP B WALL	19.5"	Hole 22	22"	23.132"	0.006"	4"													
Invert 2																							
Invert 3																							
Invert 4																							
Invert 5																							
Invert 6																							
Invert 7																							
Invert 8																							
RIGHT-SIDE UP VIEW (int. dimensions)												UPSIDE-DOWN VIEW (int. dimenions)											
																							
INSIDE WALL DIMENSIONS																							
Coating (Int): Coating (Ext):				Seam Up: Flat Seam Dn: n/a		Wall Thickness: 6" Floor Height: 6"		Height (Int): 34" Height (Ext): 40"		Weight (Net): 2932 lb Volume (Net): 0.75cu.yd													