

Job Name: 25-2686 - Whispering Oaks Subdivision
 Job Location: Jeffersonville, IN
 Contractor: Cornell Harbison Excavating

Plant: 100

2/6/2026 1:28:39 PM

Tech: J. Horsley - F

PC: J. Jarvis



Structure ID: 1

P1 BX3030-06W08F-BAVF

BOX BASE 6inW, 8inF, Variable Ht F/n

- P2) 34.5" x 34.5" - RECESS/GRATE SEAT - 1"
- P1) 30" x 30" - BOX BASE 6inW, 8inF, Variable Ht F/n - 40"
- 1) 30" x 30" - Conseal CS-102 1.00"
- 1) Hole - 20

0 lb
 3926 lb
 0 lb
 0 lb

 Structure Total: 3926 lb

- Structure Notes:
1. PER INDOT INLET TYPE E / ASTM C-913 SPECIFICATIONS
 2. CONCRETE: 4,000 PSI AT 28 DAYS
 3. REINFORCEMENT: #5 BAR @ 12" C.C. E.W. (GRADE 60) - 2" MIN. REBAR CLEARANCE (TYP)
 4. NO STORM INVERT
 5. NO STEPS
 6. EJ 6610 GRATE SUPPLIED BY OTHERS
 7. 2.25" WIDE X 1" DEEP RECESS REQUIRED ALONG INNER TOP SIDE OF WALLS FOR GRATE TO RECESS INTO



Rim: 500.86' Rim to Invert: 3.36' Slack: 0.32" Sump: 0" Step Position:

Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up (↓)	Offset
Invert 1	497.5'	0°	21"	15" HDPE	17.6"	Hole 20	20"	20"	-1.3"	0"
Invert 2										
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										


RIGHT-SIDE UP VIEW (int. dimensions)

UPSIDE-DOWN VIEW (int. dimensions)

FLOOR: 8"
WALLS: 6"

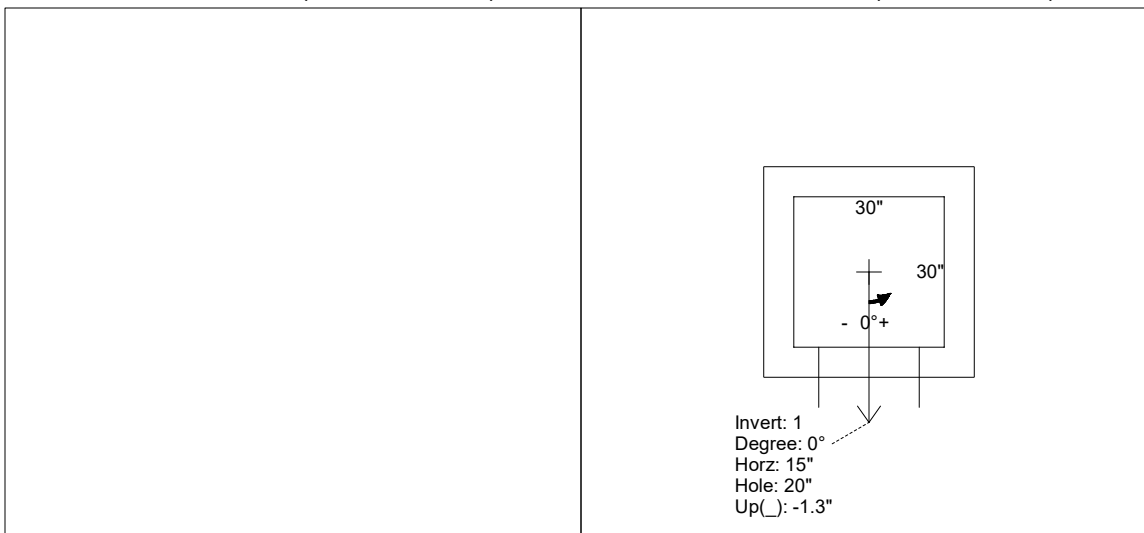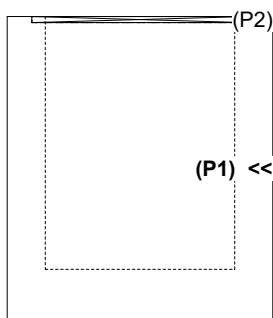

INSIDE WALL DIMENSIONS

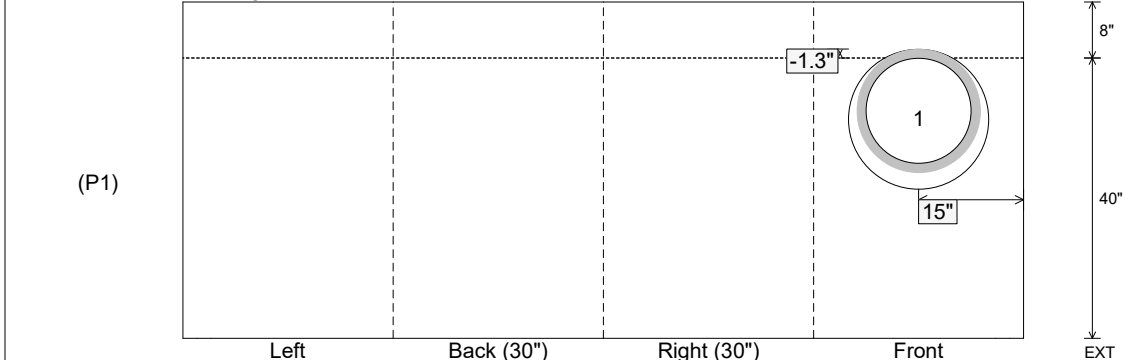

Coating (Int):
 Coating (Ext):

Seam Up: Flat
 Seam Dn: n/a

Wall Thickness: 6"
 Floor Height: 8"

Height (Int): 40"
 Height (Ext): 48"

Weight (Net): 3926 lb
 Volume (Net): 1cu.yd