


GENERAL NOTES:


1. PER ASTM C913 SPEC'S
2. CONCRETE: 4,000 PSI AT 28 DAYS.
3. NO STEPS AND NO INVERT CHANNEL..
4. CASTING SUPPLIED BY CONTRACTOR, TO BE CAST INTO TOP OF WALLS

REINFORCING PER ASTM A615 (GRADE 60).

- WALLS (As .37) #5 BARS AT 9" C.C.E.W.
- FLOOR (As .37) #5 BARS AT 9" C.C.E.W.

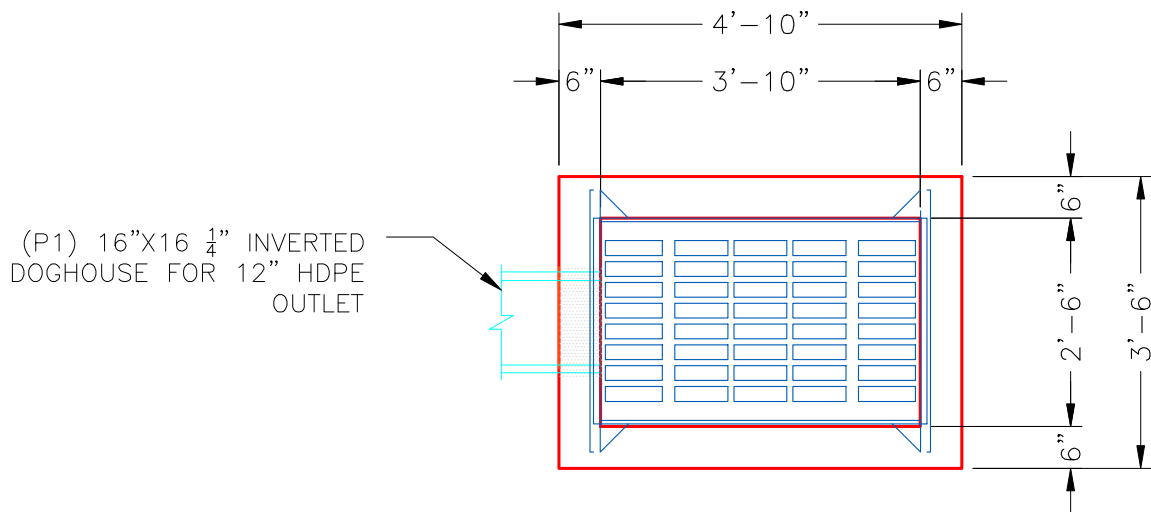

**PLAN VIEW
RIGHT SIDE UP**

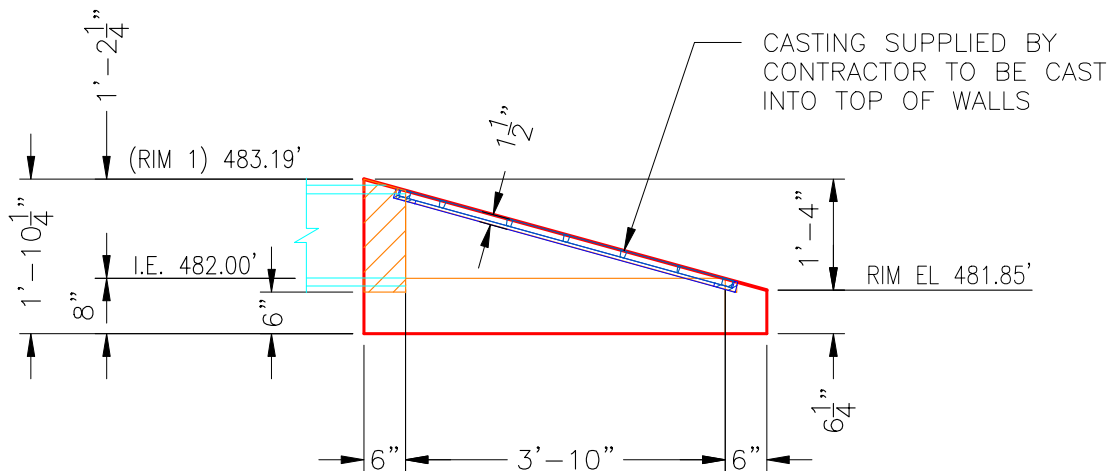

SIDE VIEW

STACKOUT DRAWING

<p>QUALITY CONTROL CHECKLIST</p> <ul style="list-style-type: none"> <input type="checkbox"/> ALL DIMENSIONS CORRECT. <input type="checkbox"/> LIFTERS INSTALLED. <input type="checkbox"/> OPENING CENTERED. <input type="checkbox"/> REINFORCING CORRECT. <input type="checkbox"/> SURFACE QUALITY ACCEPTABLE. <input type="checkbox"/> EDGES CHAMFERED. <input type="checkbox"/> ALL PATCHWORK ACCEPTABLE. 	PRODUCT I.D.: BX030046-06W08F	DESCRIPTION: 30"x46" BOX BASE. 6inW, 8inF		
	PRODUCT VIEW: RIGHT SIDE UP	CUSTOMER: CORNELL HARBISON EXCAVATING		
	PLANT: BEAVER DAM, KY.	PROJECT: WHISPERING OAKS SUBDIVISION		
	WEIGHT: 2032 LBS	STRUCTURE: 29		
	TOP SECTION JOINT: N/A	ORDER NO: 25-2686		
	BASE SECTION JOINT: N/A	PE: J. JARVIS	DRAWING: FMT	
	QC CHECK INITIALS:	DATE: 01/27/26	SCALE: NTS	PG. 1 of 1