

Job Name: 25-2686 - Whispering Oaks Subdivision
Job Location: Jeffersonville, IN
Contractor: Cornell Harbison Excavating

PC: J. Jarvis
 TECH: J. Horsley - F
 Plant: 100



Structure ID: 30
 Spec: INDOT
 Type: INLET TYPE E
 Size: 30" x 30"

Rim: 485.26'
 Invert: 481.96'
 Rim to Invert: 3.3'

Sump: 0"
 Floor (Top): 481.96'
 Floor Height: 8"

Floor (Bot): 481.293'
 Overall Height: 3.917'
 Slack: 0.6"


Structure Notes:

- PER INDOT INLET TYPE E / ASTM C-913 SPECIFICATIONS
- CONCRETE: 4,000 PSI AT 28 DAYS
- REINFORCEMENT: #5 BAR @ 12" C.C. E.W. (GRADE 60)
- NO STORM INVERT
- NO STEPS
- EJ 6610 GRATE SUPPLIED BY OTHERS
- 2.25" WIDE X 1" DEEP RECESS REQUIRED ALONG INNER TOP SIDE OF WALLS FOR GRATE TO RECESS INTO


STRUCTURE SUMMARY:

P2) 34.5" x 34.5" - RECESS/GRATE SEAT - 1" 0 lb
 P1) 30" x 30" - BOX BASE 6inW, 8inF, Variable Ht F/n - 39" 3809 lb
 1) 30" x 30" - Conseal CS-102 1.00" 0 lb
 2) Hole - 16 0 lb


 Structure Total: 3809 lb

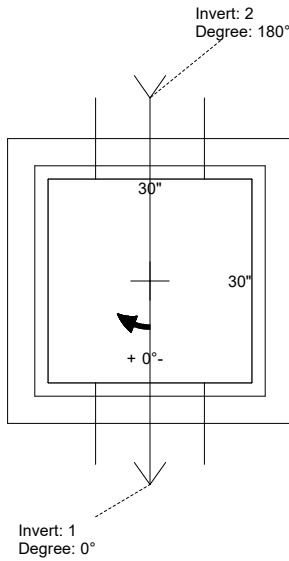

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (")	Ref
Rim	485.26'							
Reducer								
Invert 1	481.96'	0°	12" HDPE	14.5"	16"	Hole 16	-1.25"	P1
Invert 2	481.96'	180°	12" HDPE	14.5"	16"	Hole 16	-1.25"	P1
Invert 3								
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

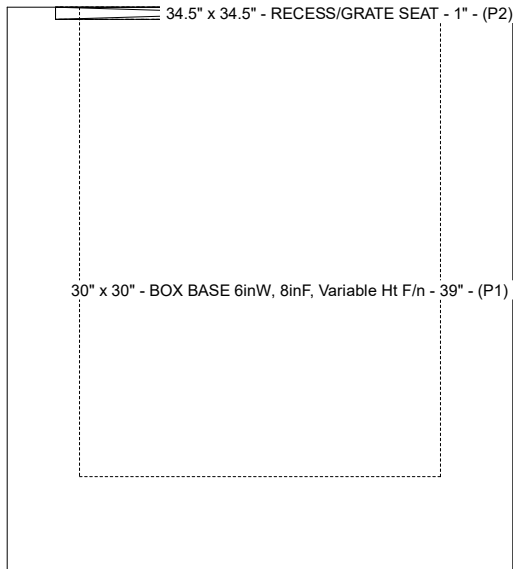

Cast (Int. Dim.) - Interior Dimensions

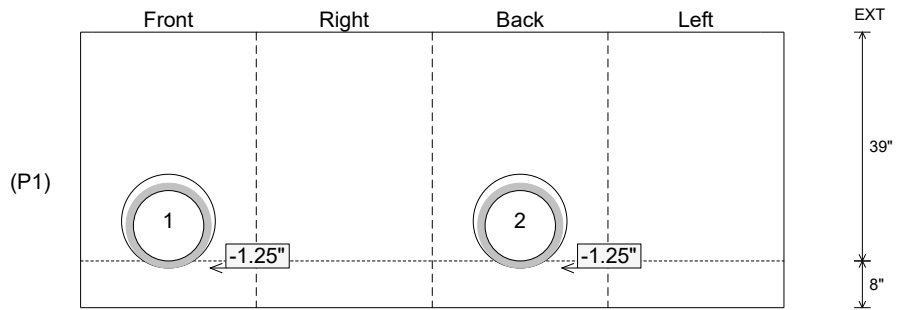

Submittal Drawing
 2/6/2026 9:34:45 AM

SUBMITTAL
 APPROVED BY: