

Structure ID: SSMH F1




P1 MH048BA36

MH BASE T/n

P3) 24" - CASTING HEIGHT - 7" P2) 48" - MH FLAT TOP w/ 24" ECC Hole F/G - 12" P1) 48" - MH BASE T/n - 36" 1) 48" - MH INVERT CHANNEL - FULL HEIGHT 1) JOINT WRAP - 0.065"x6"x50' CONSEAL CS212 1) JOINT WRAP PRIMER - CONSEAL CS-75 (1 gal.) 1) CASTING - HOE MC-315 F/C Sanitary 1) 48" - DBL 1"x14.5' Butyl (2x) 1) A-Lok - 0285 2) A-Lok - 0210	0 lb 1561 lb 3779 lb 1440 lb 0 lb 0 lb 258 lb 0 lb 1 lb 2 lb ----- Structure Total: 7041 lb	Structure Notes: 1. PER ASTM C478 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. MC-315 "SANITARY" BY ICAST 4. REINFORCING PER ASTM A615 (GRADE 60). - CONE (As .12) - RISER/WALLS (As .12) - FLOOR (As .31) #5 BARS AT 12" C.C.E.W. 5. NO STEPS
---	--	---

Rim: 916.56' Rim to Invert: 4.42' Slack: 0.04" Sump: 2" Step Position: 90°

Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	912.14'	0°	0"	8" PVC SDR35	8.5"	A-Lok 0285	9.75"	9.818"	1.125"	0"
Invert 2	912.34'	105°	53.145"	6" PVC SDR35	6.25"	A-Lok 0210	7.25"	7.278"	3.775"	0"
Invert 3	912.34'	220°	111.352"	6" PVC SDR35	6.25"	A-Lok 0210	7.25"	7.278"	3.775"	0"
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										

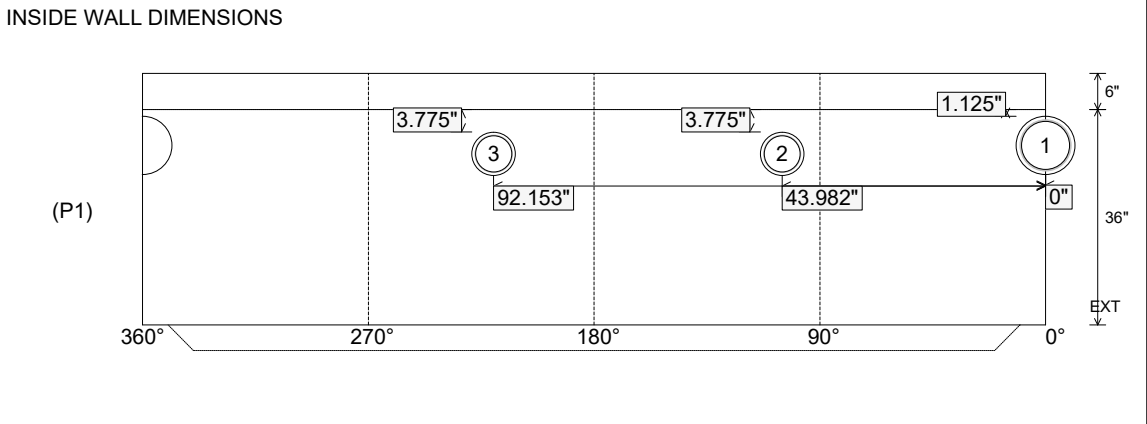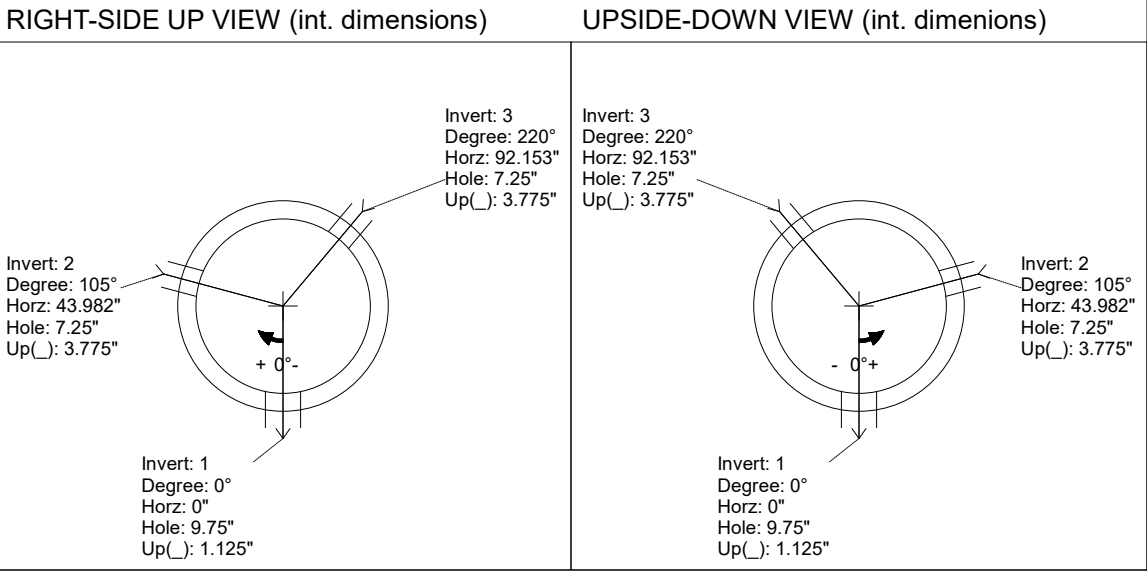

Coating (Int): Coating (Ext):	Seam Up: Tongue Seam Dn: n/a	Wall Thickness: 5" Floor Height: 6"	Height (Int): 36" Height (Ext): 42"	Weight (Net): 3779 lb Volume (Net): 0.96cu.yd
----------------------------------	---------------------------------	--	--	--