
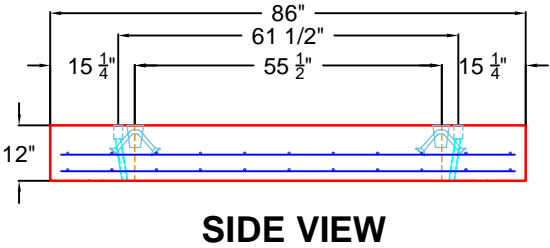
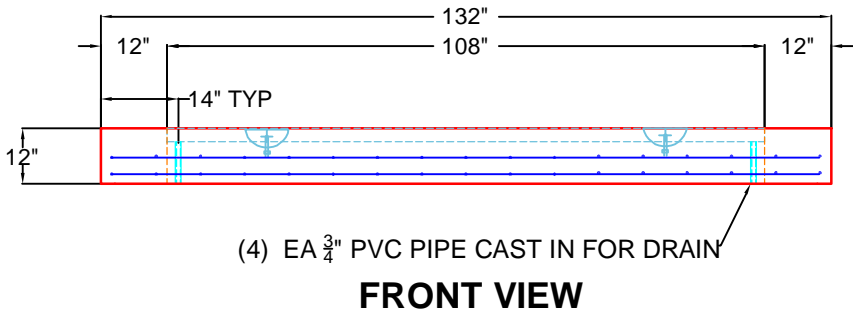


**GENERAL NOTES :**

1. CONCRETE 28 DAY COMPRESSIVE STRENGTH OF 5000 PSI.
2. REINFORCING PER ASTM A-615:  
TOP SLAB: #4 BAR @ 8" C.C.E.W. DBL MAT  
BASE #4 @ 8" C.C.E.W
3. VAULT JOINT TO BE SEALED WITH CONSEAL CS-102 ROLL (SUPPLIED BY ICAST).
4. WEIGHT:  
TOP SLAB = 5,396 LBS  
BASE SECTION = 14,258 LBS  
TOTAL = 19,654 LBS
5. TOP COVER PLATE PROVIDED BY OTHERS
6. (2)108" LONG UNISTRUT SECTIONS FOR  $\frac{1}{2}$ " INSERTS CAST INTO TOP SLAB (ATKORE UNISTRUT P3254WC PG)

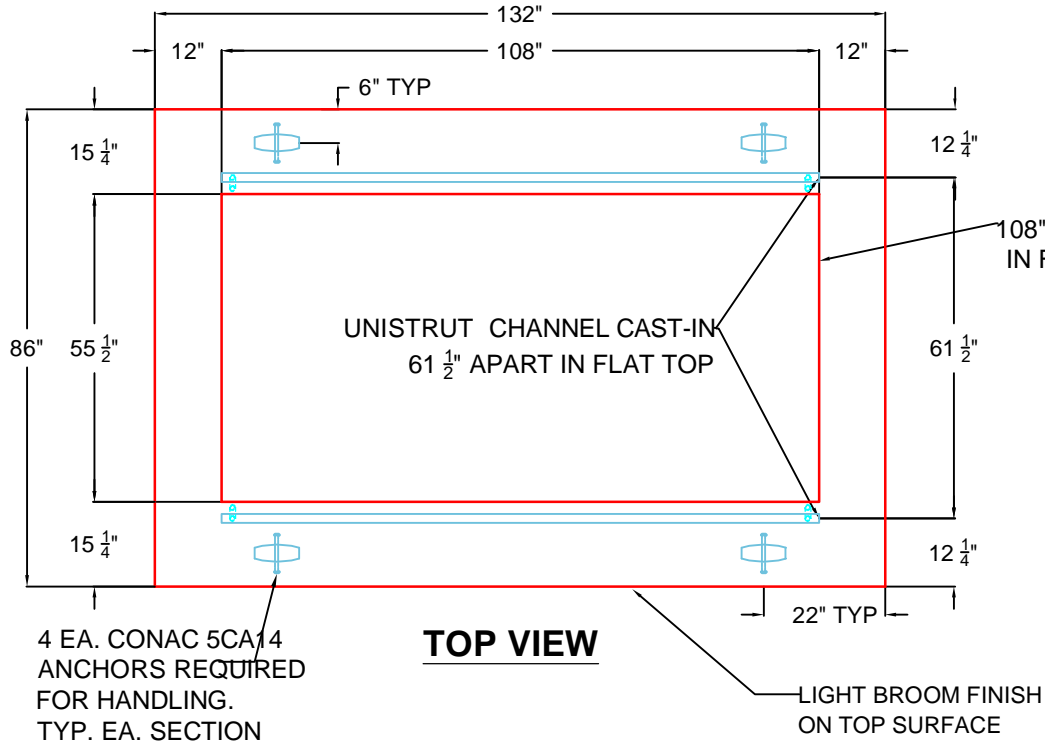

REVISION INFORMATION

|                     |                      |
|---------------------|----------------------|
| REV. $\Delta$ DATE: | NO REVISIONS TO DATE |
|                     |                      |
|                     |                      |
|                     |                      |
|                     |                      |



|  |                   |            |
|--|-------------------|------------|
| PRODUCTION DRAWING: 5'X10' SWITCH GEAR PIT TOP |                   |            |
| CUSTOMER: KEMPER CONSTRUCTION                  |                   |            |
| PROJECT: CVG 200 MLLC                          |                   |            |
| STRUCTURE: PIT 2                               |                   |            |
| QUOTE/SALES ORDER NO: 25-2930                  |                   |            |
| CHK BY: B SMITH                                | DRAWN BY: C. RUSS |            |
| DATE: 08/12/25                                 | SCALE: NTS        | PG. 1 of 1 |