

Contractor: Louisville Paving and Construction

PC:	J. Jarvis
TECH:	J. Horsley - A
Plant:	100




Slack: 0"

1. PER MSD YARD DRAIN / ASTM C-913 SPECS
2. CONCRETE: 4,000 PSI AT 28 DAYS
3. REINFORCEMENT: #4 BAR @ 12" C.C. E.W. (GRADE 60)
4. HOE 165-A FRAME & GRATE SUPPLIED BY OTHERS


P3) 18" x 18" - CASTING HEIGHT - 4"
P2) 18" x 18" - BOX RISER 6inW, Variable Ht F/G - 11"
P1) 18" x 18" - BOX BASE 6inW, 6inF T/n - 24"
2) 18" x 18" - Conseal CS-102 1.00"
2) Hole - 18

0 lb
532 lb
1421 lb
0 lb
0 lb


Structure Total: 1953 lb

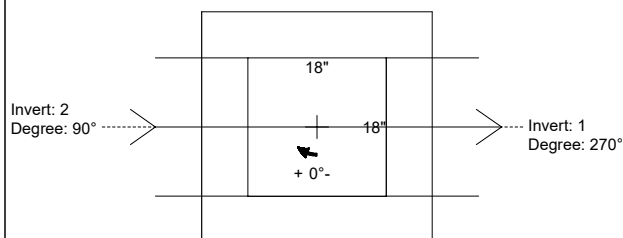

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (↓)	Ref
Rim	566.45'							
Reducer								
Invert 1	563.2'	270°	12" HDPE	14.5"	18"	Hole 18	-3"	P1
Invert 2	563.2'	90°	12" HDPE	14.5"	18"	Hole 18	-3"	P1
Invert 3								
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

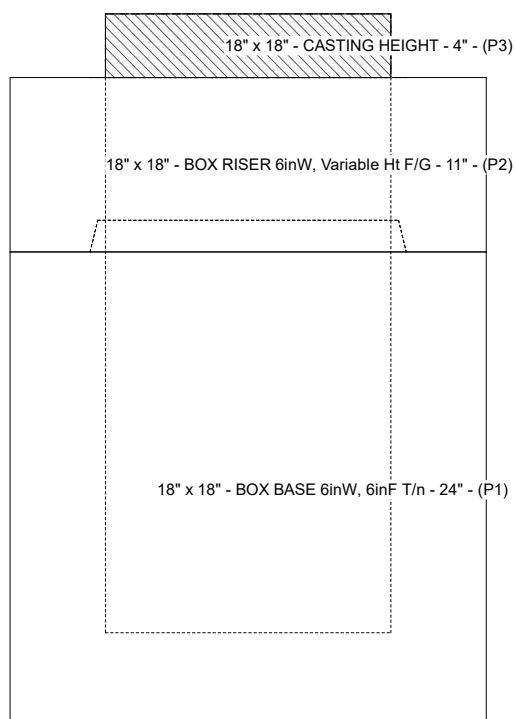

Cast (Int. Dim.) - Interior Dimensions

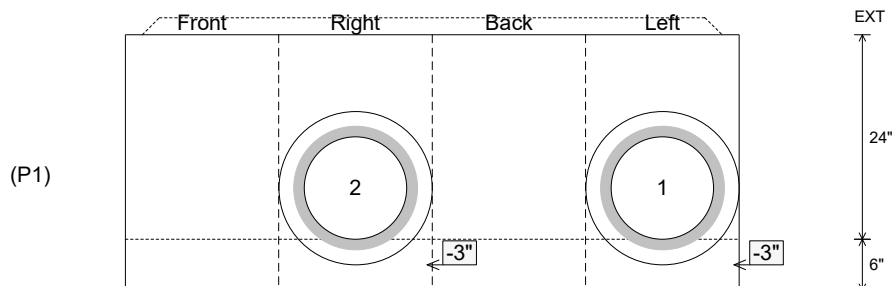

Submittal Drawing
6/17/2026 5:40:22 PM

SUBMITTAL
APPROVED BY: