

Job Name: 25-3000 - Wilkinson Lane PS
Job Location: White House, TN
Contractor: Cumberland Valley Constructors, Inc.

PC: A. Chambers
 TECH: J. Horsley - F
 Plant: 100



Structure ID: **V3 Sump Pit**
 Spec: Storm
 Type: BX 6inW, 6inF
 Size: 18" x 18"

Rim: 1'
 Invert: 0'
 Rim to Invert: 1'


Sump: 0"
 Floor (Top): 0'
 Floor Height: 6"

Floor (Bot): -0.5'
 Overall Height: 1.5'
 Slack: 0"

- Structure Notes:
1. PER ASTM C-913 SPECIFICATIONS
 2. CONCRETE: 4,000 PSI AT 28 DAYS
 3. REINFORCEMENT: #5 BAR @ 12" C.C. E.W. (GRADE 60)
 4. NO CASTING - SUMP PIT FOR STRUCTURE V3



STRUCTURE SUMMARY:

P1) 18" x 18" - BOX BASE 6inW, 6inF F/n - 12" 1033 lb
 1) 18" x 18" - Conseal CS-102 1.00" 0 lb
 1) No Hole 0 lb
 Structure Total: 1033 lb



Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up ()	Ref
Rim	1'							
Reducer								
Invert 1			No Hole					
Invert 2								
Invert 3								
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

Cast (Int. Dim.) - Interior Dimensions

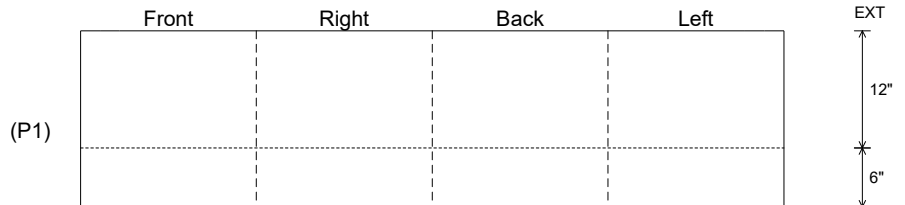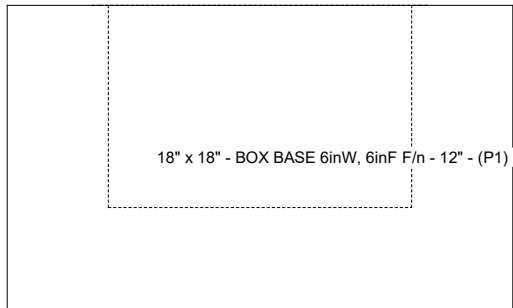

Submittal Drawing
 1/9/2026 2:41:32 PM

SUBMITTAL
 APPROVED BY: