



Structure Notes:

1. PER ASCTM C478 SPECIFICATIONS.
2. CONCRETE = 4,000 PSI AT 28 DAYS.
3. ADMIXTURE = CONBLOCK CDA RED.

REINFORCING PER ASTM A615 (GRADE 60).

- TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W. (DOUBLE MAT)
- WALLS/RISER (As .36)
- FLOOR (As .31) #5 BARS AT 10" C.C.E.W. (DOUBLE MAT)

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (')	Ref
Rim	992.5'							
Reducer								
Invert 1	972.5'	0°	16" DI	17.5"	20"	Kor-N-Seal2 S206-20L	16"	P1
Invert 2	979.75'	40°	16" DI	17.5"	20"	Kor-N-Seal2 S206-20L	49"	P2
Invert 3	982.25'	135°	4" PVC SCH40	4.5"	8"	PSX 8QRS-S NYLO	78.999"	P2
Invert 4	986.5'	180°	8" DI	9"	12"	PSX 12M NYLO	34"	P3
Invert 5	989.5'	340°	6" PVC SDR35	6.25"	12"	PSX 12-06 NYLO	69"	P3
Invert 6								
Invert 7								
Invert 8								

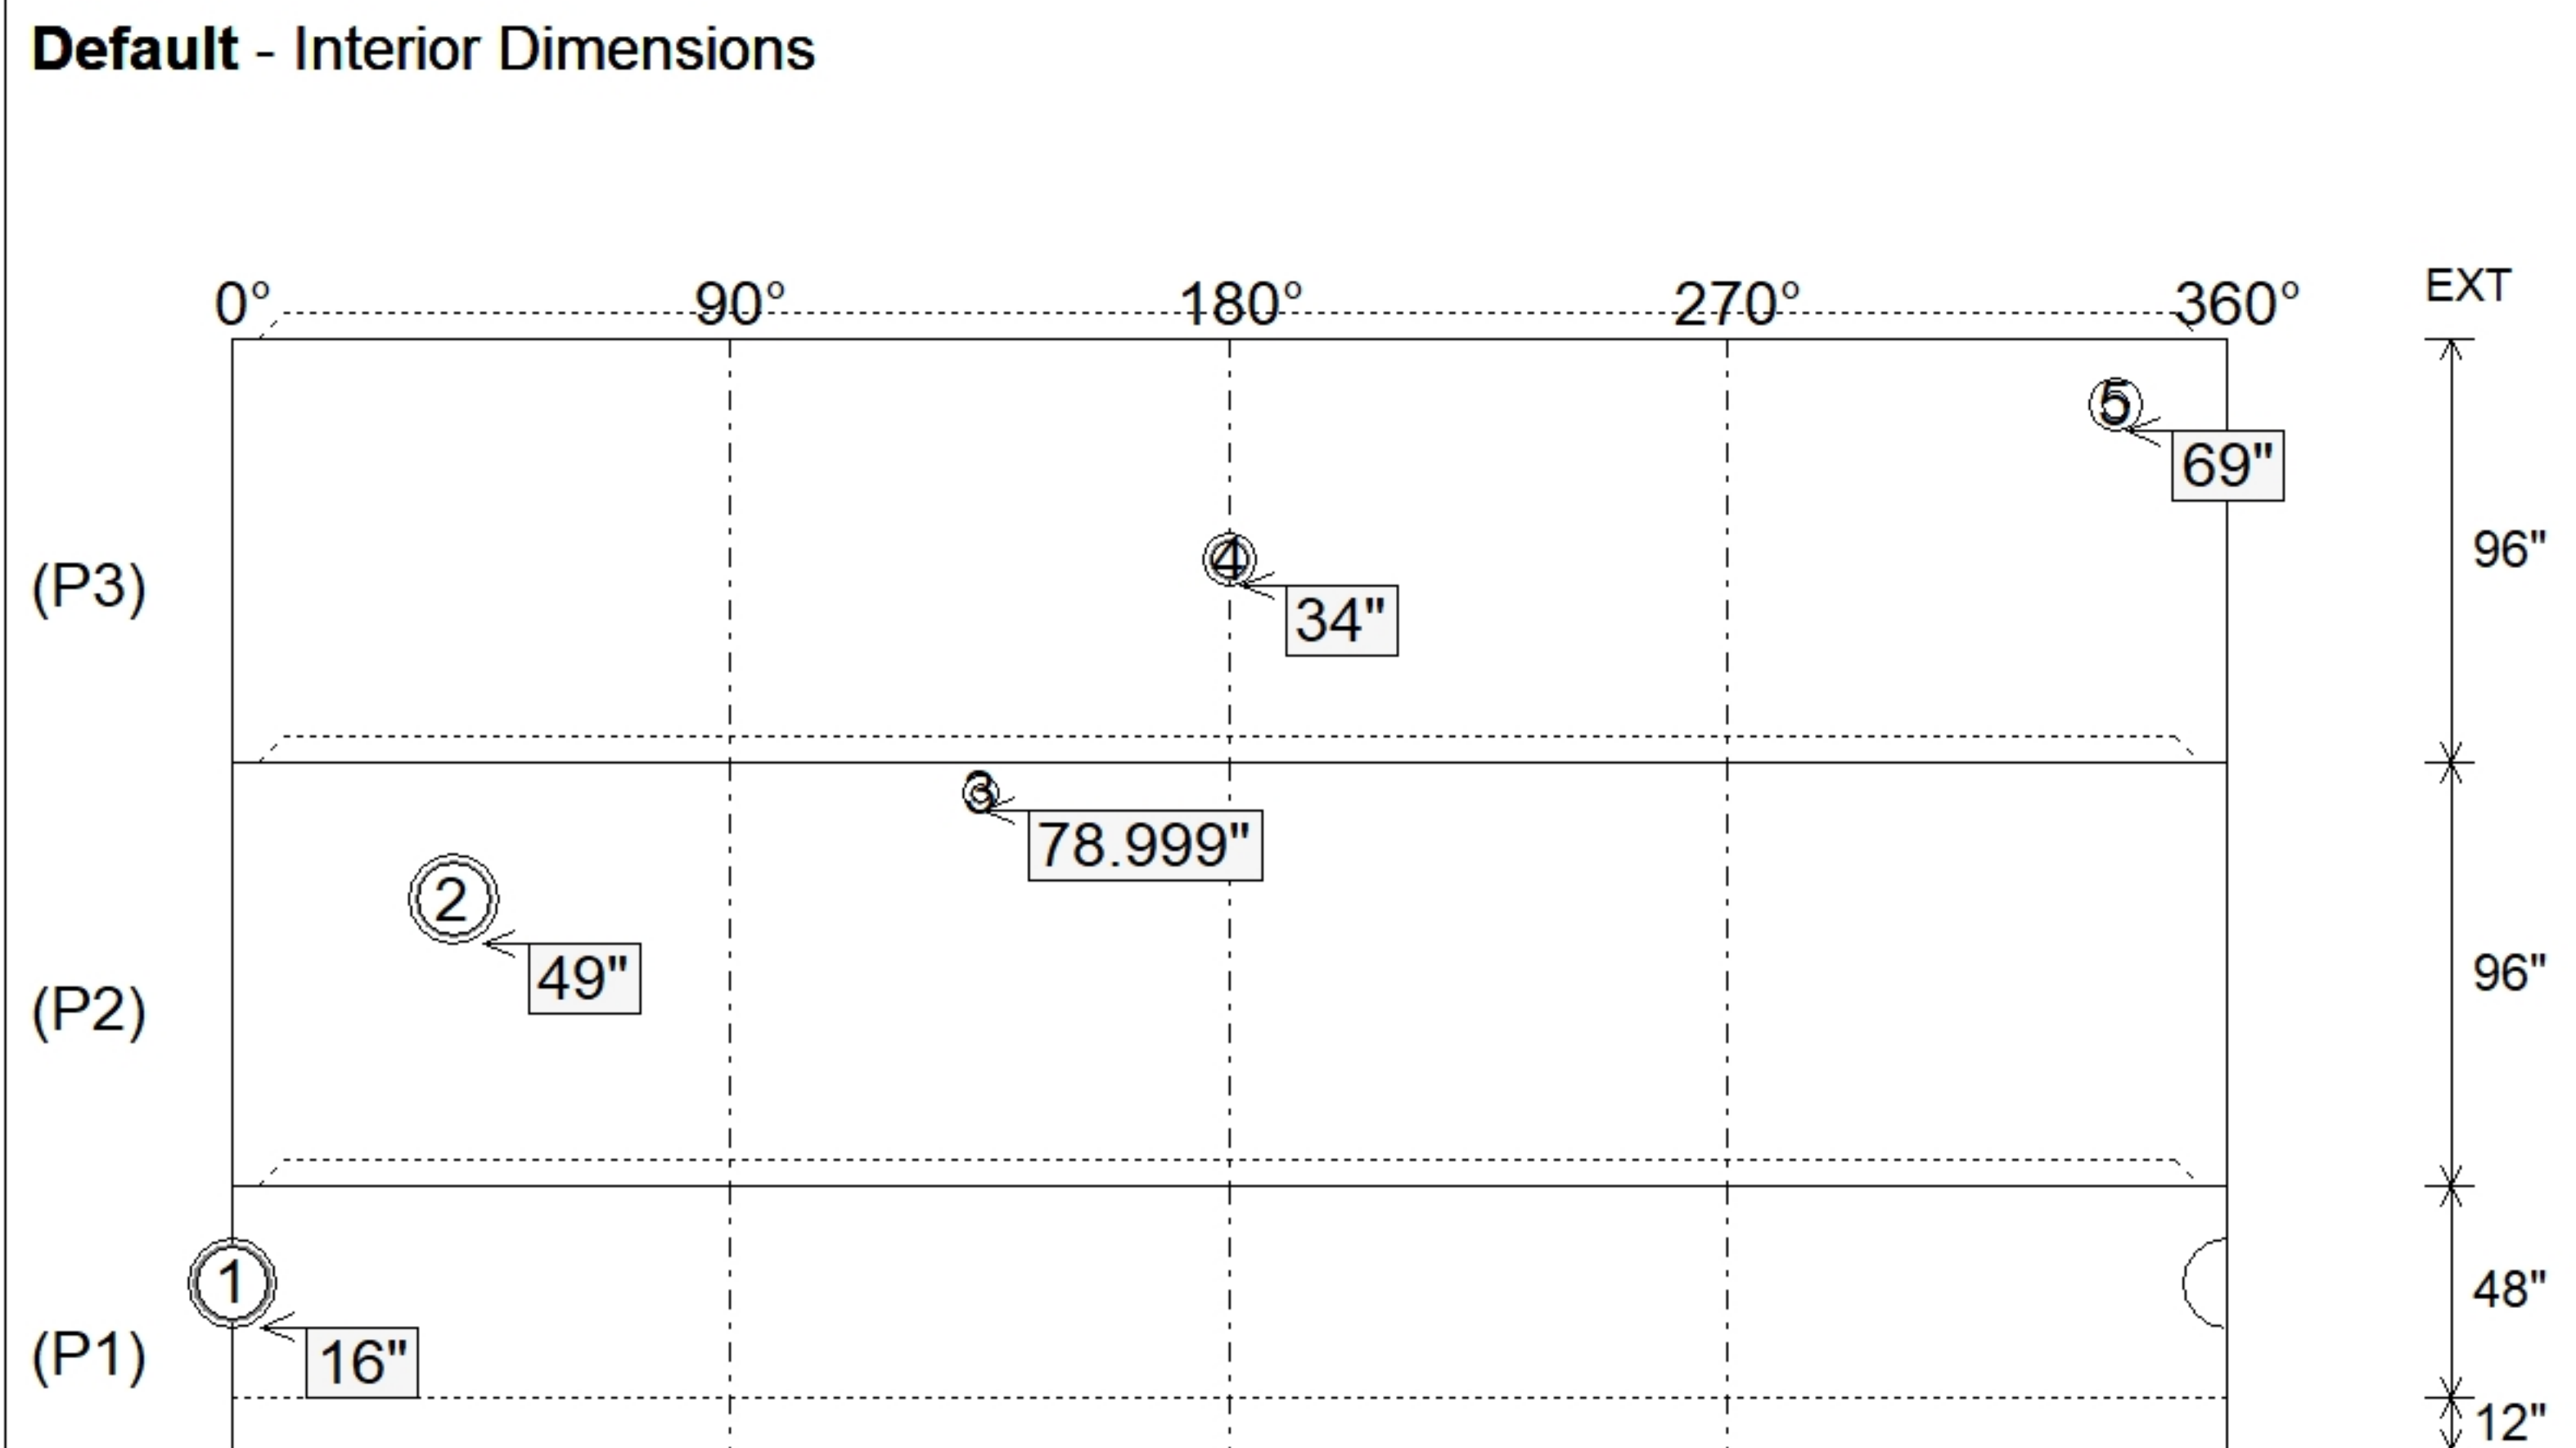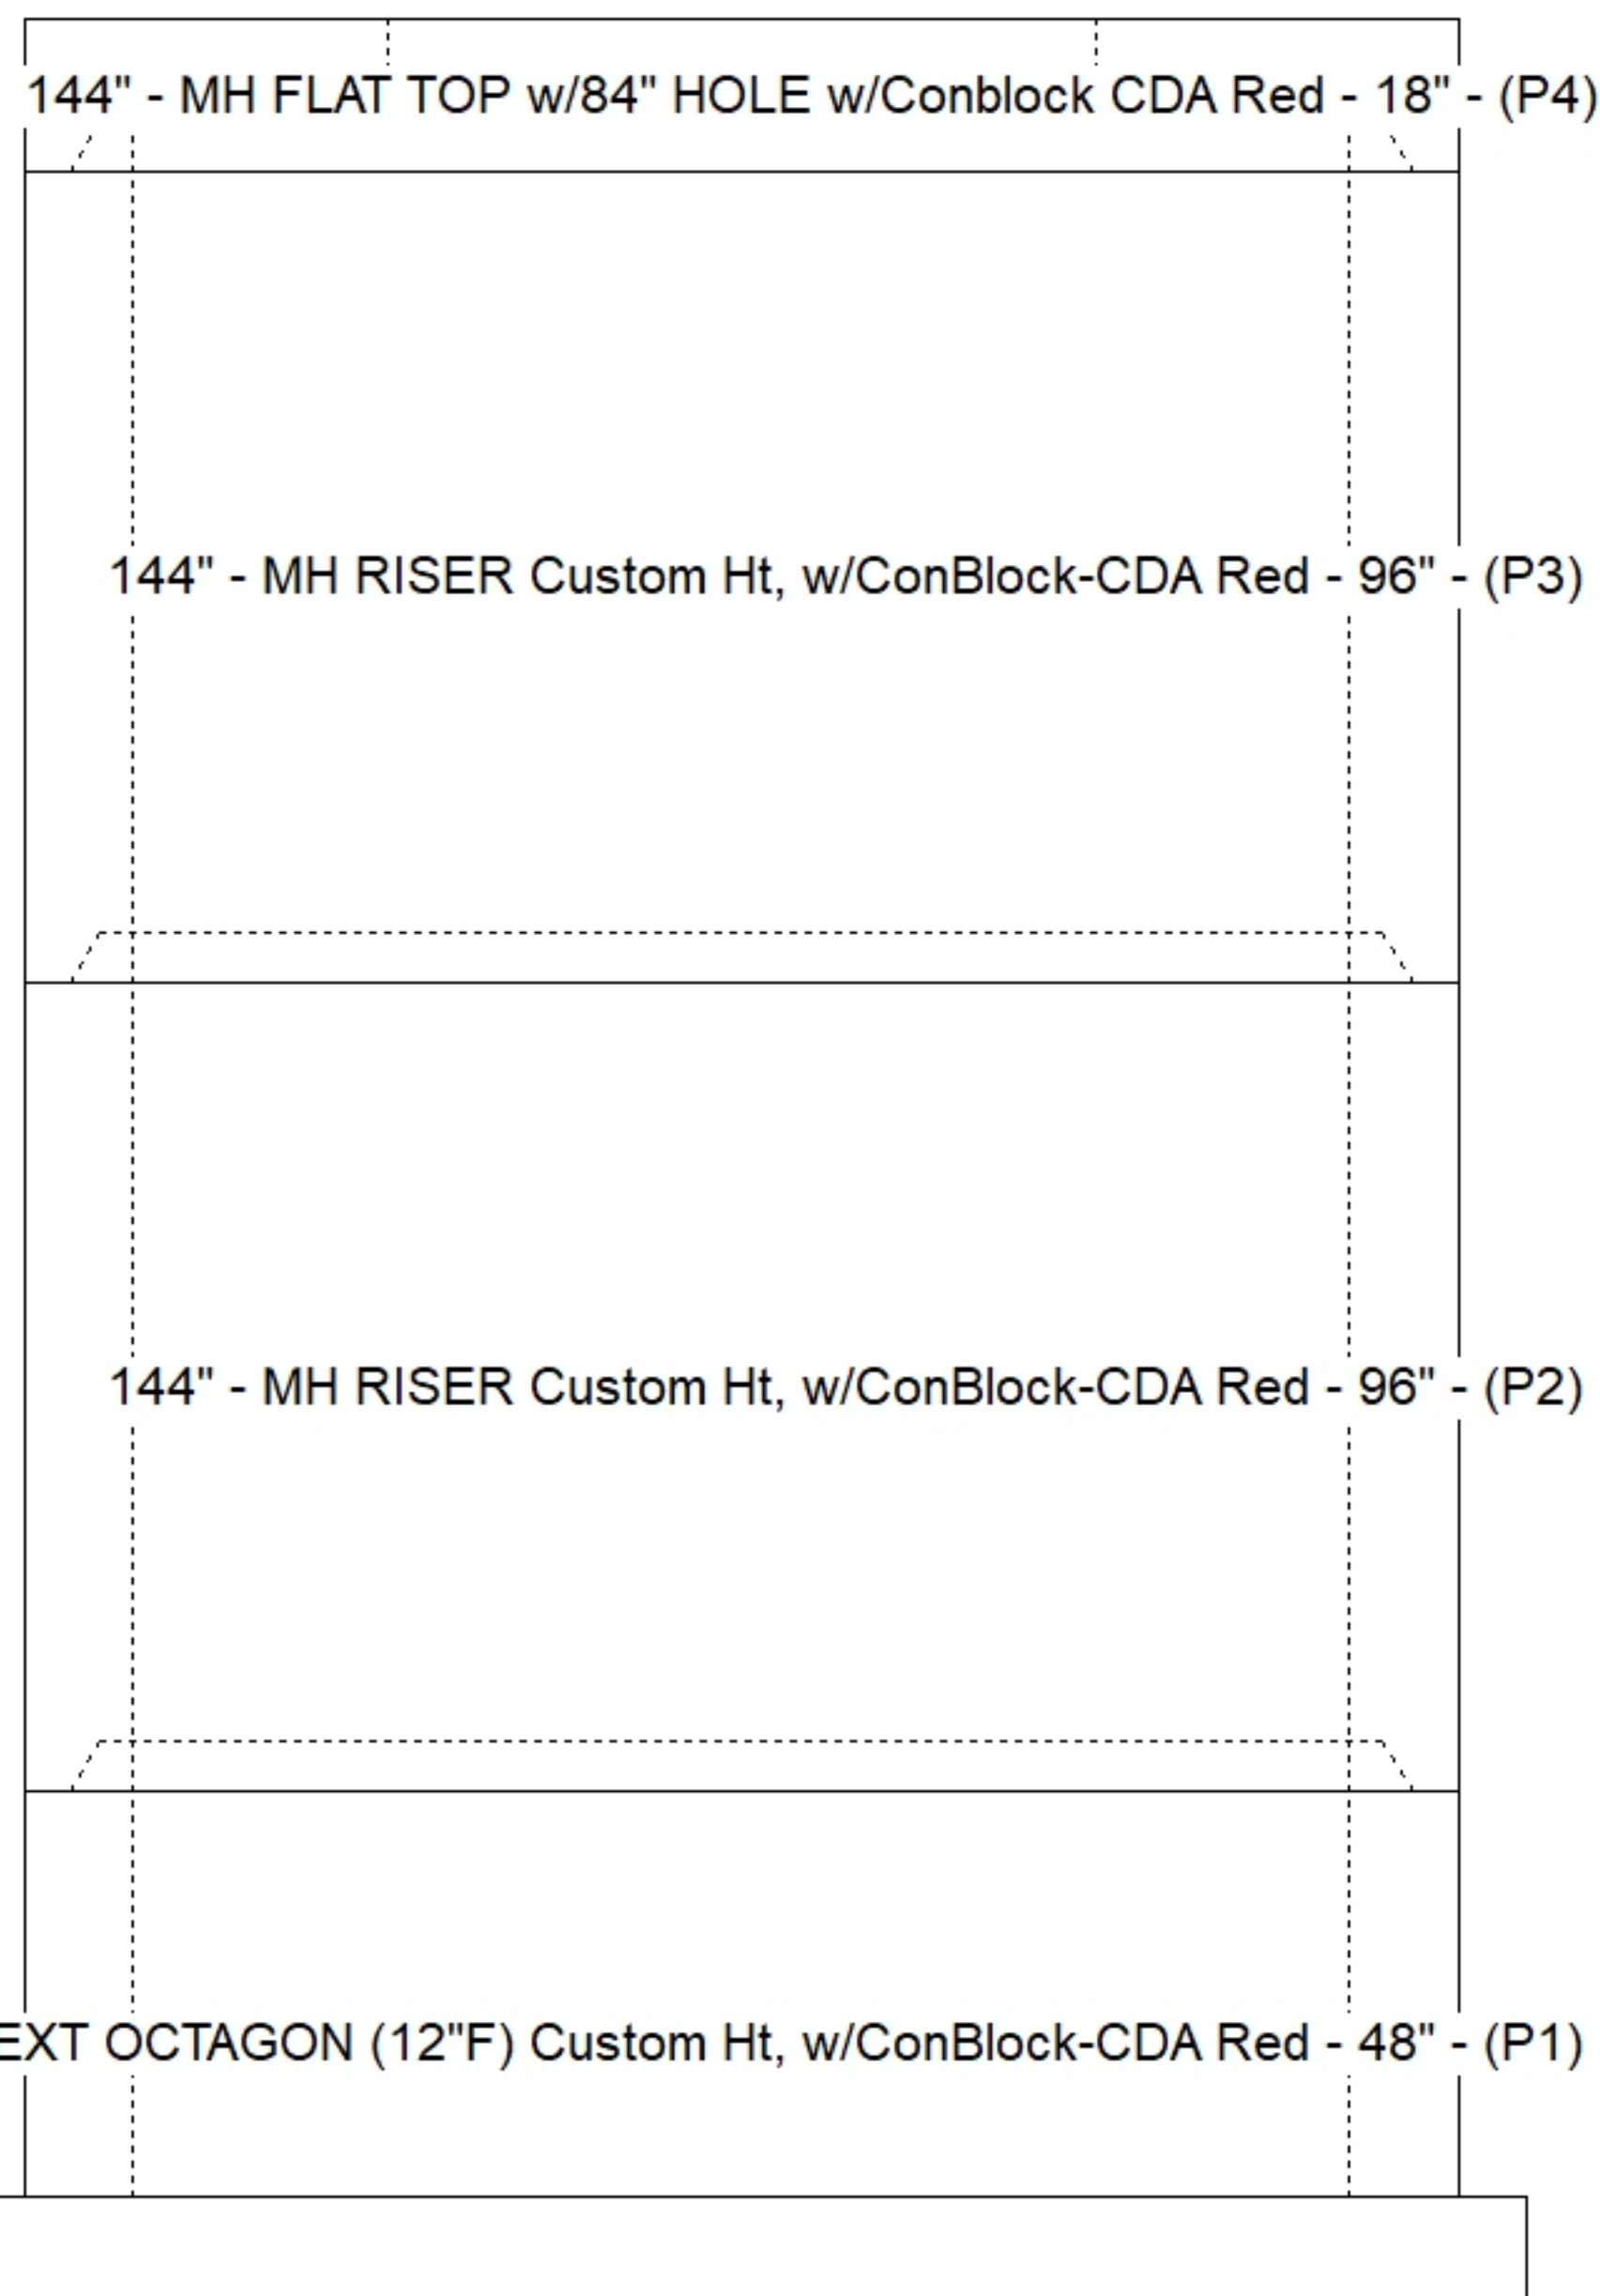

Submittal Drawing
9/8/2026 3:04:19 PM