
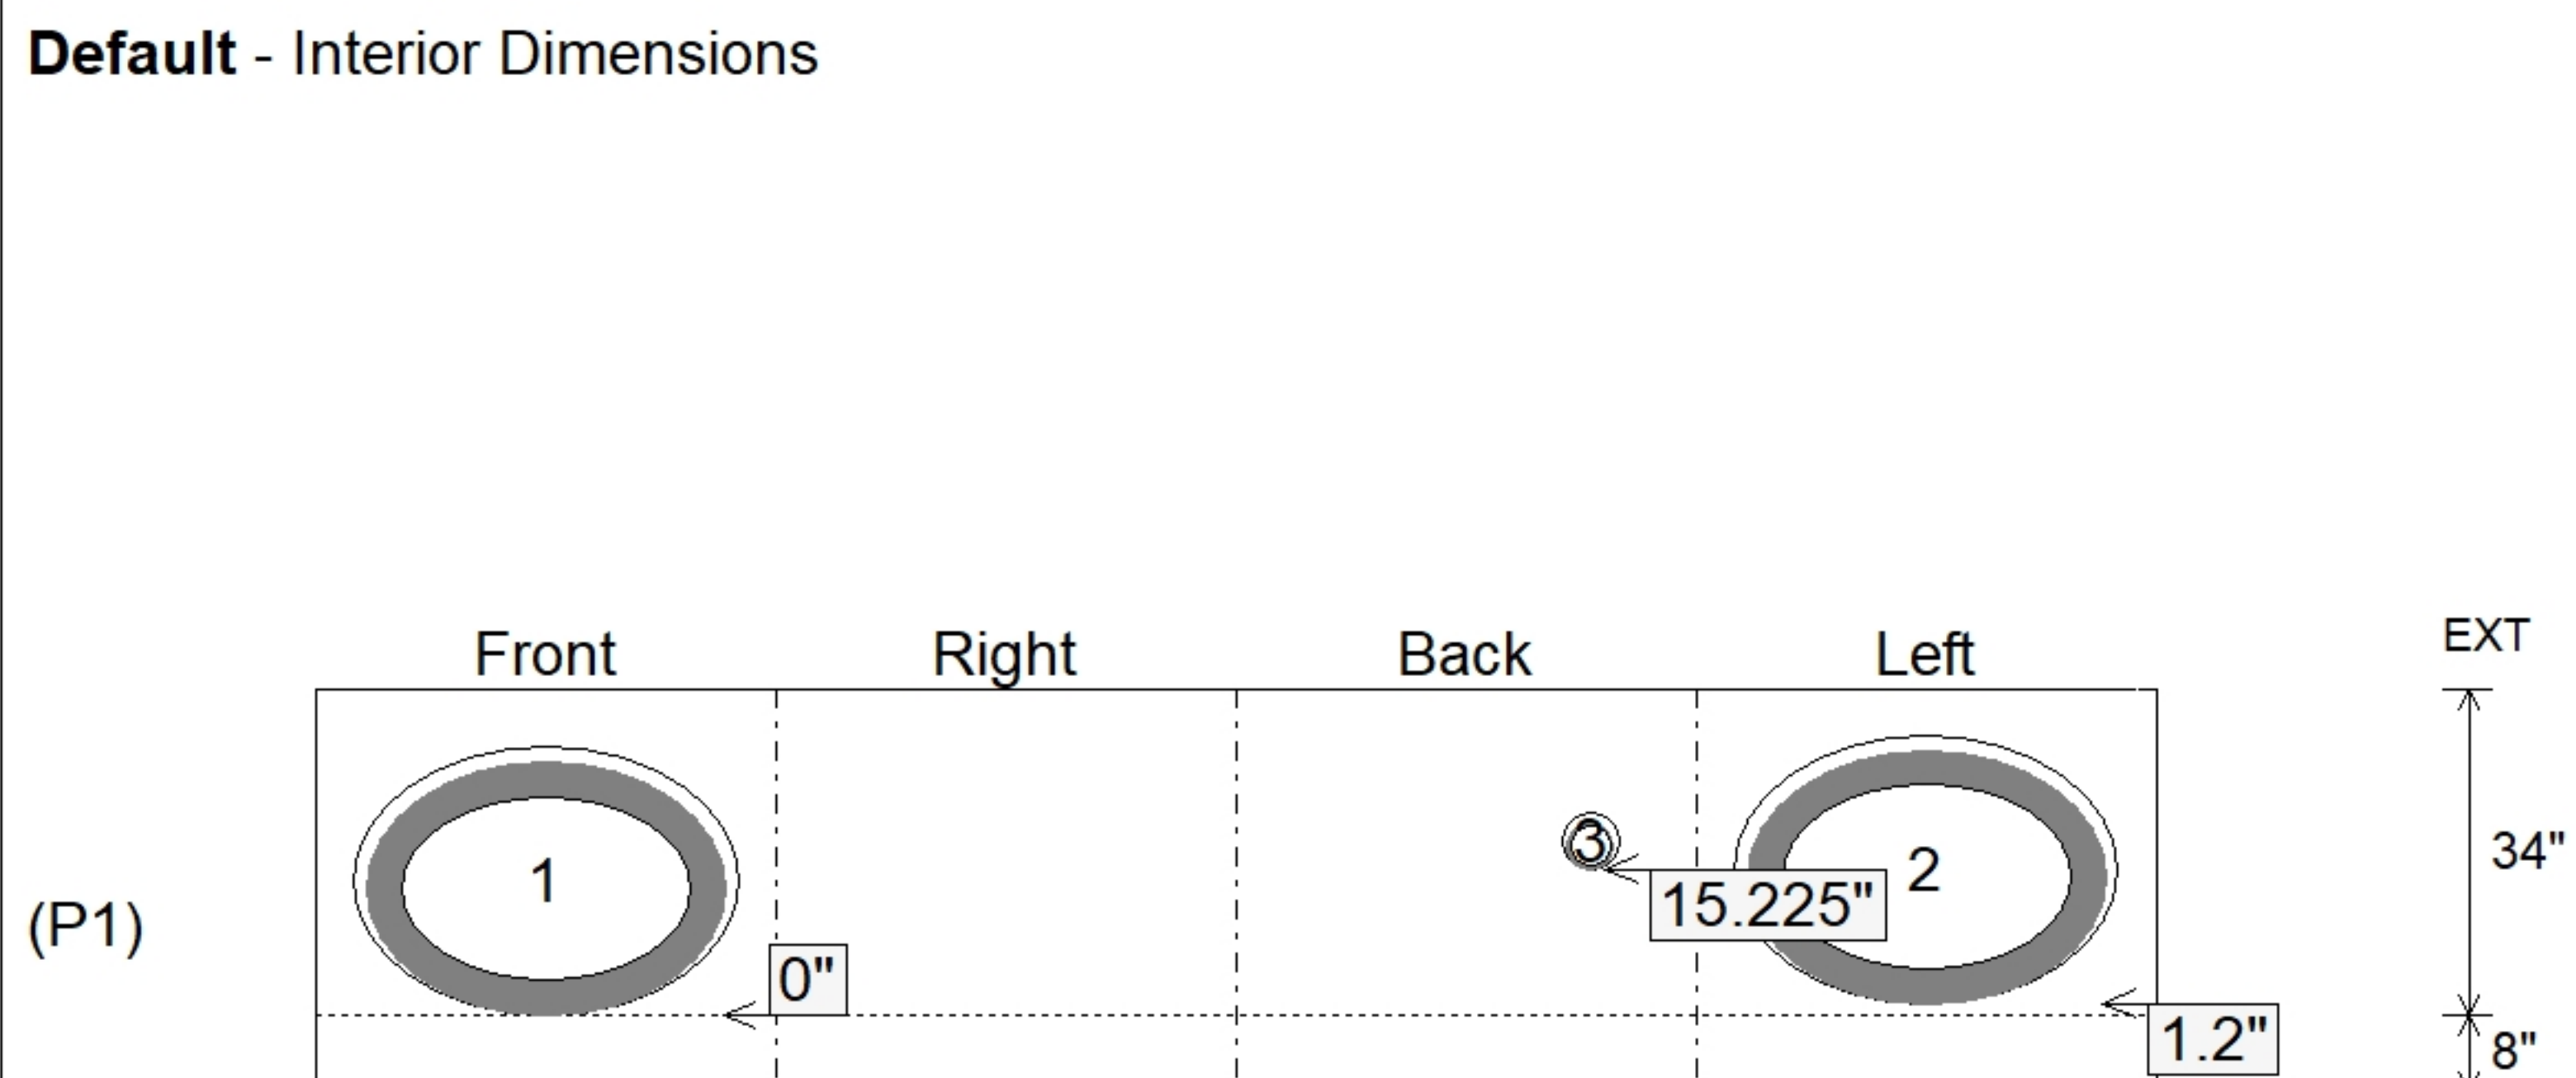
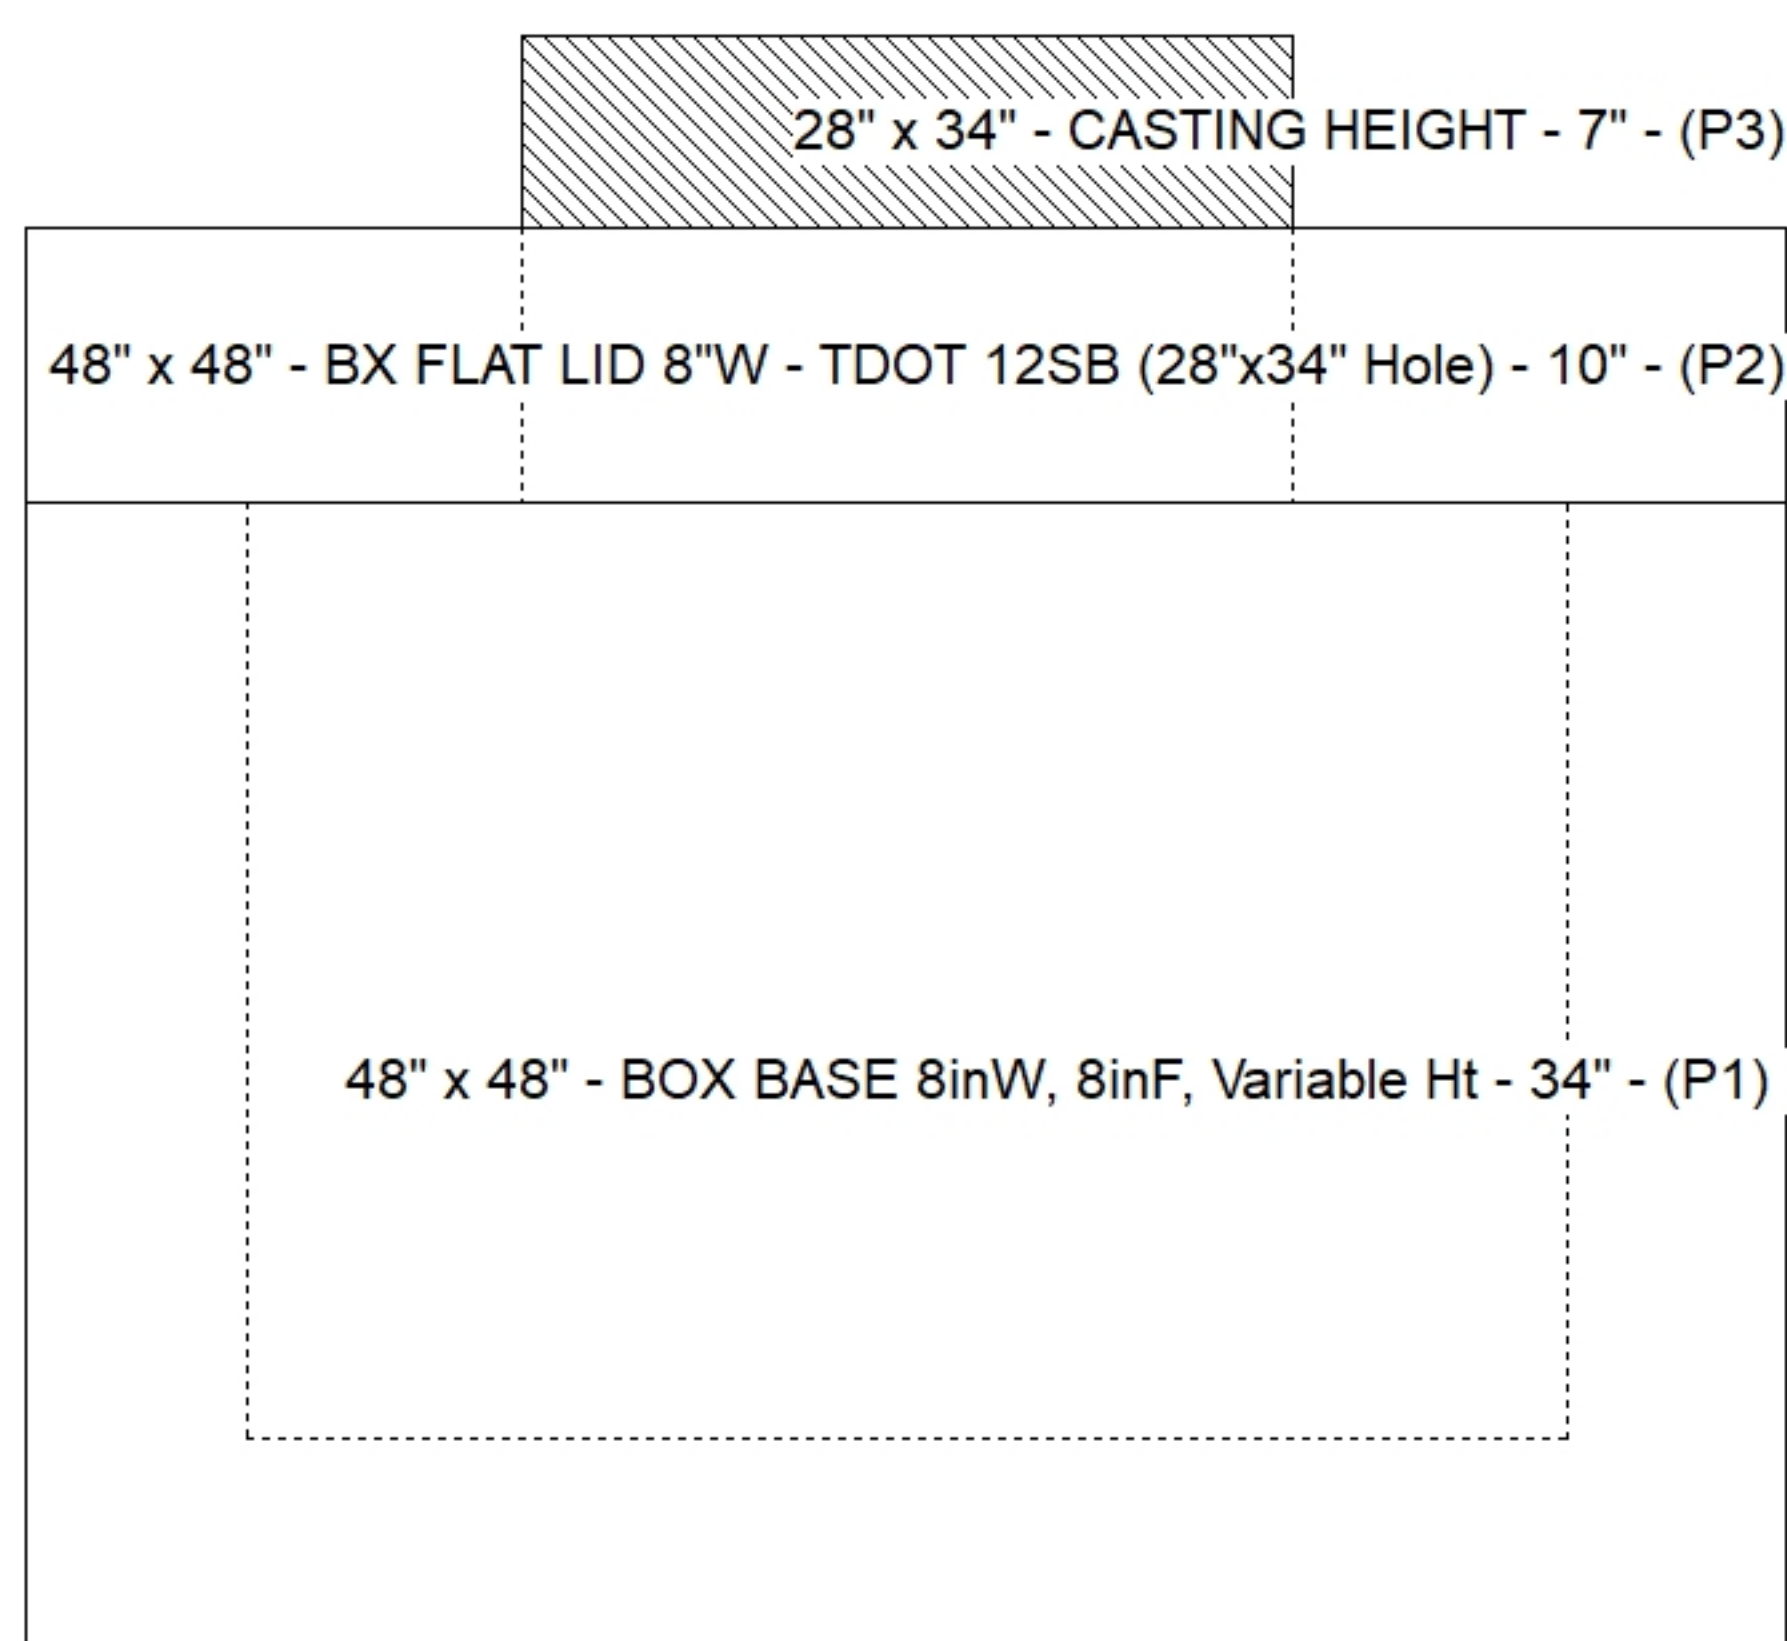


Structure Notes: 1. PER TDOT D-CB-12SB / ASTM C913 SPEC'S.
2. CONCRETE = 4,000 PSI AT 28 DAYS.
3. NO INVERT CHANNEL.
4. JBS 3123 MOD SINGLE SET BY ICAST
5. REINFORCING PER ASTM A615 (GRADE 60).
** SEE TDOT STD DRAWING D-CB-12SB **
- TOP SLAB - DBL MAT #5 BARS.
- WALLS (As .47) #5 BARS AT 8" C.C.E.W.
- FLOOR (As .47) #5 BARS AT 8" C.C.E.W.

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (⌵)	Rel
Rim	783.27'							
Reducer								
Invert 1	779.27'	0°	30" x 19" ELL RCP	37.375" x 26.438"	40" x 28"	Hole 40 x 28	0"	P1
Invert 2	779.37'	270°	30" x 19" ELL RCP	37.375" x 26.438"	40" x 28"	Hole 40 x 28	1.2"	P1
Invert 3	780.27'	180°	4" HDPE (perf pipe)	4.8"	6"	Hole 6	15.225"	P1
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

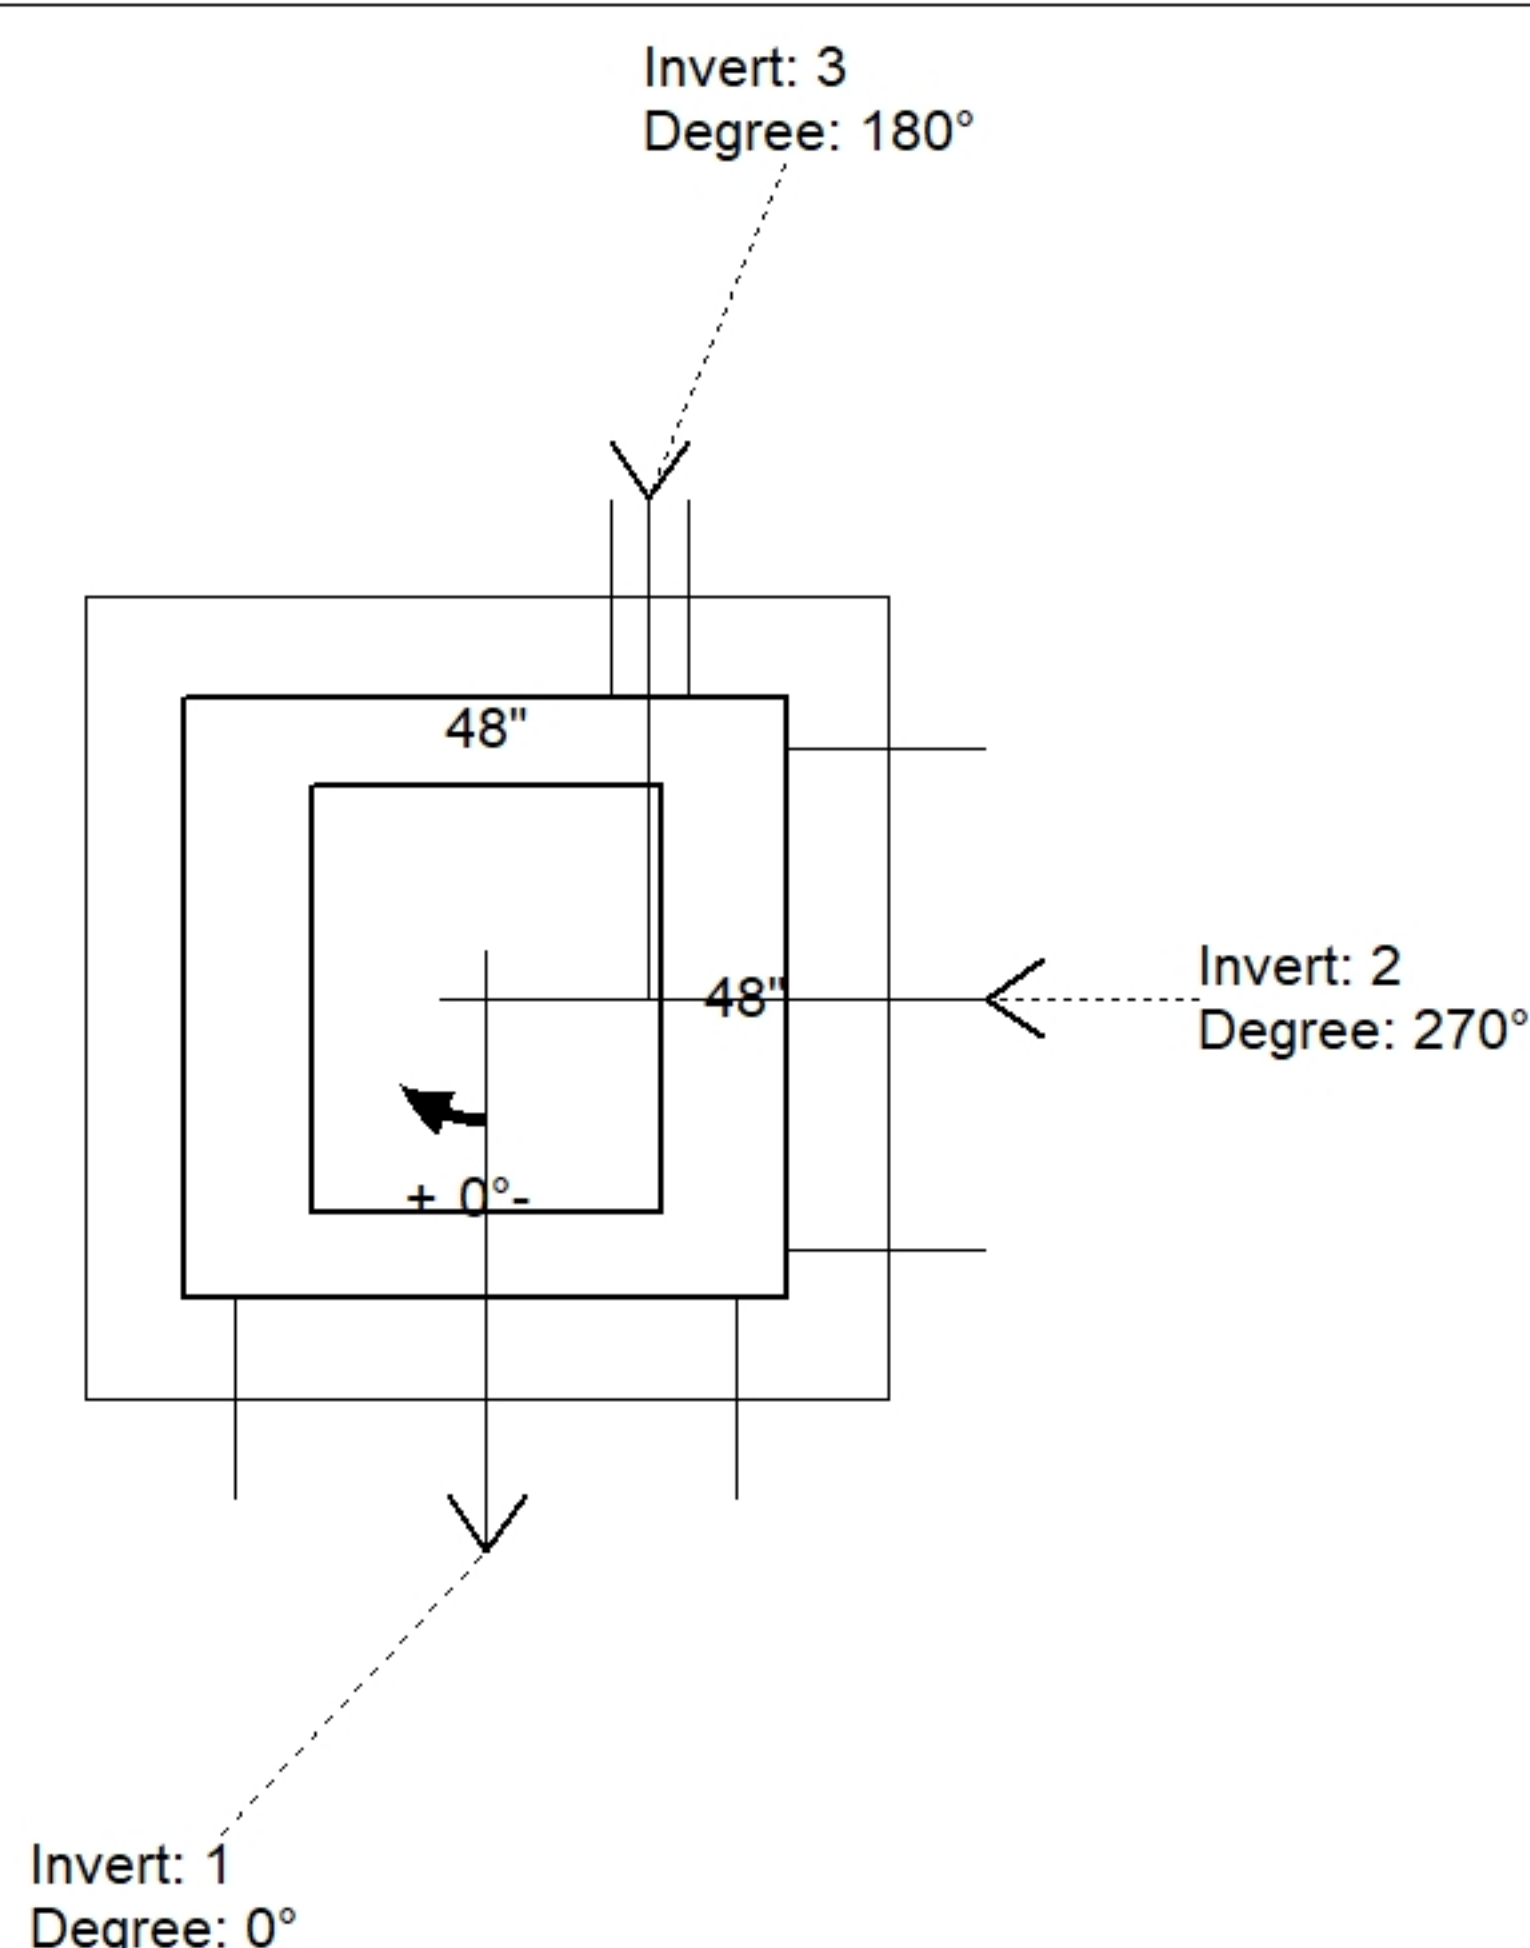

SUBMITTAL
APPROVED BY: