
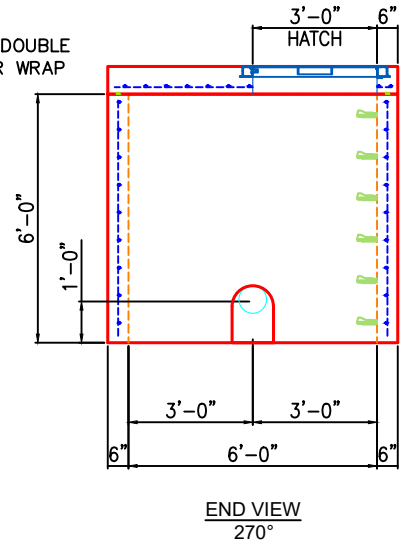
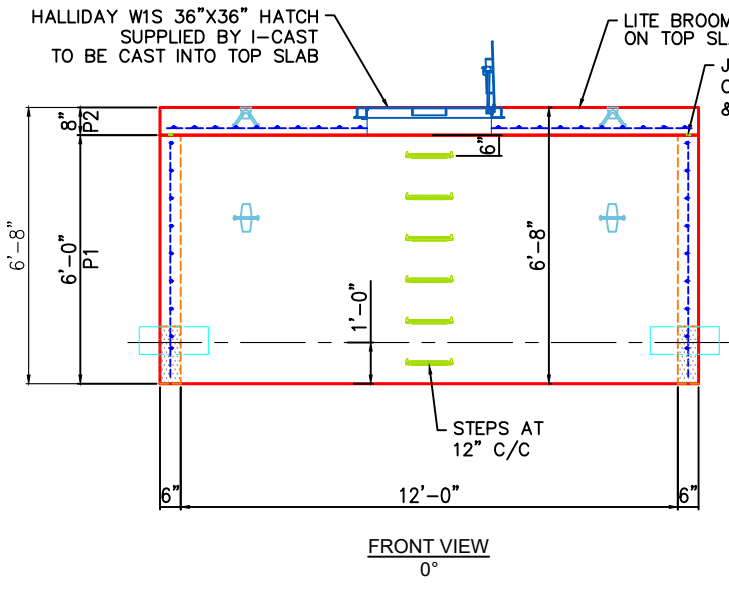
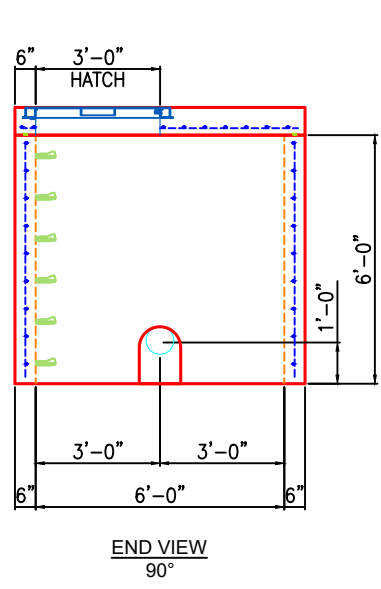


NOTES:

1. MANUFACTURED PER ASTM C913 SPECIFICATIONS.
2. CONCRETE = 5,000 PSI AT 28 DAYS.
3. STEPS REQUIRED.
4. JOINT SEALANT (SUPPLIED BY I-CAST):
CONSEAL CS-102 (1") DOUBLE.
5. EXTERIOR WRAP: 6" CS-212.
6. ADMIXTURE - NOT REQUIRED.
7. INVERT CHANNEL - NOT REQUIRED.
8. OPEN BOTTOM - P.I.P. BASE SLAB BY OTHERS.
9. COATING - NOT REQUIRED.
10. REINFORCING PER ASTM A615 (GRADE 60).
- TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W
- RISER (As .47) #5 BARS AT 8" C.C.E.W
11. 36"x36" HALLIDAY W1S HATCH (SUPPLIED BY I-CAST):
MUST INCLUDE SKIRT FOR CASTING INTO TOP SLAB.
HEIGHT OF HATCH WITH SKIRT = 8".
12. WEIGHTS:
P2 TOP SLAB = 8,200 LBS
P1 RISER = 16,352 LBS

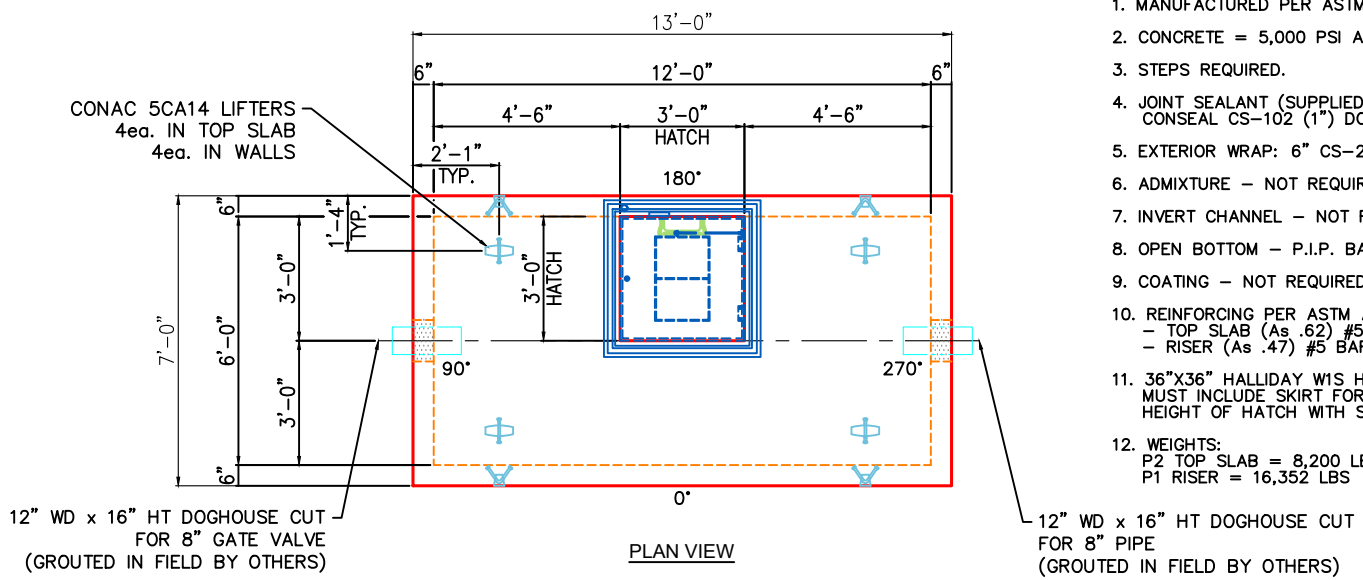

REVISION INFORMATION

REV.	DATE	NO REVISIONS TO DATE



SUBMITTAL DRAWING: 144x72 VAULT		
CUSTOMER: CORE & MAIN		
PROJECT: BELMARK VAULT		
STRUCTURE: CONCRETE VAULT 8in (144x72)		
SALES ORDER NO: 25-3165		
PC: E. BRADLEY	DRAWN BY: FMT	
DATE: 10/03/25	SCALE: NTS	PG. 1 of 1