

Job Name: 25-3182 - Silverstone Subdivision
 Job Location: Bowling Green, KY
 Contractor: R.A. Alexander & Sons, Inc.

Plant: 100

3/10/2026 9:41:53 AM

Tech: Jared - F

PC: T. Lewis



Structure ID: A6

P4 GR3

GRADE RING


- P5) 24" - CASTING HEIGHT - 7"
- P4) 24" - GRADE RING - 3"
- P3) 48" - ECC CONE w/ 24" HOLE - 24"
- P2) 48" - MH RISER - 36"
- P1) 48" - MH BASE - 24"
- 1) JOINT WRAP - 12" WD x 048" MAC WRAP
- 1) 48" - MH INVERT CHANNEL - FULL HEIGHT
- 1) CASTING - HOE MC-375 F/C Sanitary
- 2) 48" - Conseal CS-102 1.00" (Double)
- 2) A-Lok - 0285
- 6) MH Step ML-10-TDS-NCR - 10"

0 lb	Structure Notes:
202 lb	1. PER ASTM C478 SPECIFICATIONS.
1550 lb	2. CONCRETE = 4,000 PSI AT 28 DAYS.
2515 lb	3. CASTING BY ICAST (HOE MC-375 F/C SANITARY).
2944 lb	
0 lb	REINFORCING PER ASTM A615 (GRADE 60).
1440 lb	- CONE (As .12)
271 lb	- RISER/WALLS (As .12)
0 lb	- FLOOR (As .31) #5 BARS AT 12" C.C.E.W.
2 lb	
0 lb	


Structure Total:	8924 lb

NOTES:


1. GRADE RINGS MEET OR EXCEED THE FOLLOWING SPECIFICATIONS:
 -CONCRETE: 4,000 PSI @ 28 DAYS.
 -REINFORCING: (1) #3 HOOP CENTERED (GRADE 60)

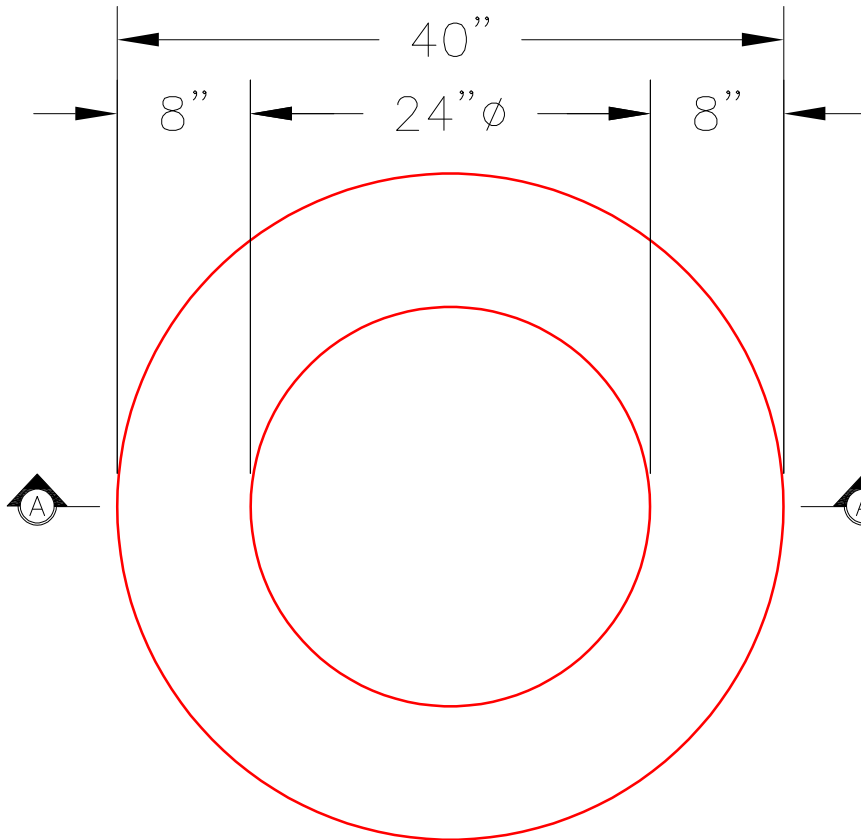

PLAN VIEW

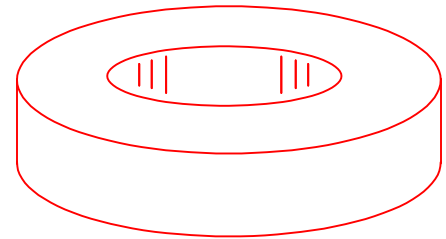

ISOMETRIC VIEW

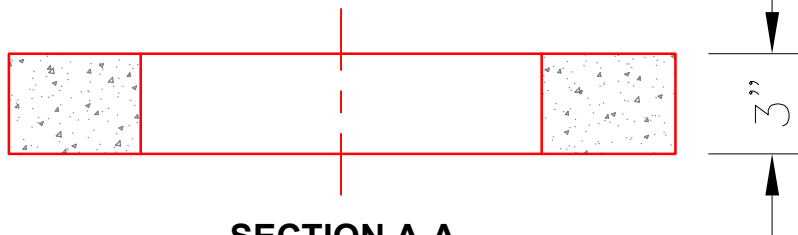

SECTION A-A

Coating (Int):
 Coating (Ext):

Seam Up: Flat
 Seam Dn: Flat

Wall Thickness: 8"

Height (Ext): 3"

Weight (Net): 202 lb
 Volume (Net): 0.05cu.yd