

Contractor: Eaton Asphalt

TECH: Jared - A

Plant: 100




Slack: 0.24"

1. HOE MC-375-WT F/C SANITARY PROVIDED BY ICAST.
2. PER ASTM C478 SPECIFICATIONS.
3. CONCRETE = 4,000 PSI AT 28 DAYS.
4. REINFORCING PER ASTM A615 (GRADE 60).
 - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W.
 - RISER/WALLS (As .18)
 - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.


P3) 24" - CASTING HEIGHT - 7"
P2) 48" - CON CONE w/24" HOLE - 36"
P1) 48" - MH BASE Custom Ht - 58"
1) 48" - MH INVERT CHANNEL - FULL HEIGHT
1) CASTING - HOE MC-375 F/C Sanitary
1) 48" - Con seal CS-102 1.00" (Double)
2) PSX - 16L NYLO
7) MH Step ML-10-TDS-NCR - 10"

0 lb
2252 lb
5211 lb
1440 lb
271 lb
0 lb
16 lb
0 lb


Structure Total: 9190 lb

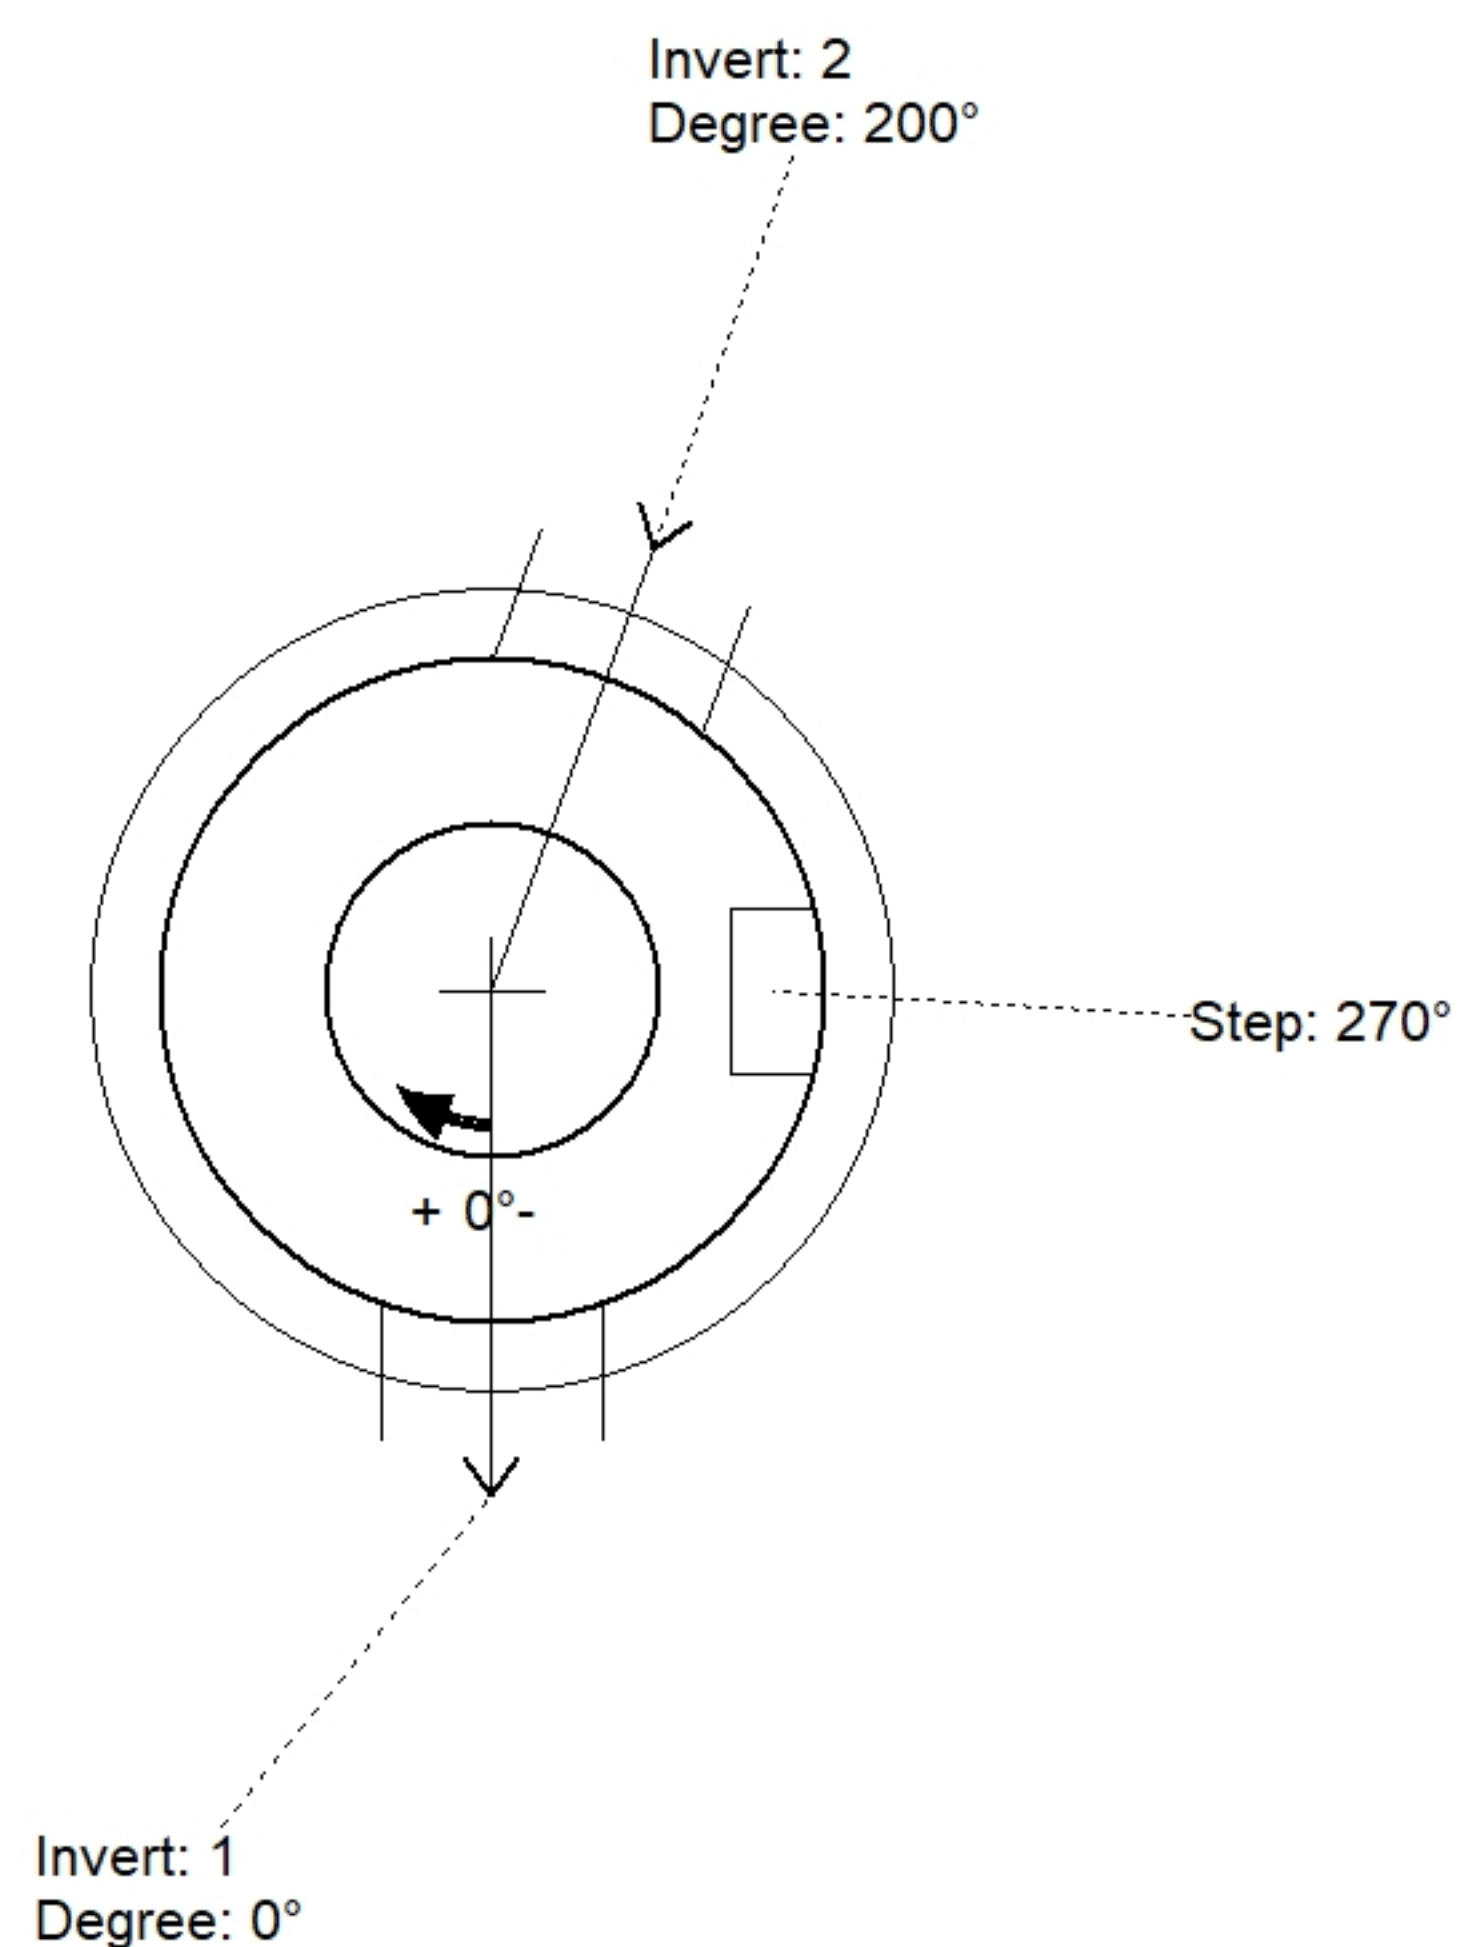

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (⌵)	Ref
Rim	784.38'							
Reducer								
Invert 1	776.11'	0°	12" PVC SDR35	12.5"	16"	PSX 16L NYLO	0"	P1
Invert 2	776.21'	200°	12" PVC SDR35	12.5"	16"	PSX 16L NYLO	1.2"	P1
Invert 3								
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

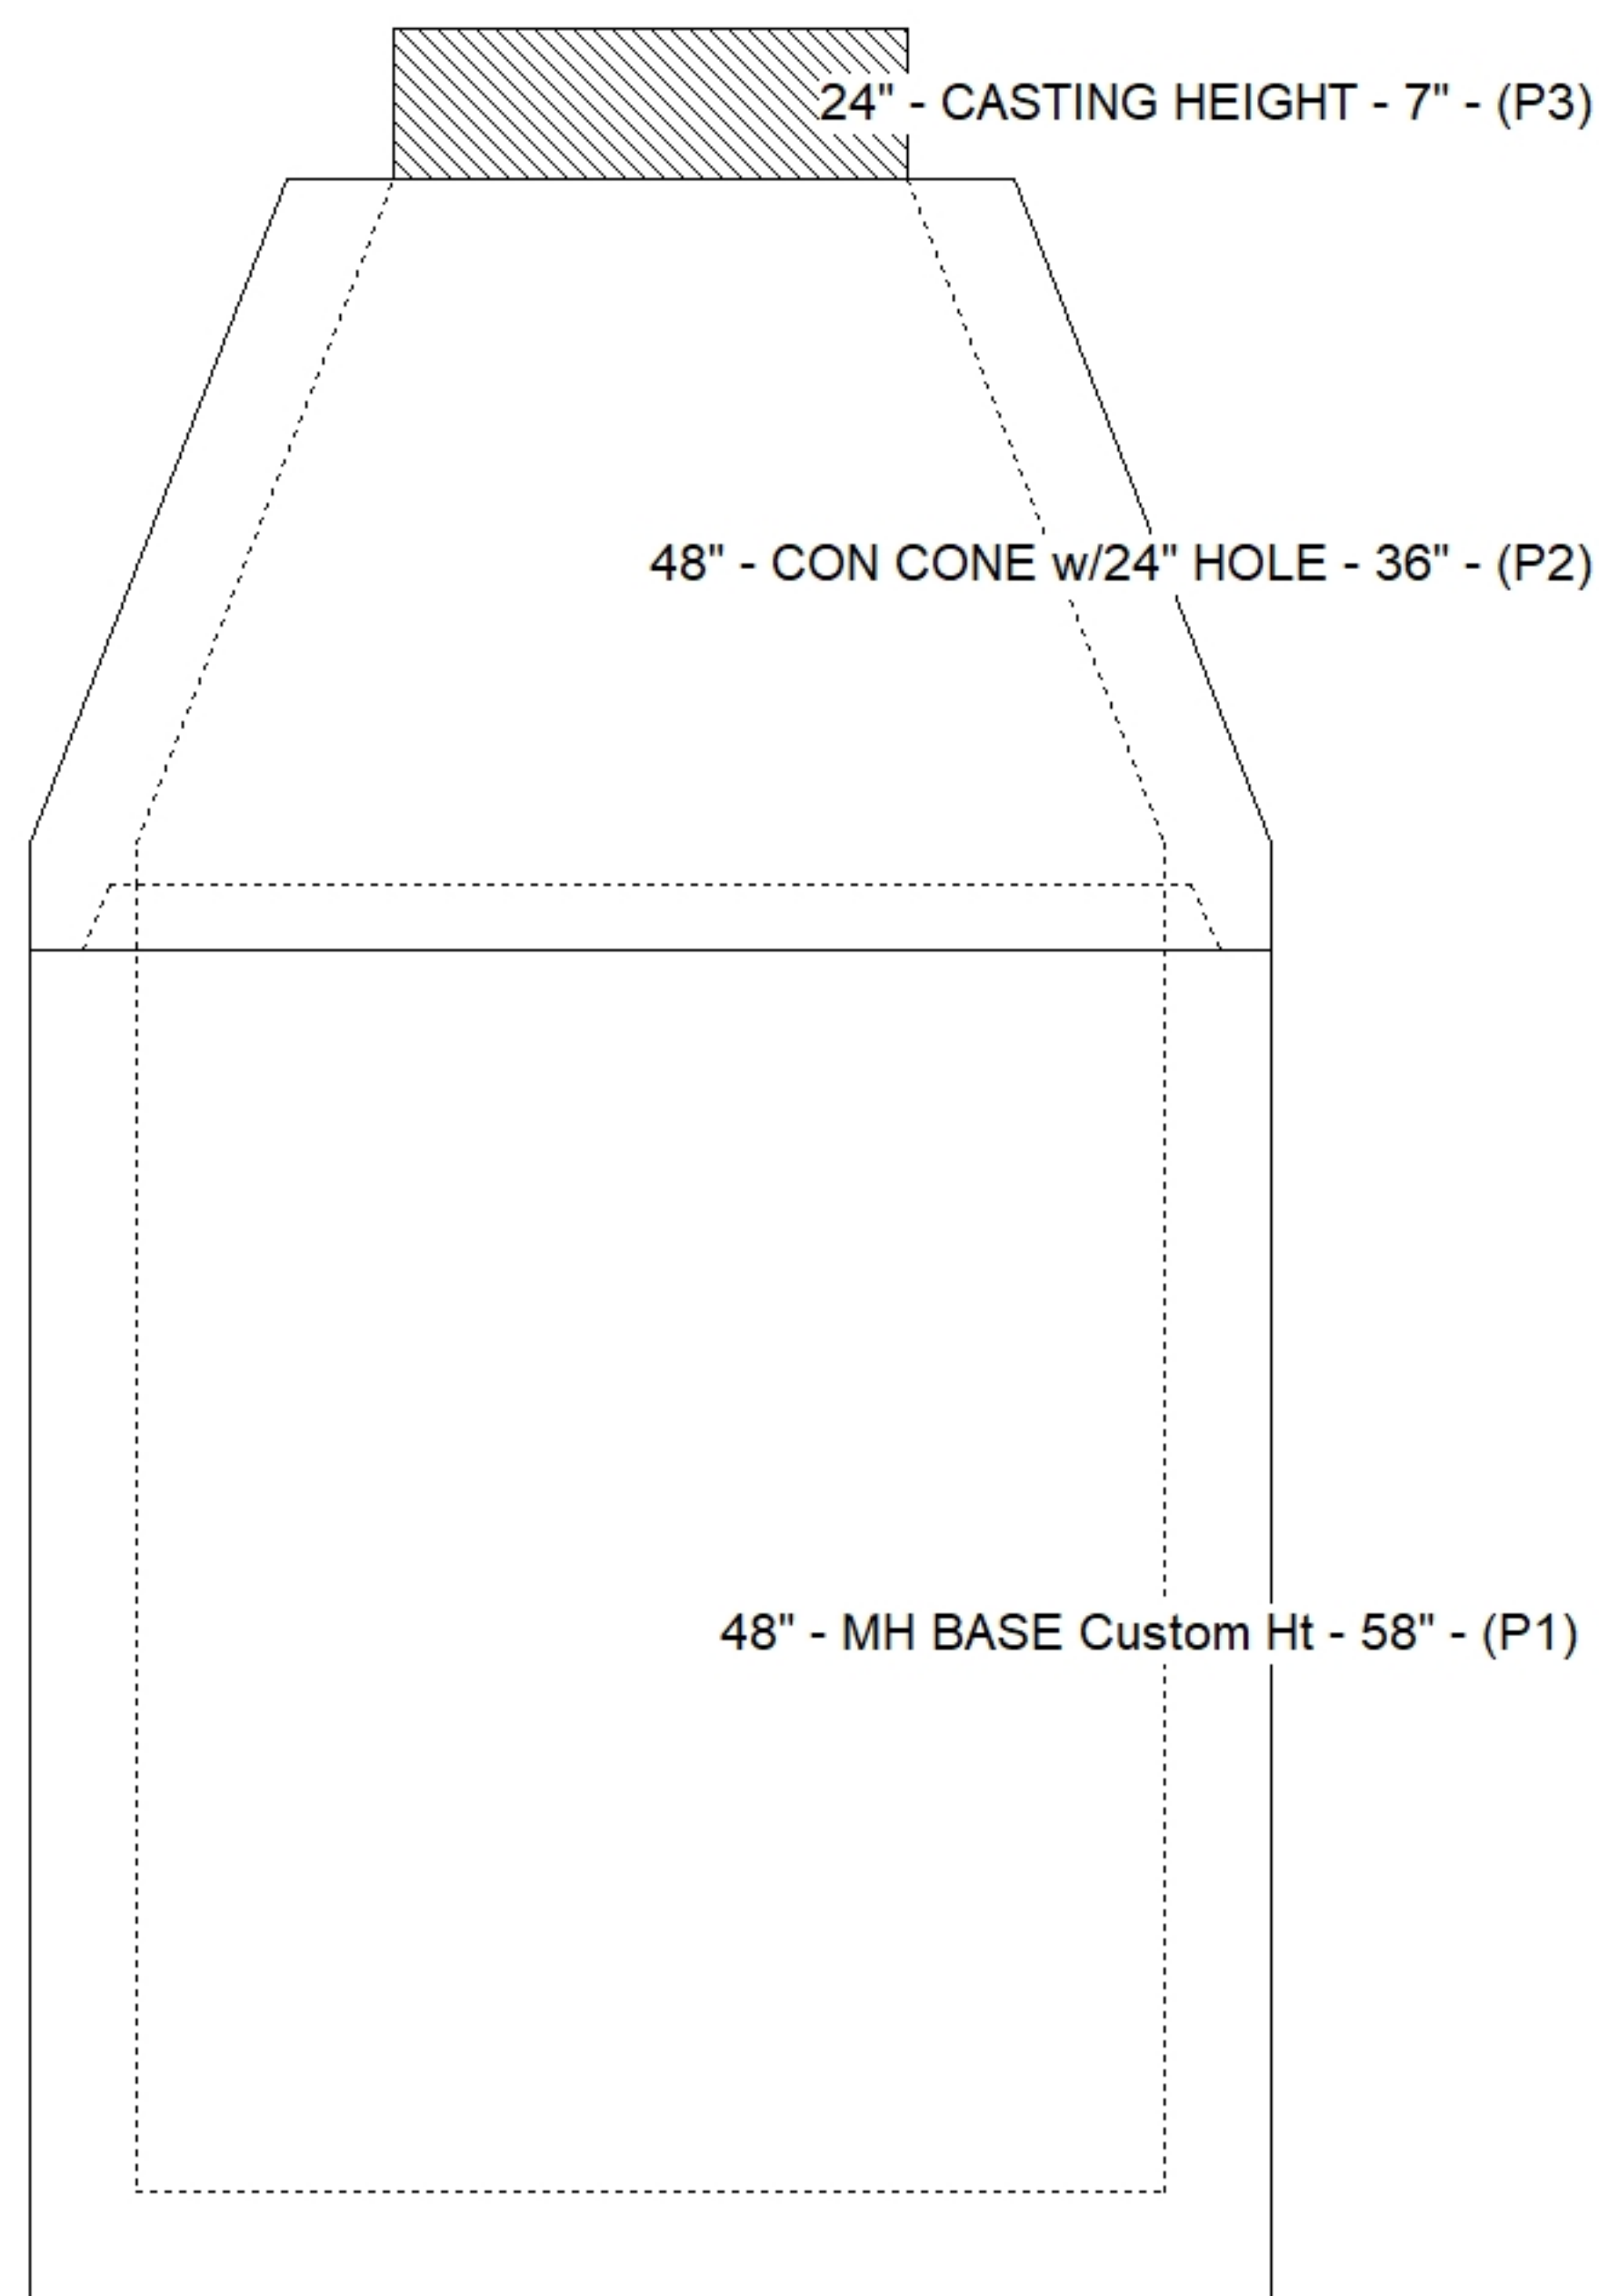

Default - Interior Dimensions

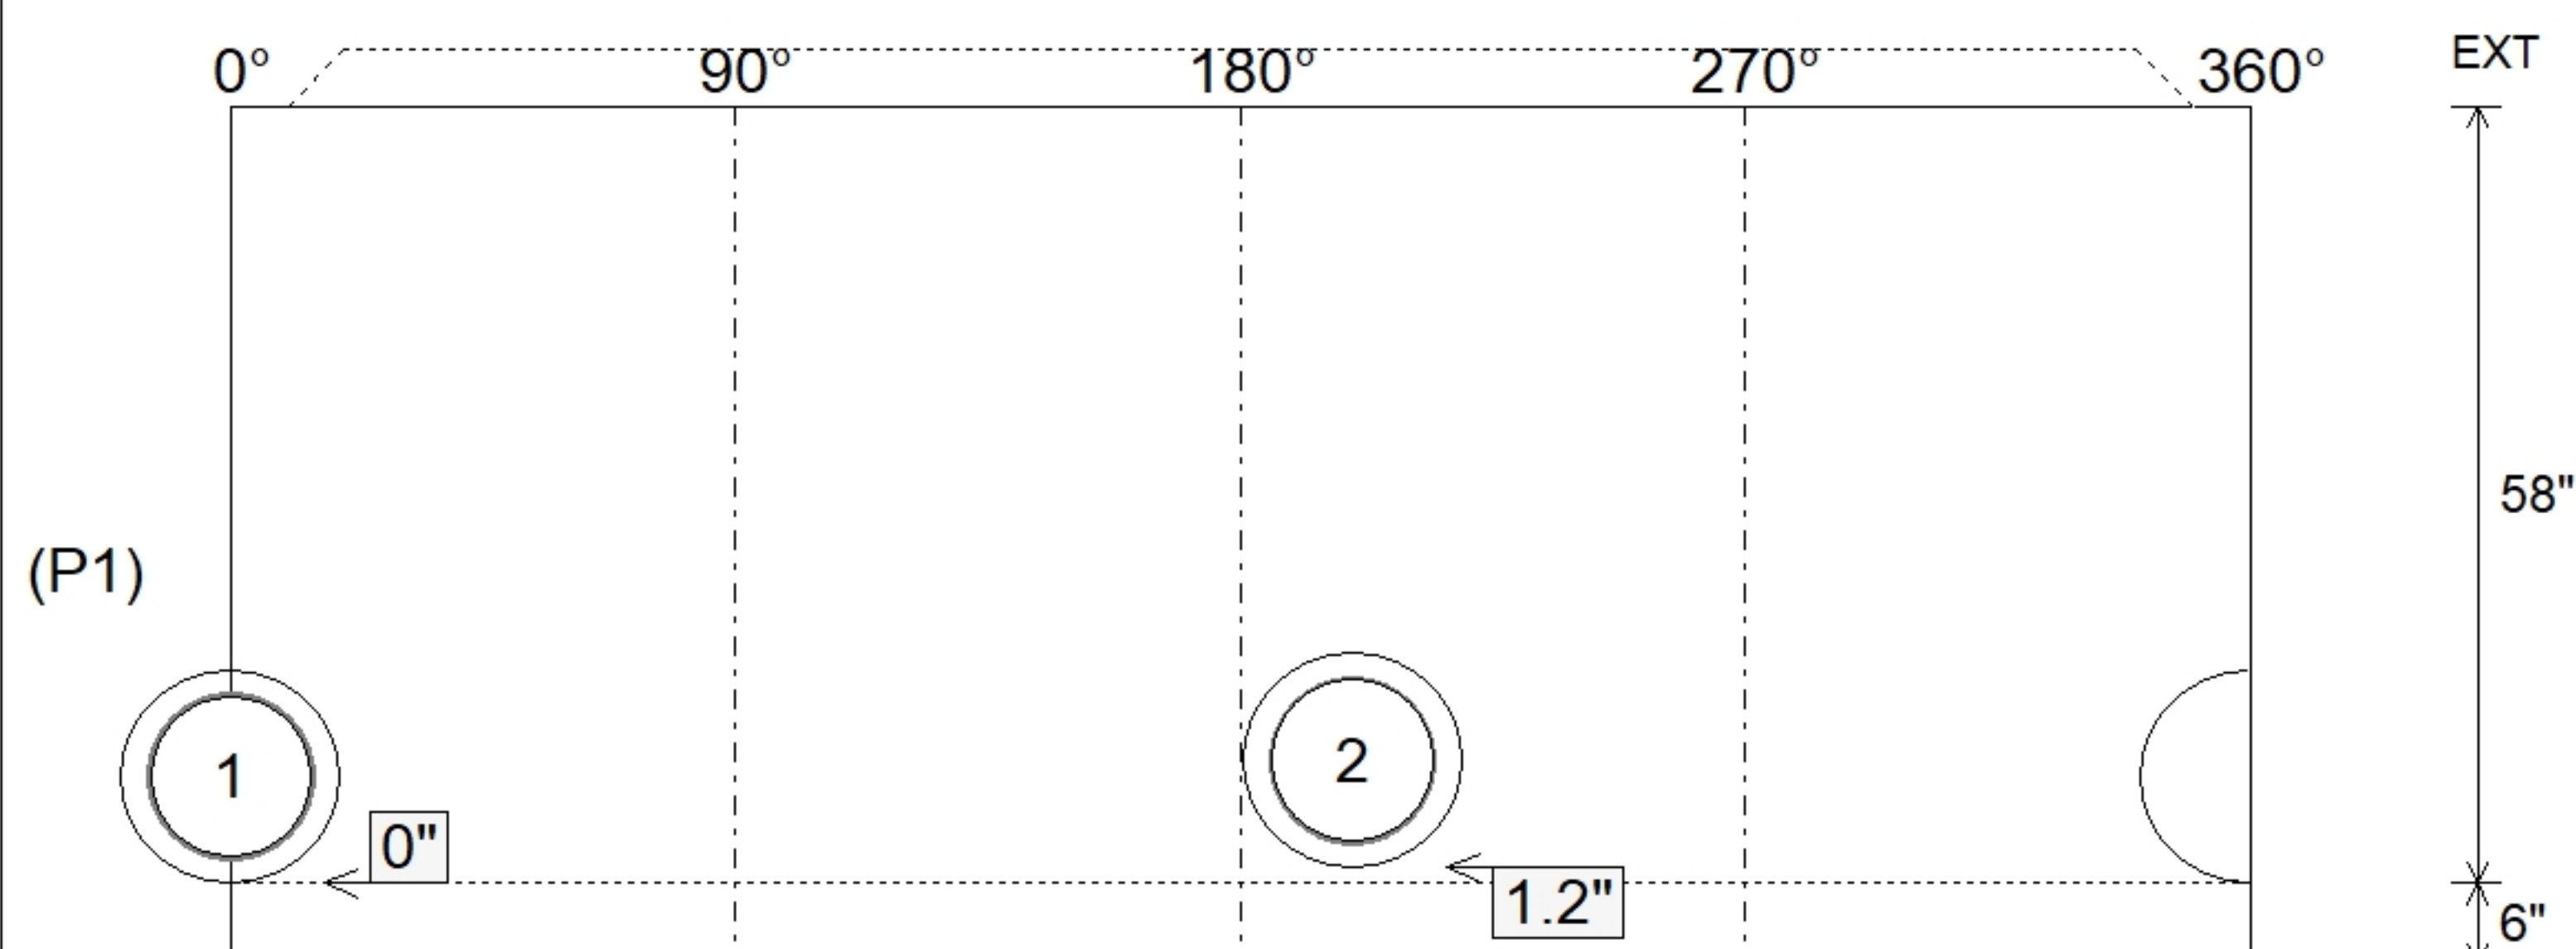

Submittal Drawing
7/10/2026 11:54:12 AM

SUBMITTAL
APPROVED BY: