

Contractor: Eaton Asphalt

TECH: Jared - A

Plant: 100




Slack: 0.04"

1. HOE KY-230-S F/G (SAG) PROVIDED BY ICAST.
2. KYTC DBI TYPE 13S / ASTM C-913 SPEC'S.
3. CONCRETE = 4,000 PSI AT 28 DAYS.
4. REINFORCING PER ASTM A615 (GRADE 60).
 - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W. (DBL MAT).
 - WALLS (As .31) #5 BARS AT 12" C.C.E.W..
 - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.
5. STUB #5 BARS 12" OUT OF THE TOP OF THE SLAB (SPACED AT 12" CC) AROUND THE 15" X 59" HOLE

2) Hole - 4

Structure Total:	9118 lb
------------------	---------

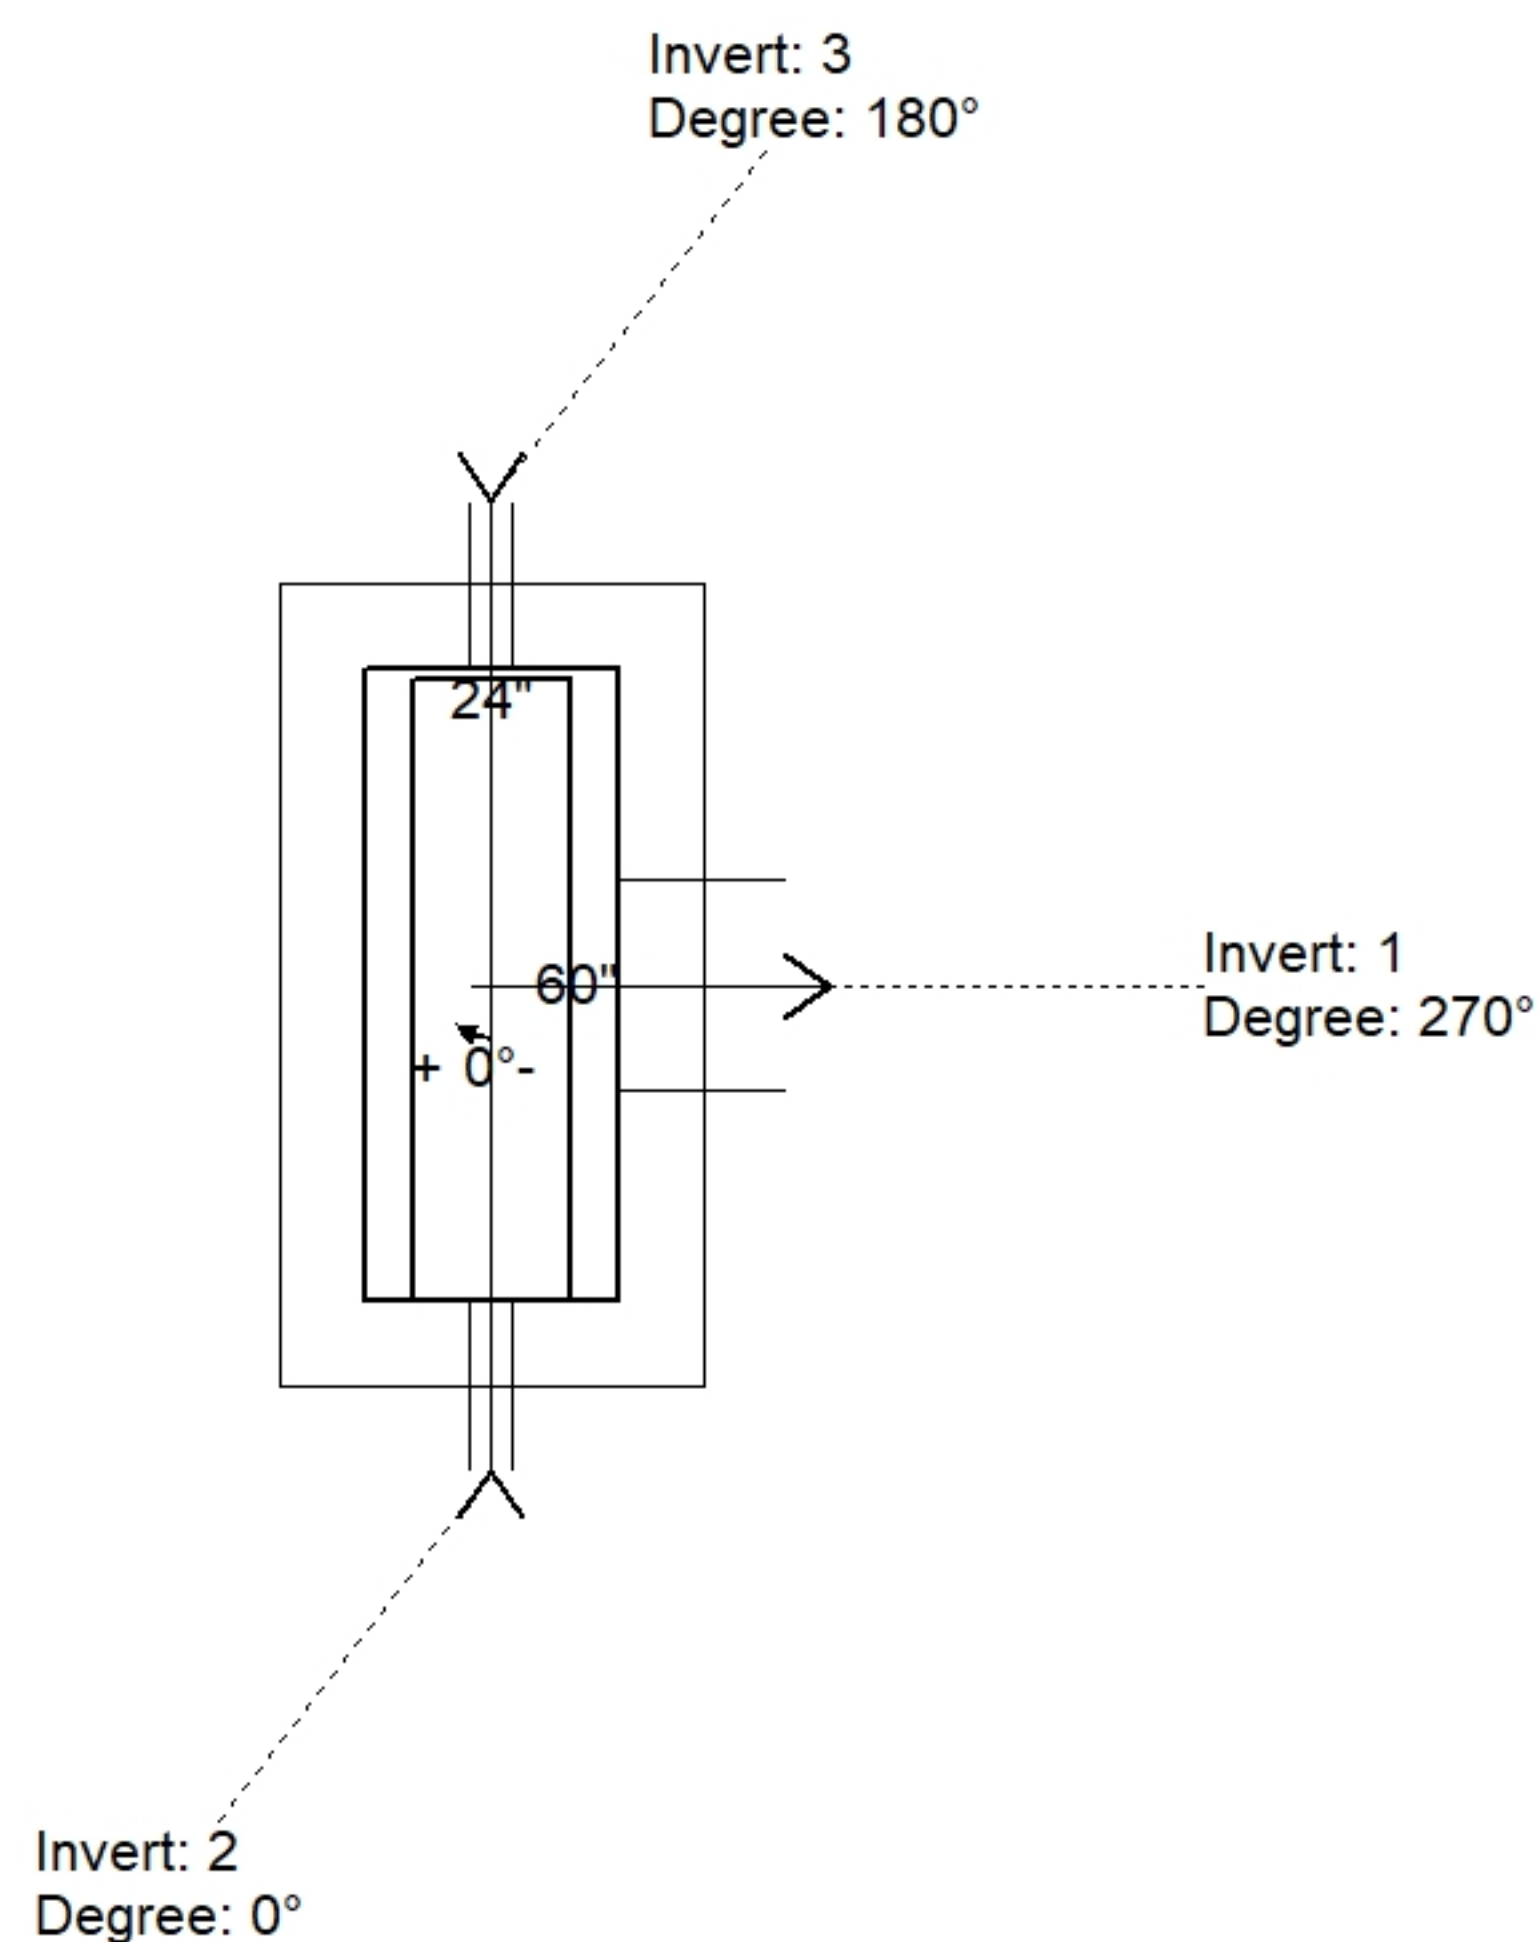

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (_)	Ref
Rim	891.28'							
Reducer								
Invert 1	886.61'	270°	15" ADS N-12	18"	20"	Hole 20	-2.5"	P1
Invert 2	888.28'	0°	4" WEEP HOLE	4"	4"	Hole 4	20.04"	P1
Invert 3	888.28'	180°	4" WEEP HOLE	4"	4"	Hole 4	20.04"	P1
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

SUBMITTAL
APPROVED BY: