

Contractor: Eaton Asphalt

TECH: Jared - A


Plant: 100




Slack: 0.68"

1. HOE KY-230-G F/G (GRADE) PROVIDED BY ICAST.
2. KYTC DBI TYPE 13G / ASTM C-913 SPEC'S.
3. CONCRETE = 4,000 PSI AT 28 DAYS.
4. REINFORCING PER ASTM A615 (GRADE 60).
 - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W.
 - WALLS (As .31) #5 BARS AT 12" C.C.E.W..
 - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.
5. STUB #5 BARS 12" OUT OF THE TOP OF THE SLAB (SPACED AT 12" CC) AROUND THE 15" X 27" HOLE


Structure Total: 7285 lb

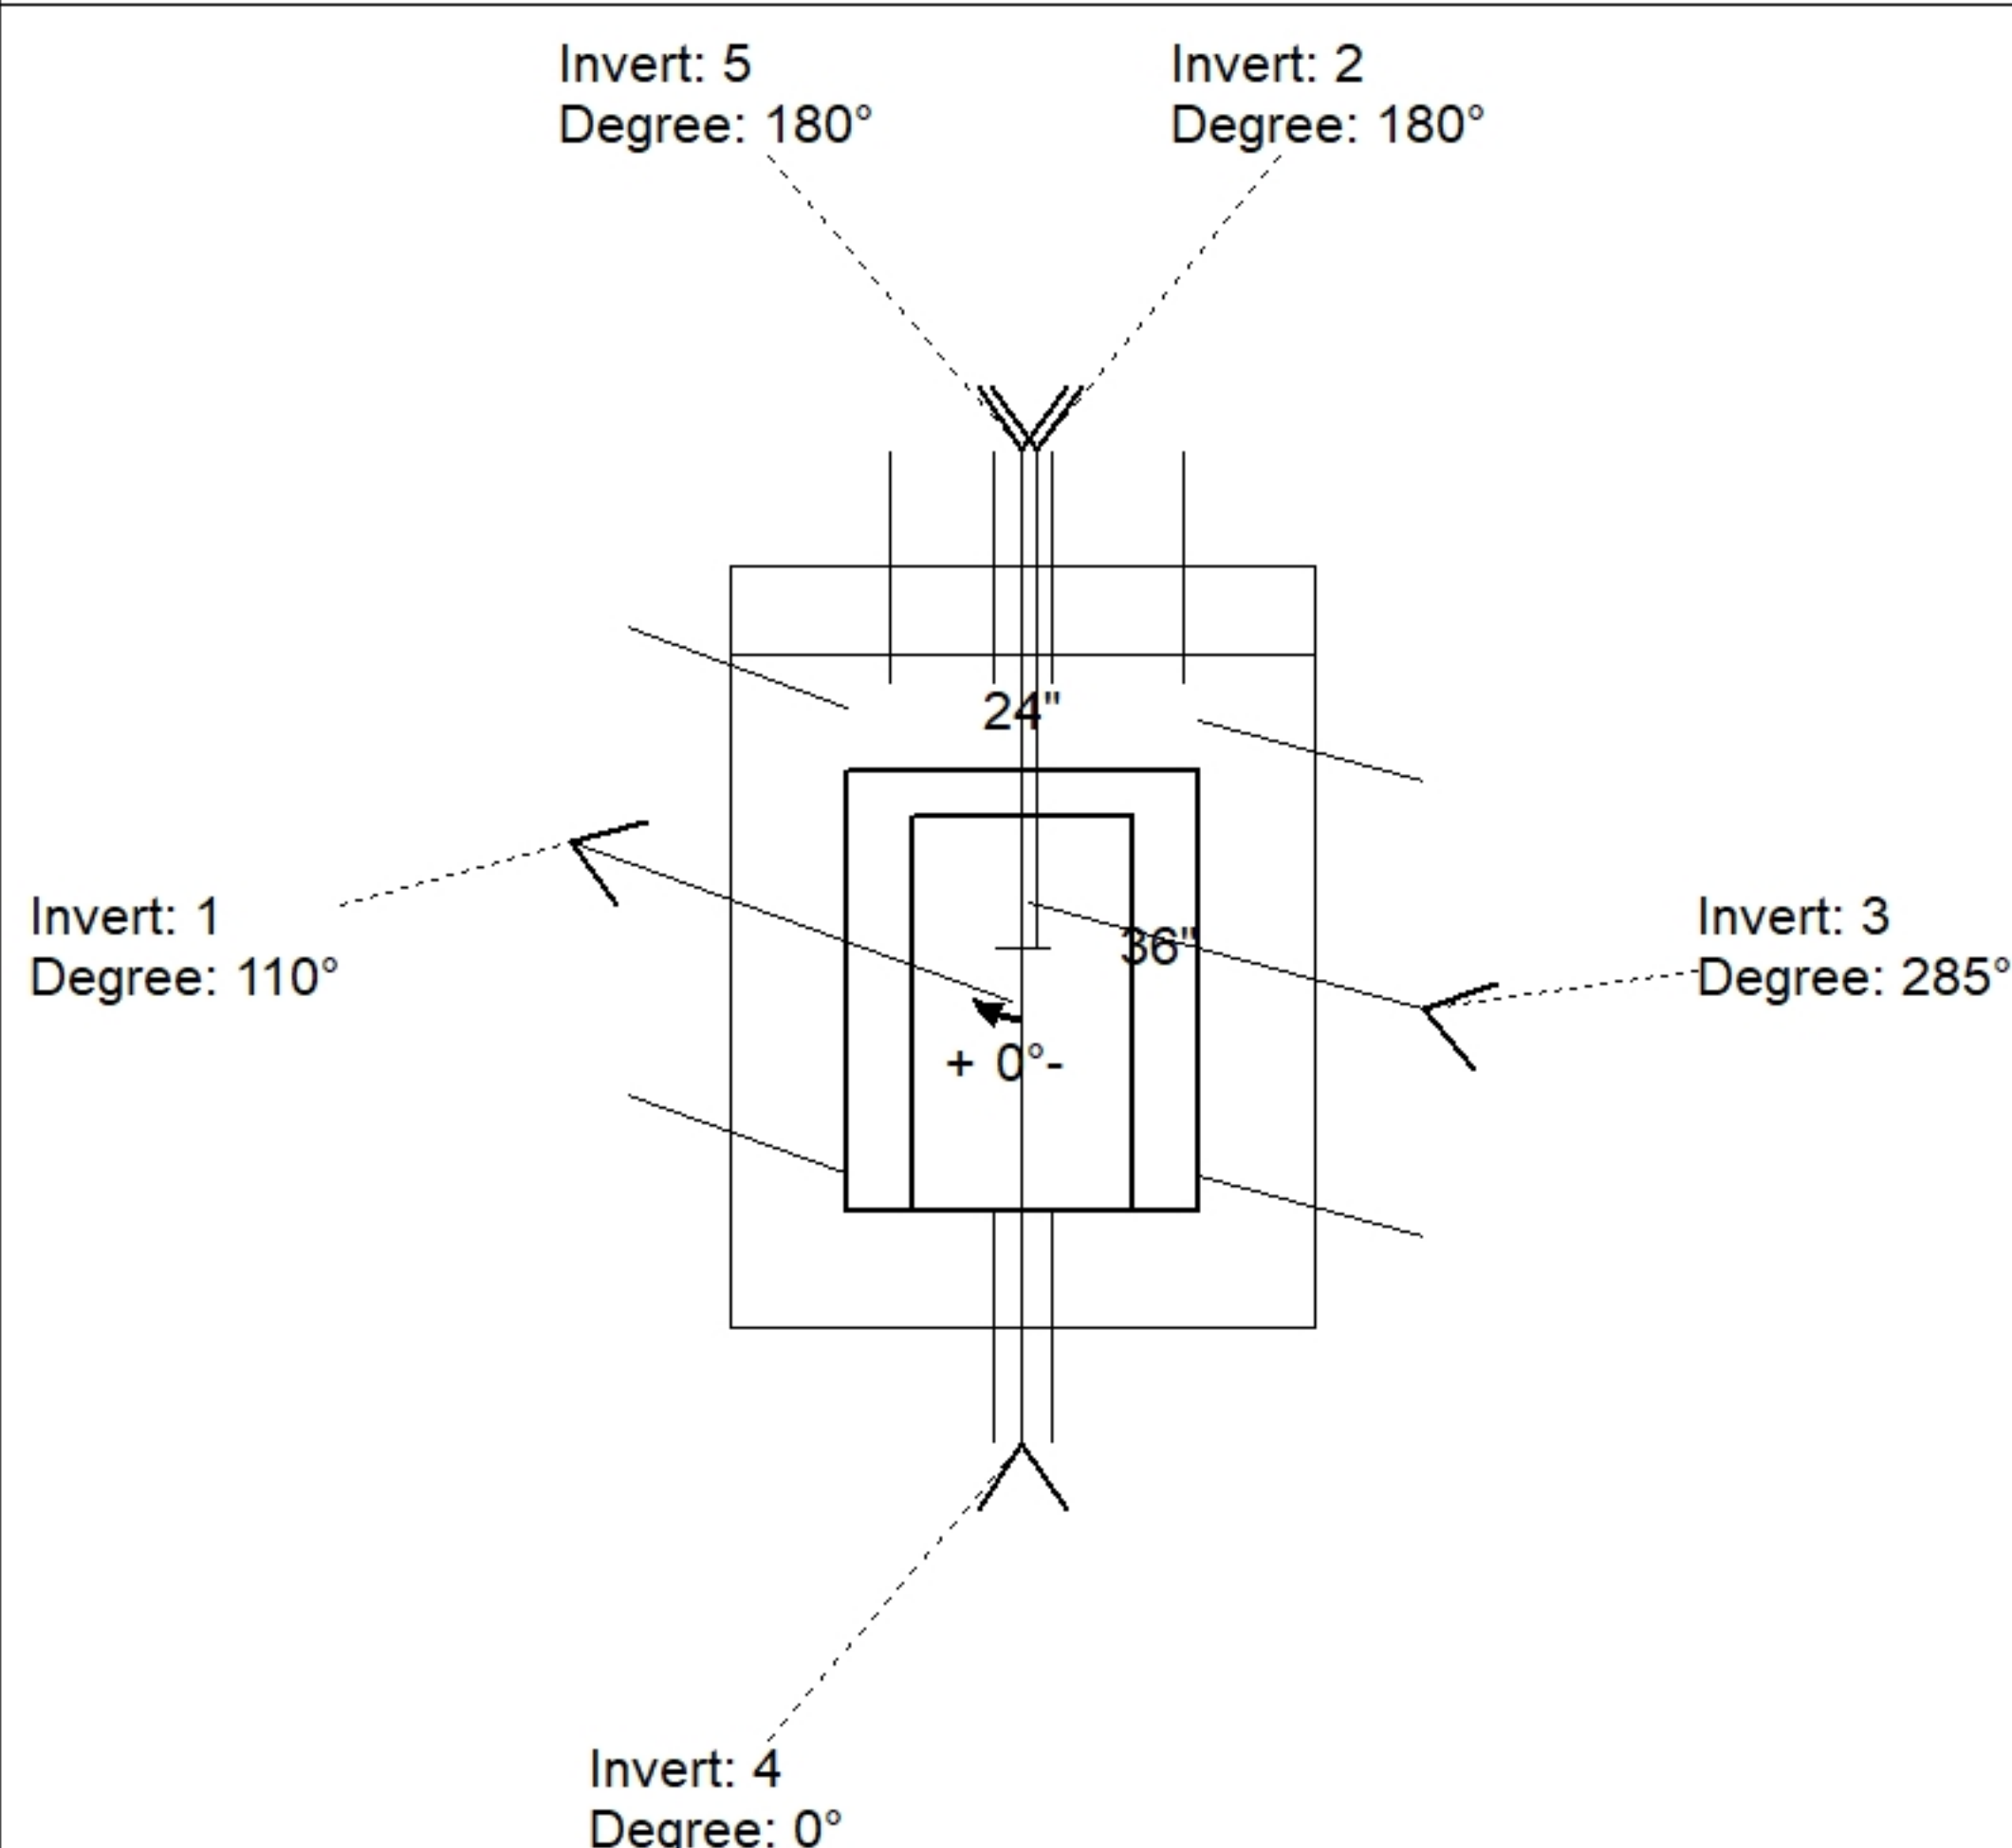

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (')_	Ref
Rim	893.69'							
Reducer	891.633'							
Invert 1	887.55'	110°	24" ADS N-12	28"	30"	Hole 30	-3"	P1
Invert 2	887.55'	180°	15" ADS N-12	18"	20"	Hole 20	-2.5"	P1
Invert 3	887.55'	285°	24" ADS N-12	28"	30"	Hole 30	-3"	P1
Invert 4	890.69'	0°	4" WEEP HOLE	4"	4"	Hole 4	37.68"	P1
Invert 5	890.69'	180°	4" WEEP HOLE	4"	4"	Hole 4	37.68"	P1
Invert 6								
Invert 7								
Invert 8								

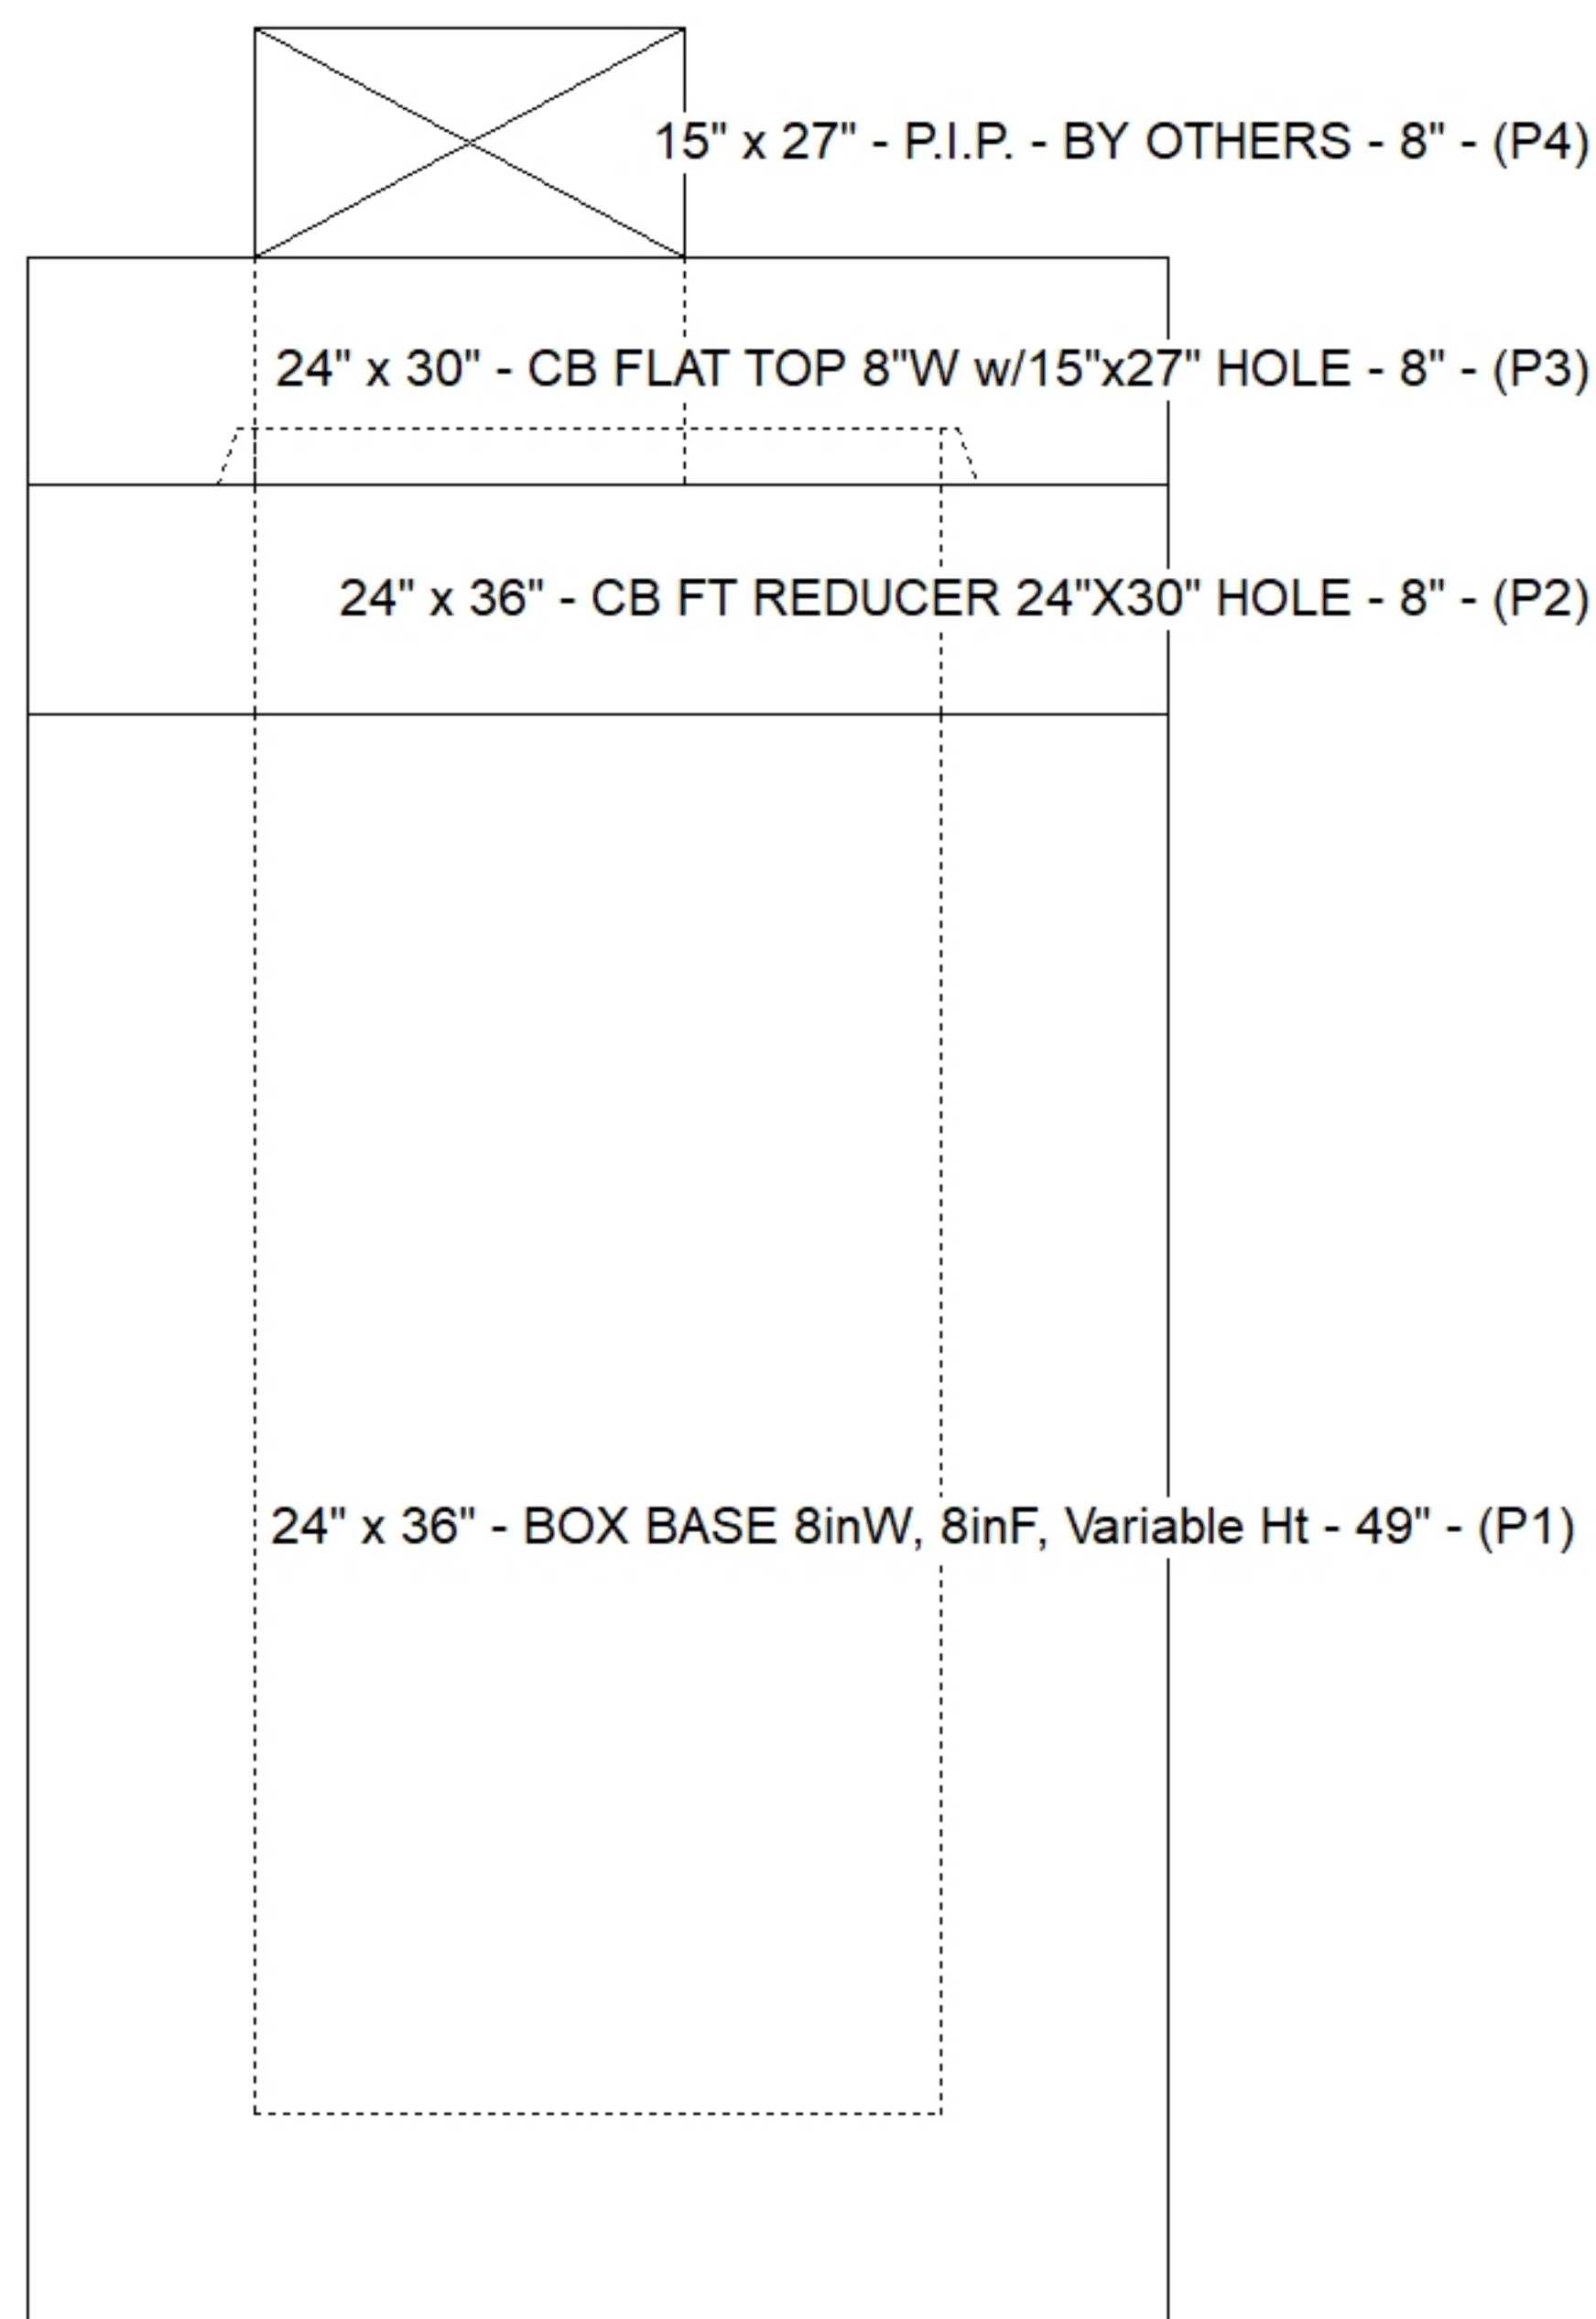

Default - Interior Dimensions

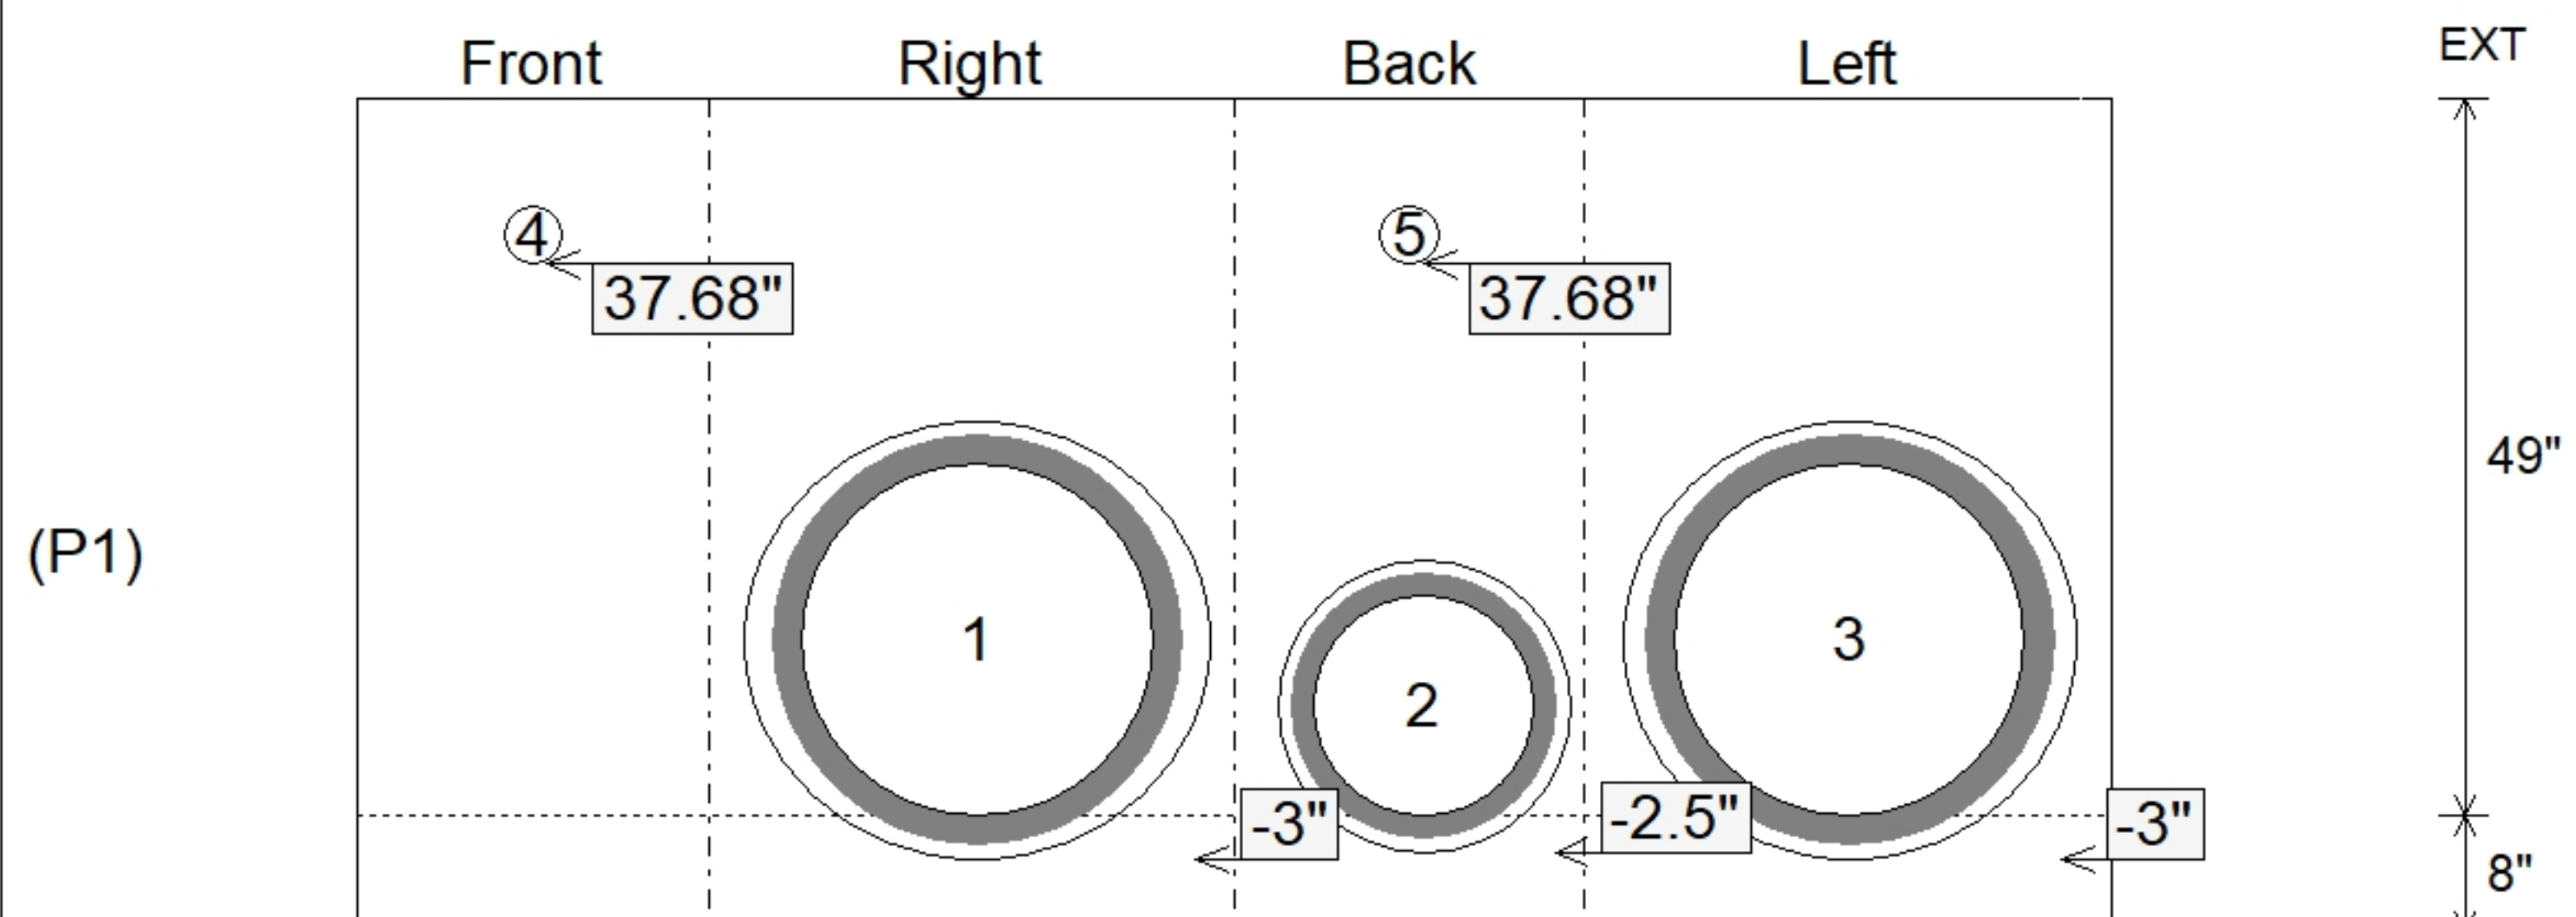

SUBMITTAL
APPROVED BY: