

Contractor: Phillips Brothers

TECH: J. Horsley - F

Plant: 100



Slack: 0.56"


REINFORCING PER ASTM A615 (GRADE 60).

- TOP SLAB (As .12) #5 BARS AT 6" C.C.E.W..
- WALLS (As .12) #5 BARS AT 6" C.C.E.W.
- FLOOR (As .12) #5 BARS AT 6" C.C.E.W.


P3) 30" x 48" - CASTING HEIGHT - 8"
P2) 36" x 48" - CB FLAT TOP 8"W w/30"x48" HOLE - 8"
P1) 36" x 48" - BOX BASE 8inW, 8inF - 30"
1) 36" x 48" - Conseal CS-102 1.00"
1) 30" x 48" - Conseal CS-102 1.00"
3) Hole - 26

0 lb
1267 lb
5077 lb
0 lb
0 lb
0 lb


Structure Total: 6344 lb

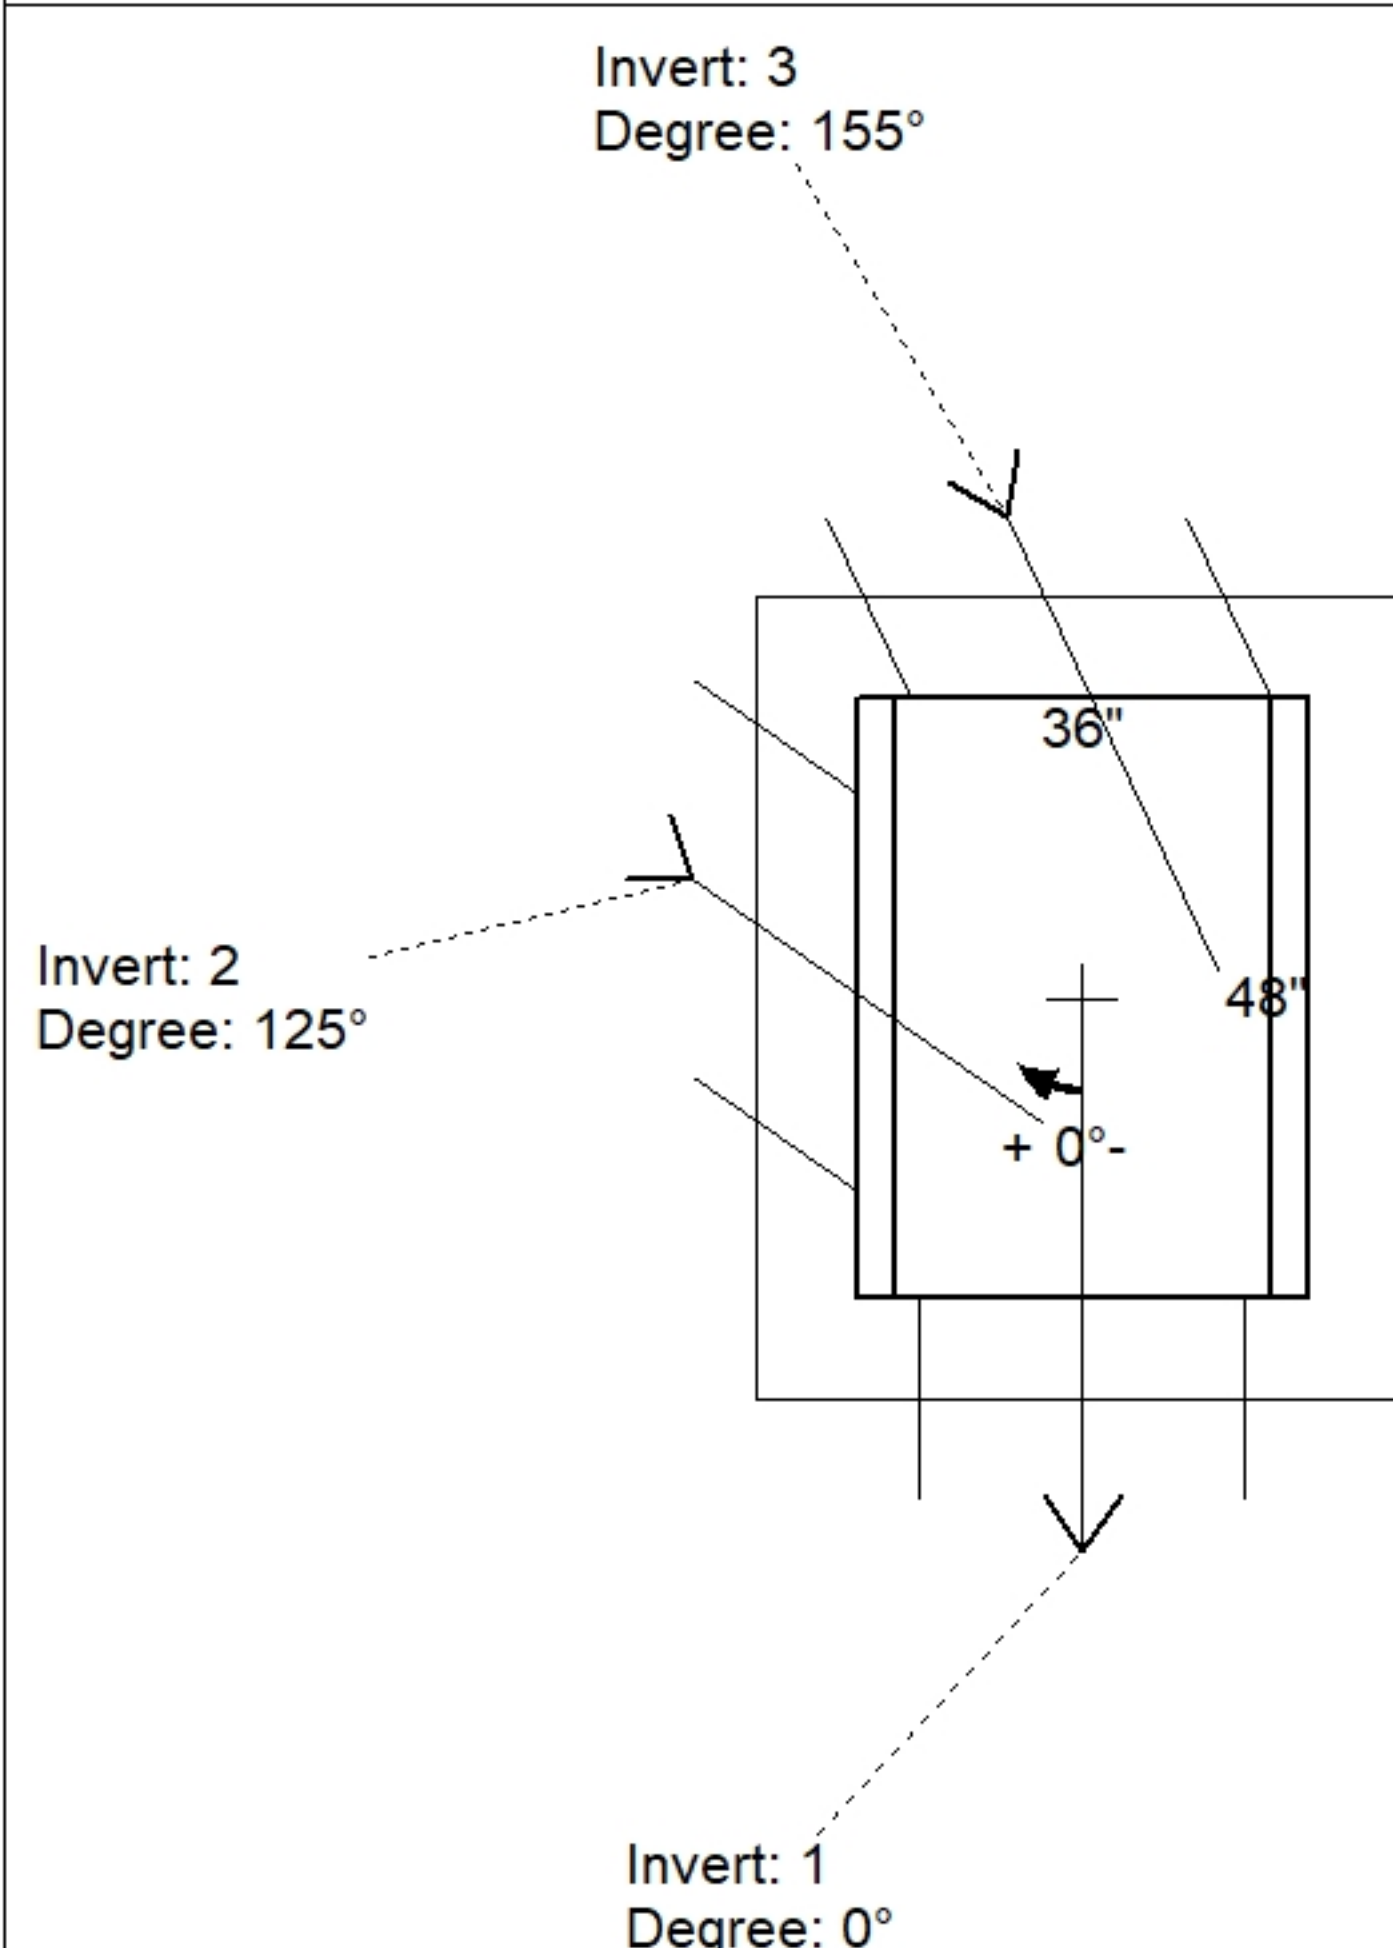

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (↓)	Ref
Rim	738.61'							
Reducer								
Invert 1	734.9'	0°	18" RCP B WALL	23"	26"	Hole 26	-0.46"	P1
Invert 2	734.9'	125°	18" RCP B WALL	23"	26"	Hole 26	-0.46"	P1
Invert 3	734.9'	155°	18" RCP B WALL	23"	26"	Hole 26	-0.46"	P1
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

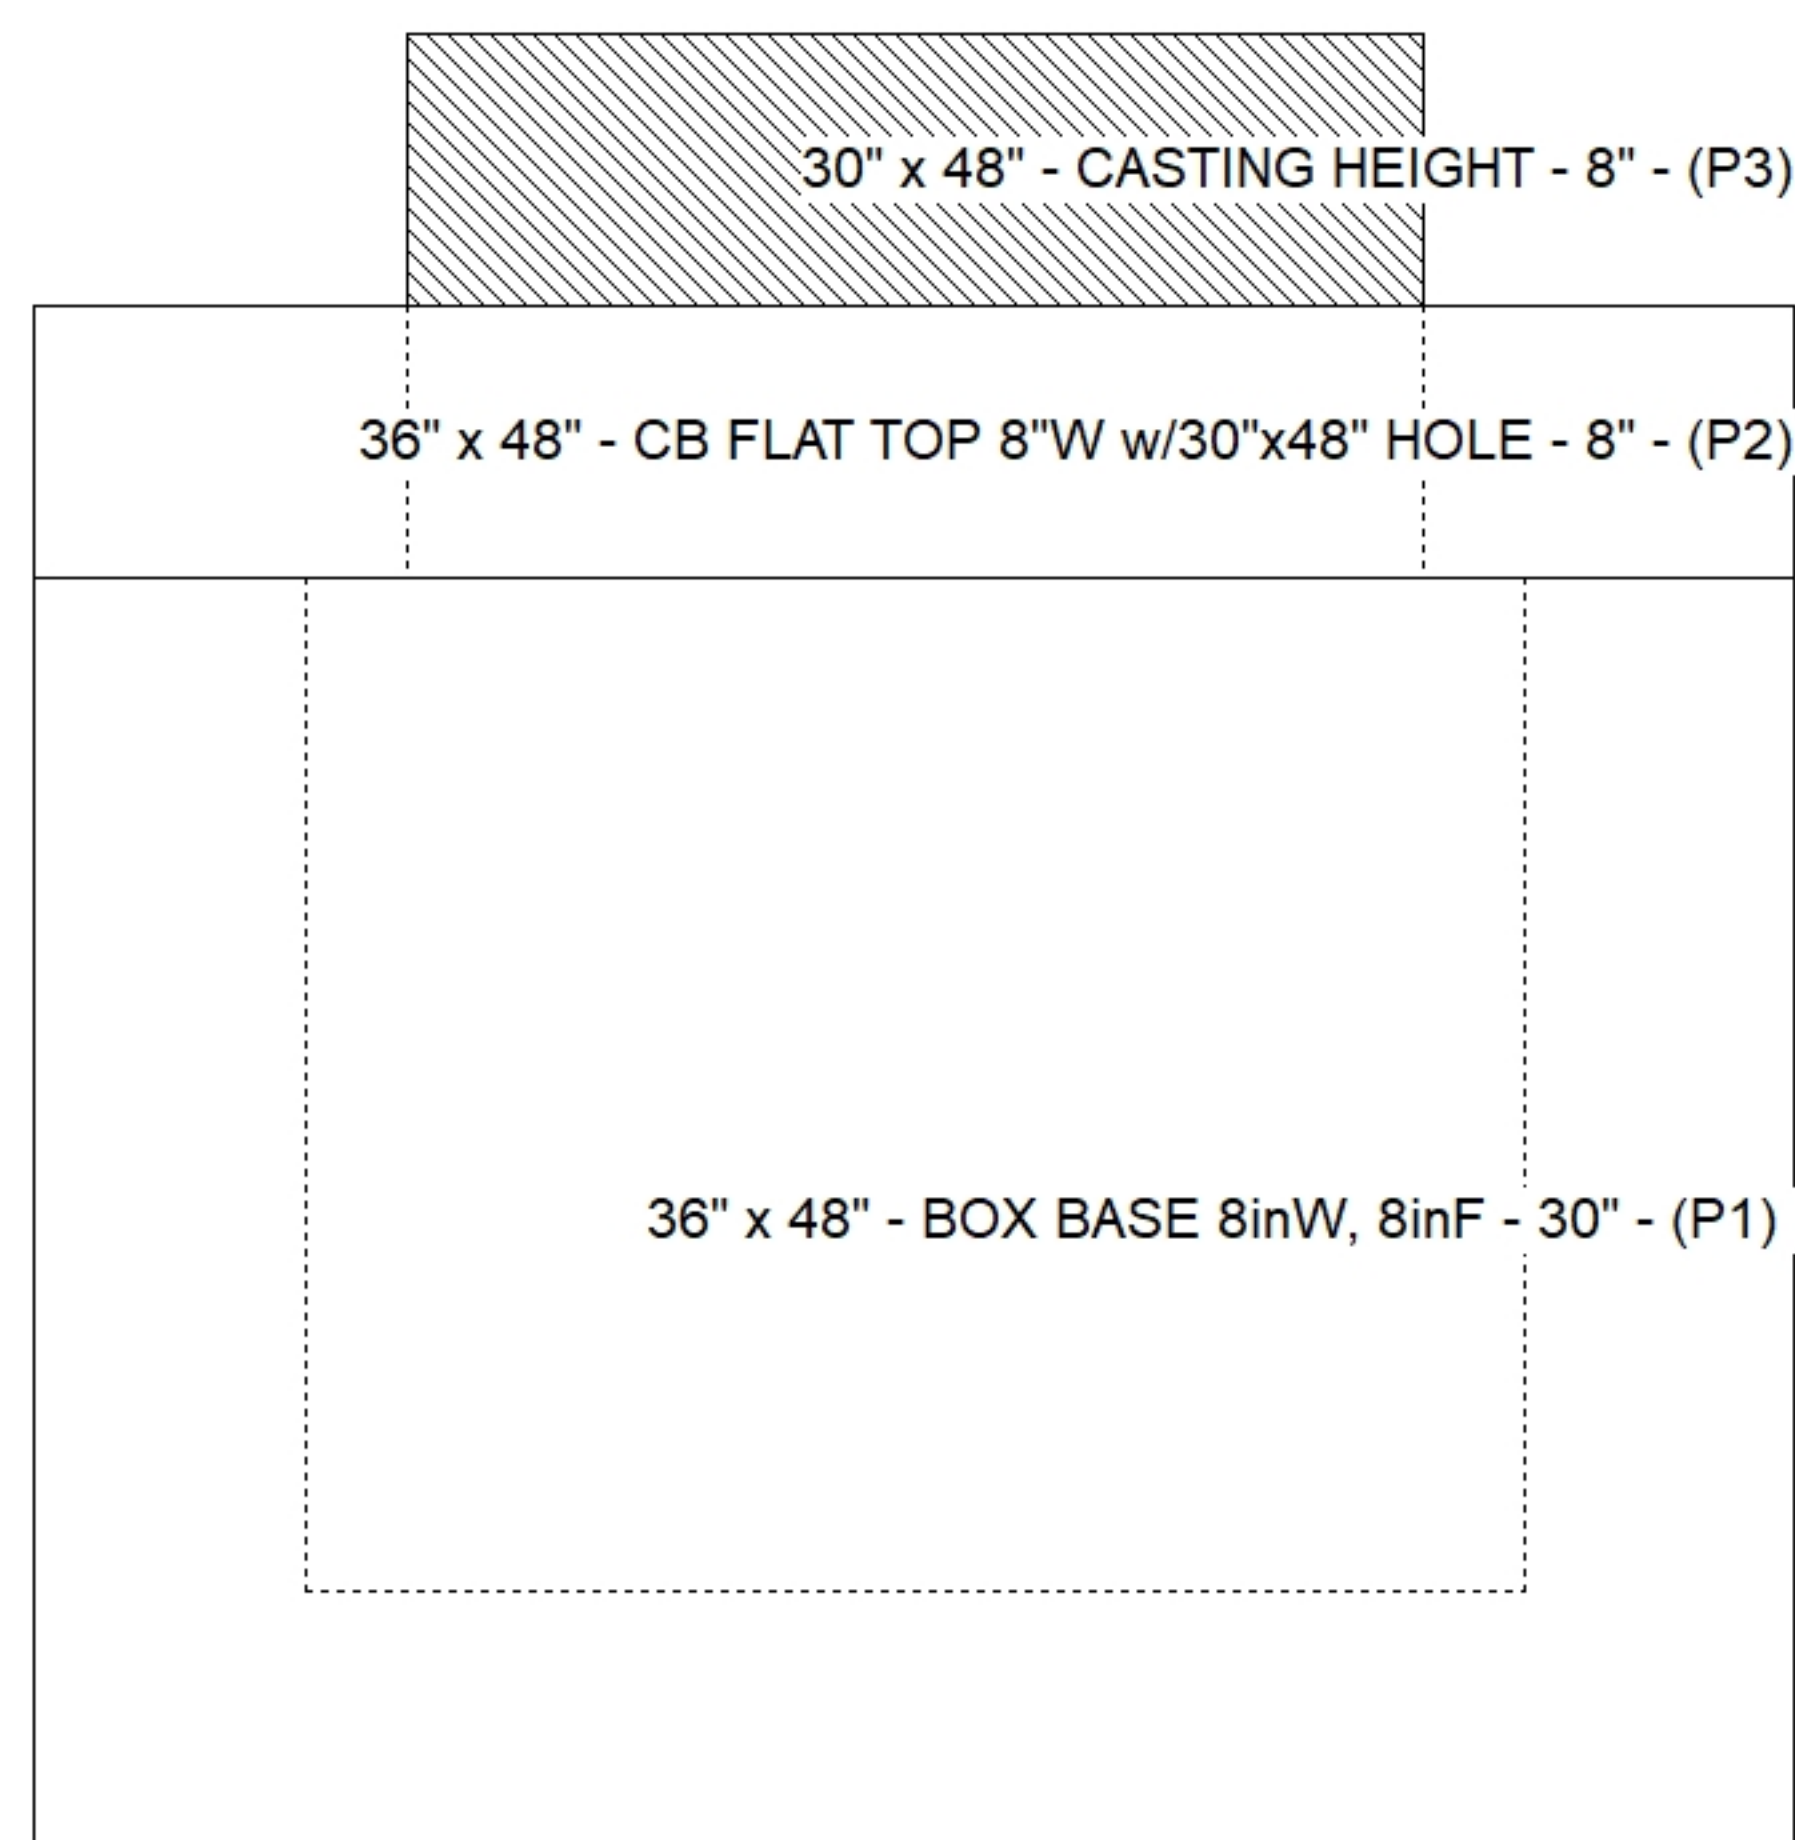

Default - Interior Dimensions

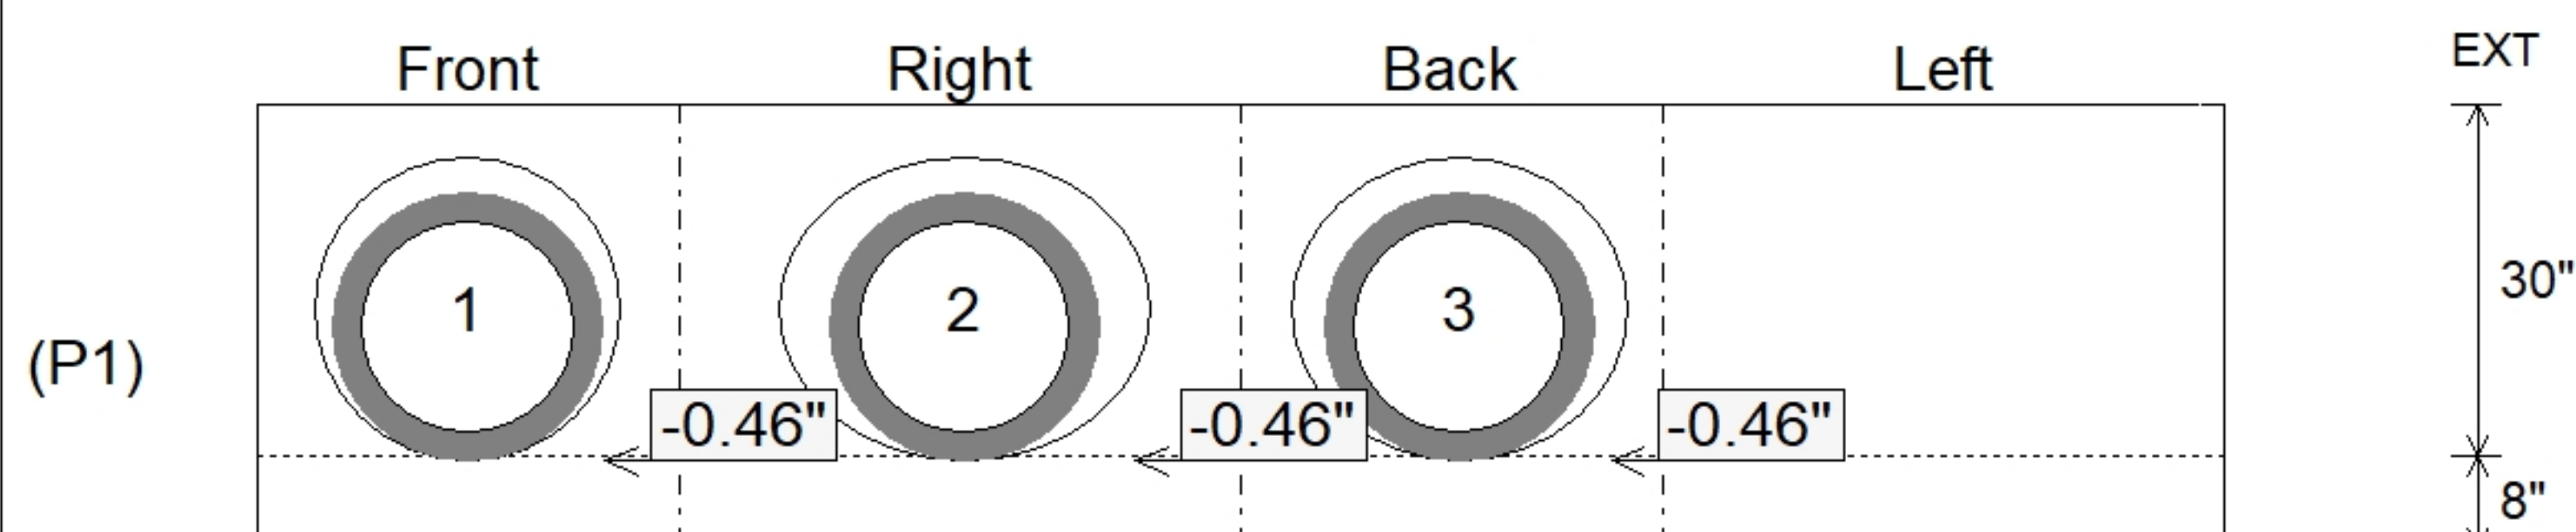

Submittal Drawing
5/11/2026 8:23:35 AM

SUBMITTAL
APPROVED BY: