

Job Name: 25-3462 - Corvette Museum Material Job Location: Bowling Green, KY Contractor: National Corvette Museum c/o Scotty's Contracting	Plant: 100	Tech: J. Horsley - F	
	12/8/2025 3:15:56 PM	PC: C. Goff	

Structure ID: DI-6


P3 GR24x24x8x3

GRADE RING F/F

P4) 24" x 24" - CASTING HEIGHT - 2"	0 lb
P3) 24" x 24" - GRADE RING F/F - 3"	258 lb
P2) 48" - MH FLAT TOP w/24"x24" Hole F/G - 12"	1500 lb
P1) 48" - MH BASE T/n - 36"	3482 lb
1) CASTING - JBS 4190-L F/G	335 lb
1) 48" - Conseal CS-102 1.00"	0 lb
2) 24" x 24" - Conseal CS-102 1.00"	0 lb
2) Hole - 26	0 lb
Structure Total:	5574 lb

Structure Notes:
 1. PER ASTM C478 SPECIFICATIONS.
 2. CONCRETE = 4,000 PSI AT 28 DAYS.
 3. NO STEPS AND NO INVERT CHANNEL.
 4. CASTING BY I-CAST (JBS 4190-L F/G).

 REINFORCING PER ASTM A615 (GRADE 60).
 - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W..
 - RISER/WALLS (As .12)
 - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.

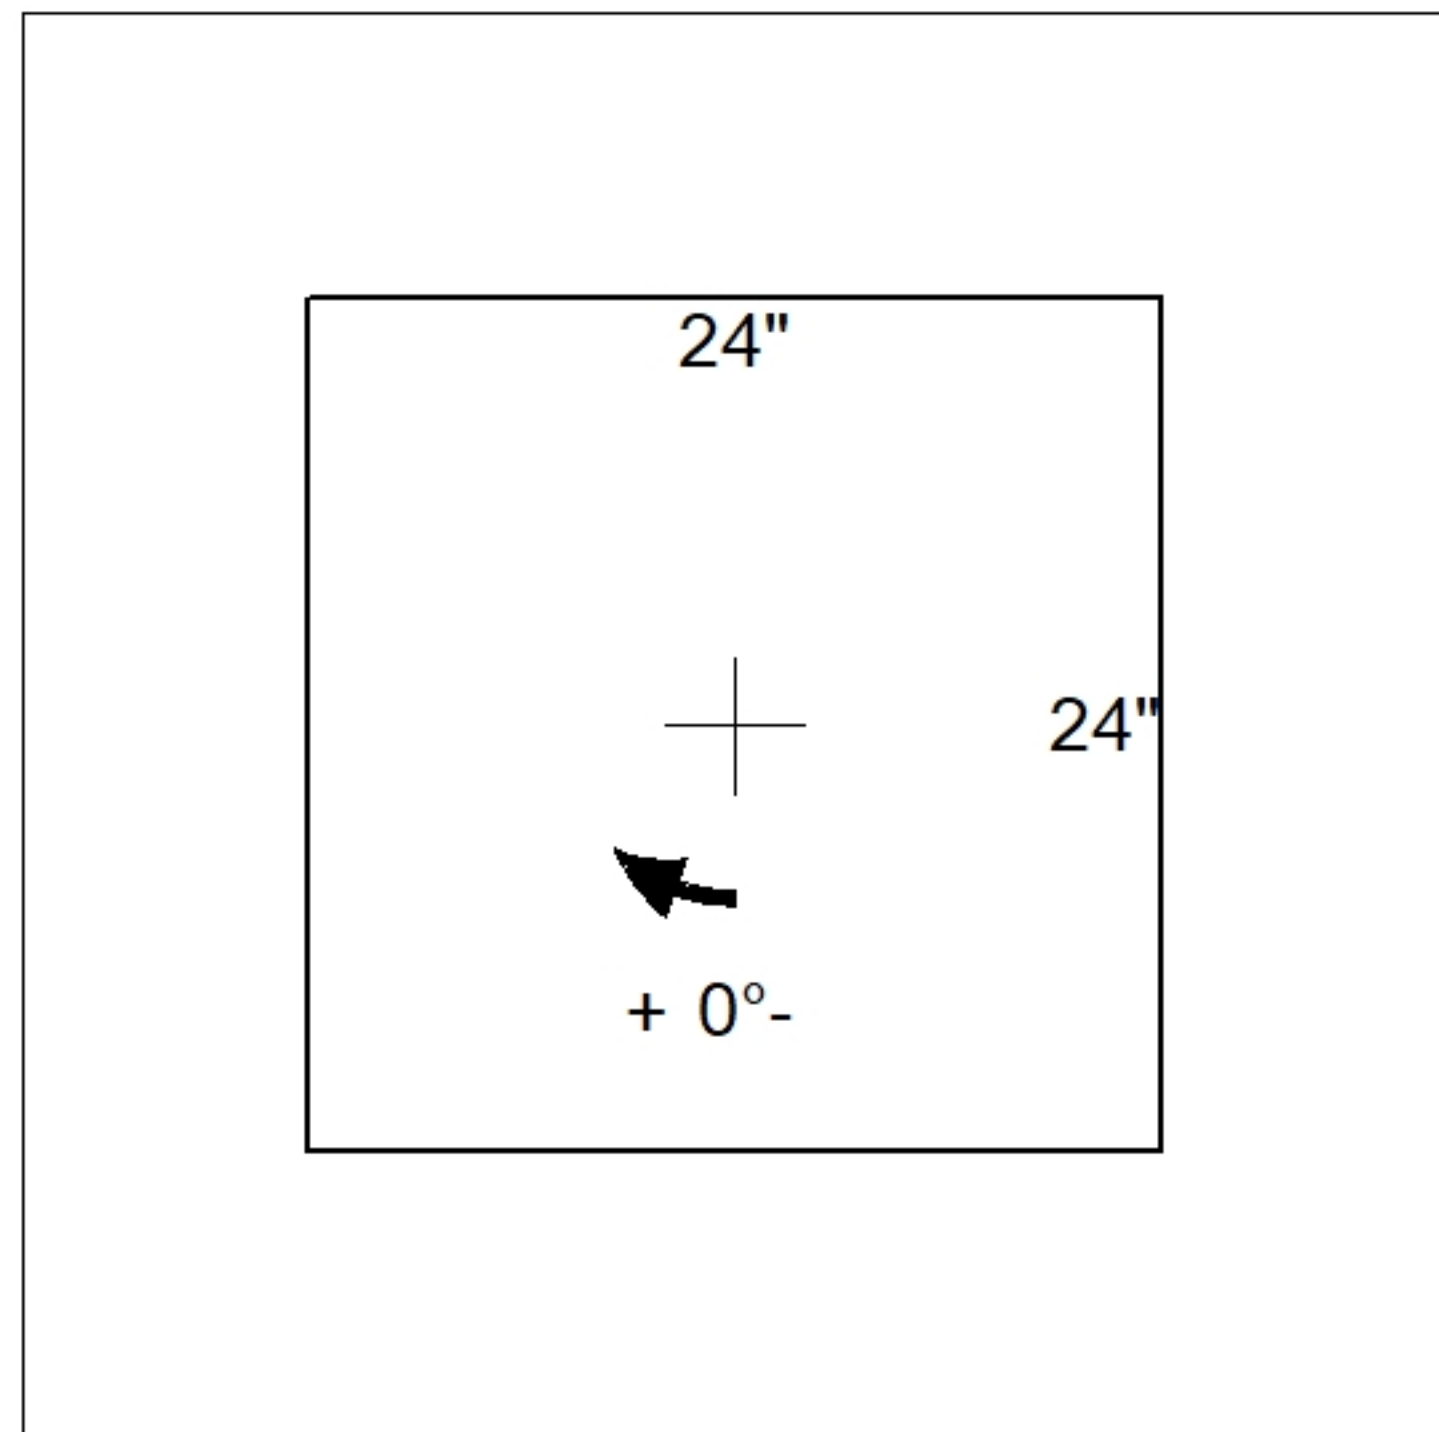

Coating (Int): Coating (Ext):	Seam Up: Flat Seam Dn: Flat	Wall Thickness: 8"	Height (Ext): 3"	Weight (Net): 258 lb Volume (Net): 0.07cu.yd
----------------------------------	--------------------------------	--------------------	------------------	---