

Job Name: 25-3552 ADS Beau Henry Villa
 Job Location: Bowling Green, KY
 Contractor: ADS Advances Drainage Systems, Inc.

Plant: Beaver Dam

Tech: J. Coppage

11/4/2025 9:21:19 AM

PC: C. Goff



Structure ID: 6,1

P3 MH048RS24

MH RISER

- P6) 24" - CASTING HEIGHT - 7"
- P5) 24" - GRADE RING - 3"
- P4) 48" - MH FLAT LID w/24" Center Hole - 12"
- P3) 48" - MH RISER - 24"
- P2) 48" - MH RISER - 72"
- P1) 48" - MH BASE - 72"
- 1) PSASSEMBLY
- 1) CASTING - HOE MC-375 F/C Storm
- 3) 48" - Conseal CS-102 1.00"
- 2) Hole - 24



- Structure Notes:**
1. JR HOE MC-375 STORM PROVIDED BY ICAST.
 2. PER ASTM C478 SPECIFICATIONS.
 3. CONCRETE = 4,000 PSI AT 28 DAYS.
 4. REINFORCING PER ASTM A615 (GRADE 60).
 - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W..
 - RISER/WALLS (As .12)
 - FLOOR (As .31) #5 BARS AT 12" C.C.E.W.
 5. LIFTING ANCHORS TO BE INSTALLED ON THE OUTSIDE OF THE STRUCTURE.

Structure Total: 14725 lb


Rim: 541.32' Rim to Invert: 8.77' Slack: 0.2" Sump: 84.96" Step Position:

Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up (L)	Offset
Invert 1										
Invert 2										
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										

RIGHT-SIDE UP VIEW (int. dimensions)

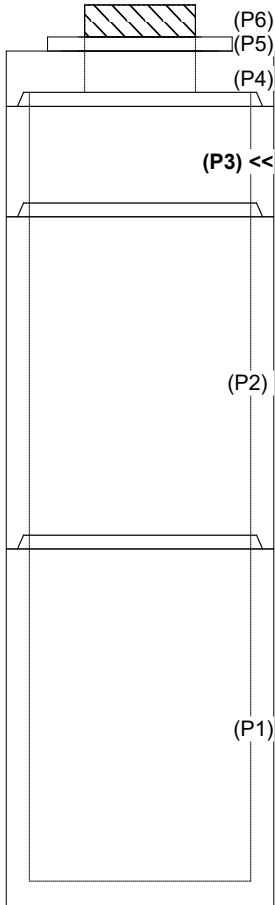

INSIDE WALL DIMENSIONS

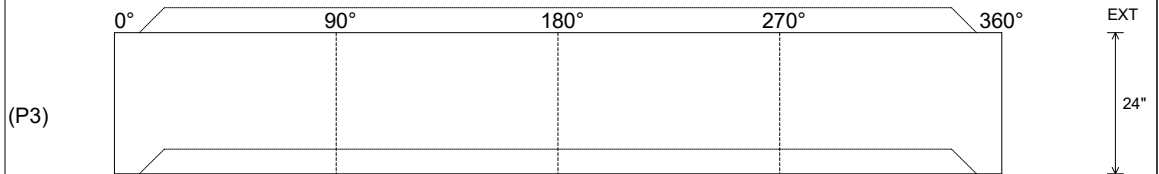

Coating (Int):
 Coating (Ext):

Seam Up: Tongue
 Seam Dn: Groove

Wall Thickness: 5"
 Floor Height: 0"

Height (Int): 24"
 Height (Ext): 24"

Weight (Net): 1677 lb
 Volume (Net): 0.43cu.yd