




THIS DRAWING IS INTENDED TO BE PRINTED IN COLOR.

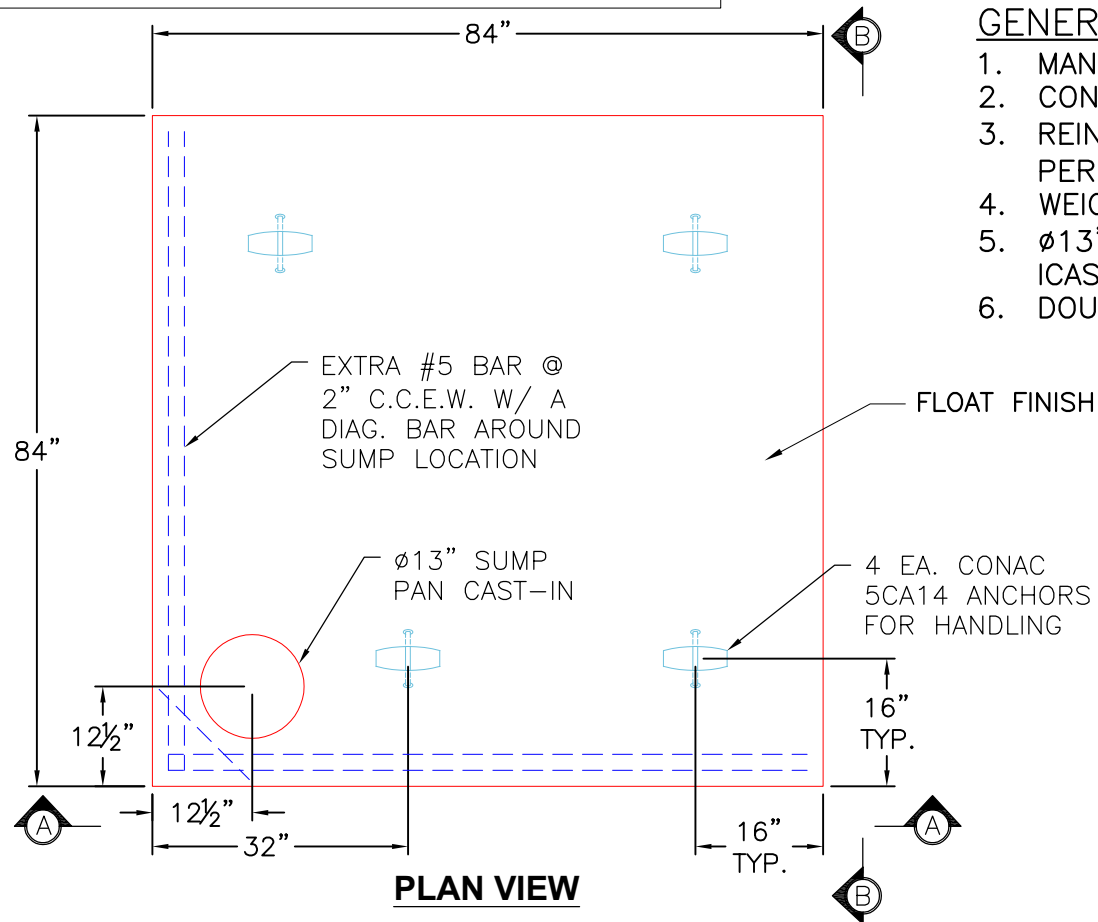

PLAN VIEW

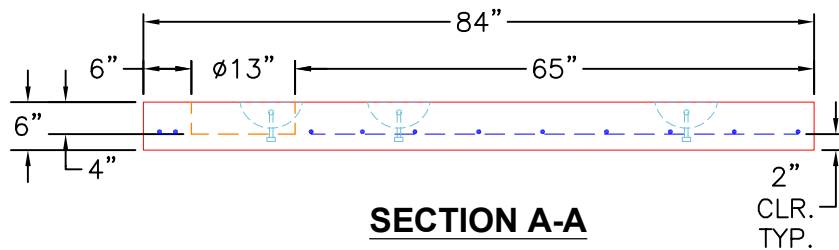

SECTION A-A

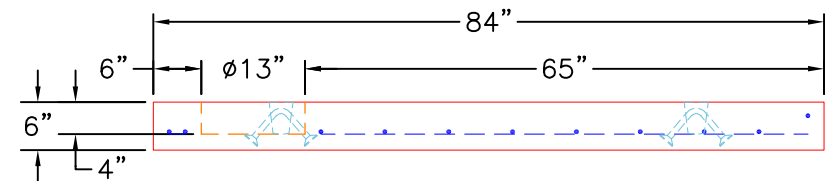

SECTION B-B

GENERAL NOTES:

1. MANUFACTURED TO ASTM C-913 (LATEST REVISION).
2. CONCRETE: 5,000 PSI AT 28 DAYS.
3. REINFORCING: #5 BAR @ 8" O.C. E.W. PER ASTM A615. (GRADE 60).
4. WEIGHT: 3,552 LBS
5. ø13" X 4" DEEP SUMP PAN W/ LID PROVIDED BY ICAST. CAST-IN
6. DOUBLE ROLL CS-102 JOINT SEALANT.

PRODUCTION WORK ORDER



QUALITY CONTROL CHECKLIST

- ☐ ALL DIMENSIONS CORRECT.
- ☐ LIFTERS INSTALLED.
- ☐ HATCH CORRECT LOCATION.
- ☐ REINFORCING CORRECT.
- ☐ SURFACE QUALITY ACCEPTABLE.
- ☐ EDGES CHAMFERED.
- ☐ ALL PATCHWORK ACCEPTABLE.

PRODUCT I.D.: CBS

PRODUCT VIEW: RIGHT SIDE UP

PLANT: BEAVER DAM, KY.

WEIGHT: 3,552 LBS.

TOP SECTION JOINT: FLAT

BASE SECTION JOINT: N/A

QC CHECK INITIALS:

DESCRIPTION: 84" X 84" X 6" THICK VAULT BASE SLAB

CUSTOMER: CUMBERLAND VALLEY CONSTRUCTORS

PROJECT: RESERVOIR REHABILITATION

STRUCTURE: VAULT 6 (MILLS RD. VAULT)

ORDER NO: 25-4238

PC: A. CHAMBERS

DRAWING: S. FELLETER

DATE: 09/10/26

SCALE: NTS

PG. 1 of 1