


Contractor: CITCO Water



Plant: 100



Slack: 0"

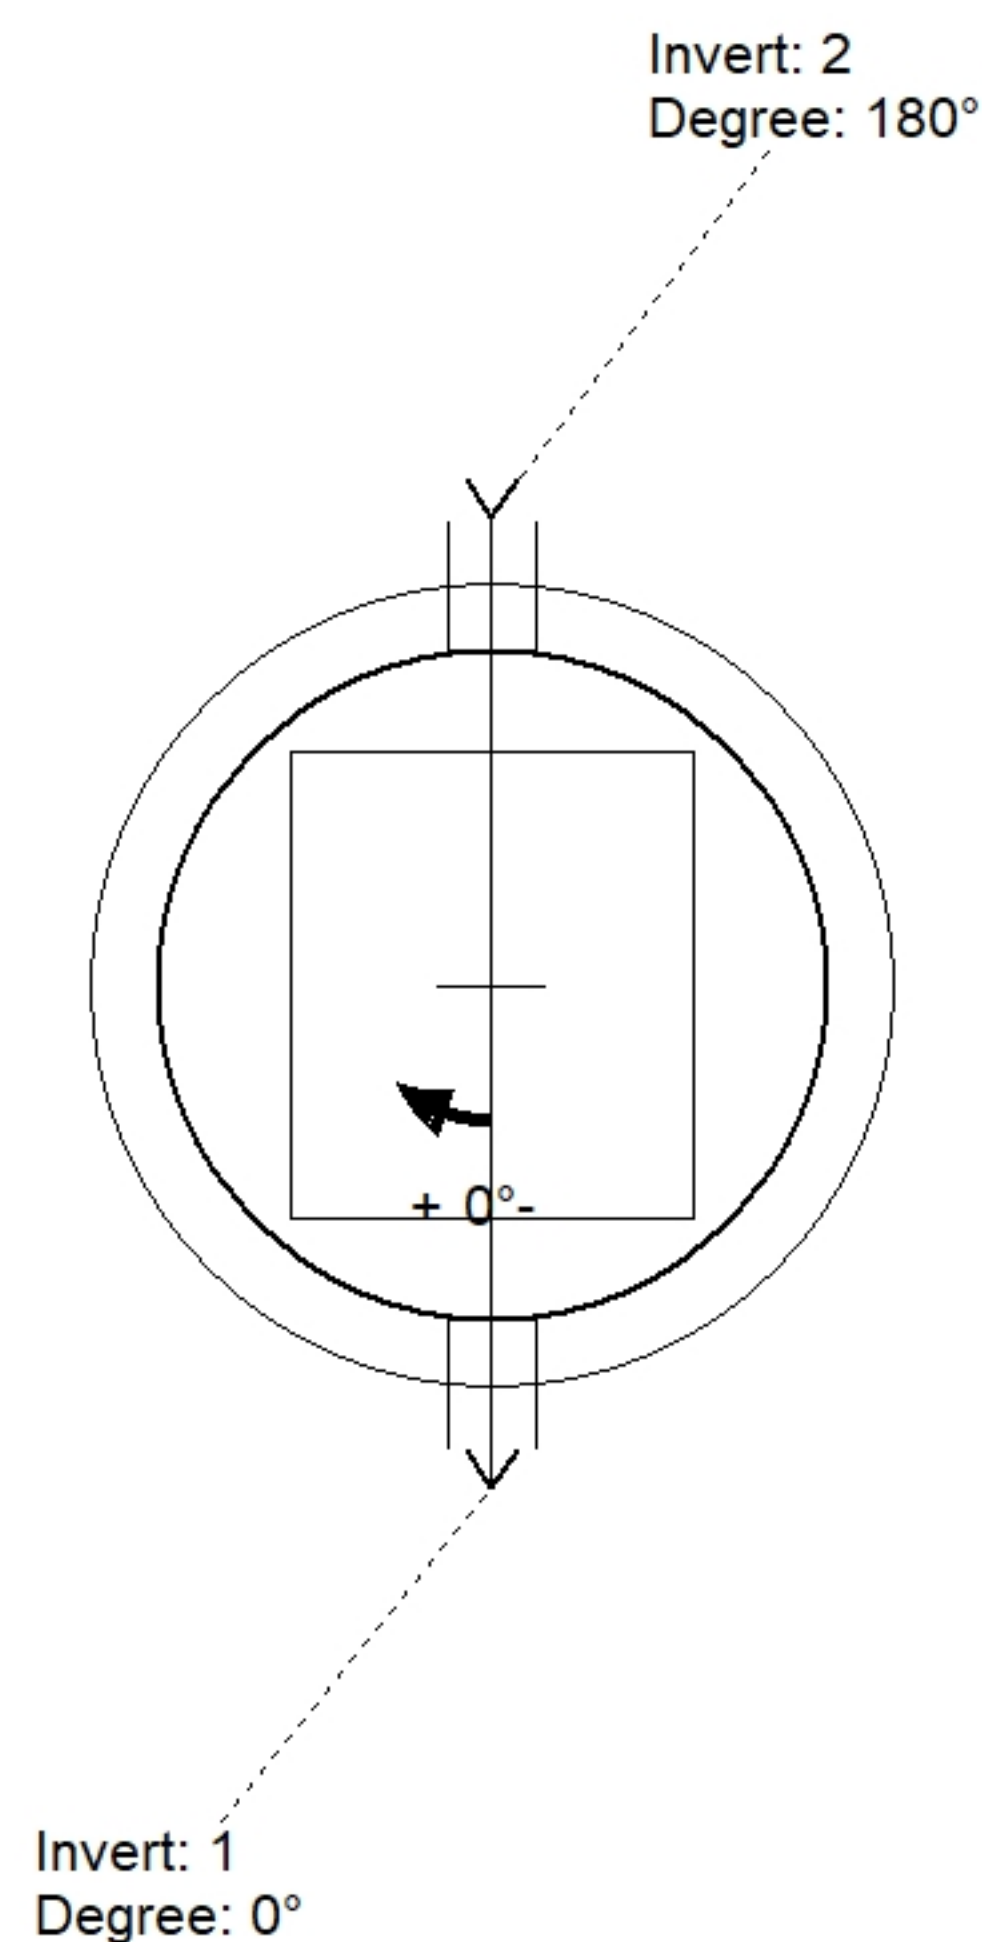

Position	Elev	Angle	Pipe	Pipe OD	Hole	Connector	Up (')	Ref
Rim	6'							
Reducer								
Invert 1	1.667'	0°	4" PVC SDR21	4.375"	8"	Hole 8	18"	P1
Invert 2	1.667'	180°	4" PVC SDR21	4.375"	8"	Hole 8	18.004"	P1
Invert 3								
Invert 4								
Invert 5								
Invert 6								
Invert 7								
Invert 8								

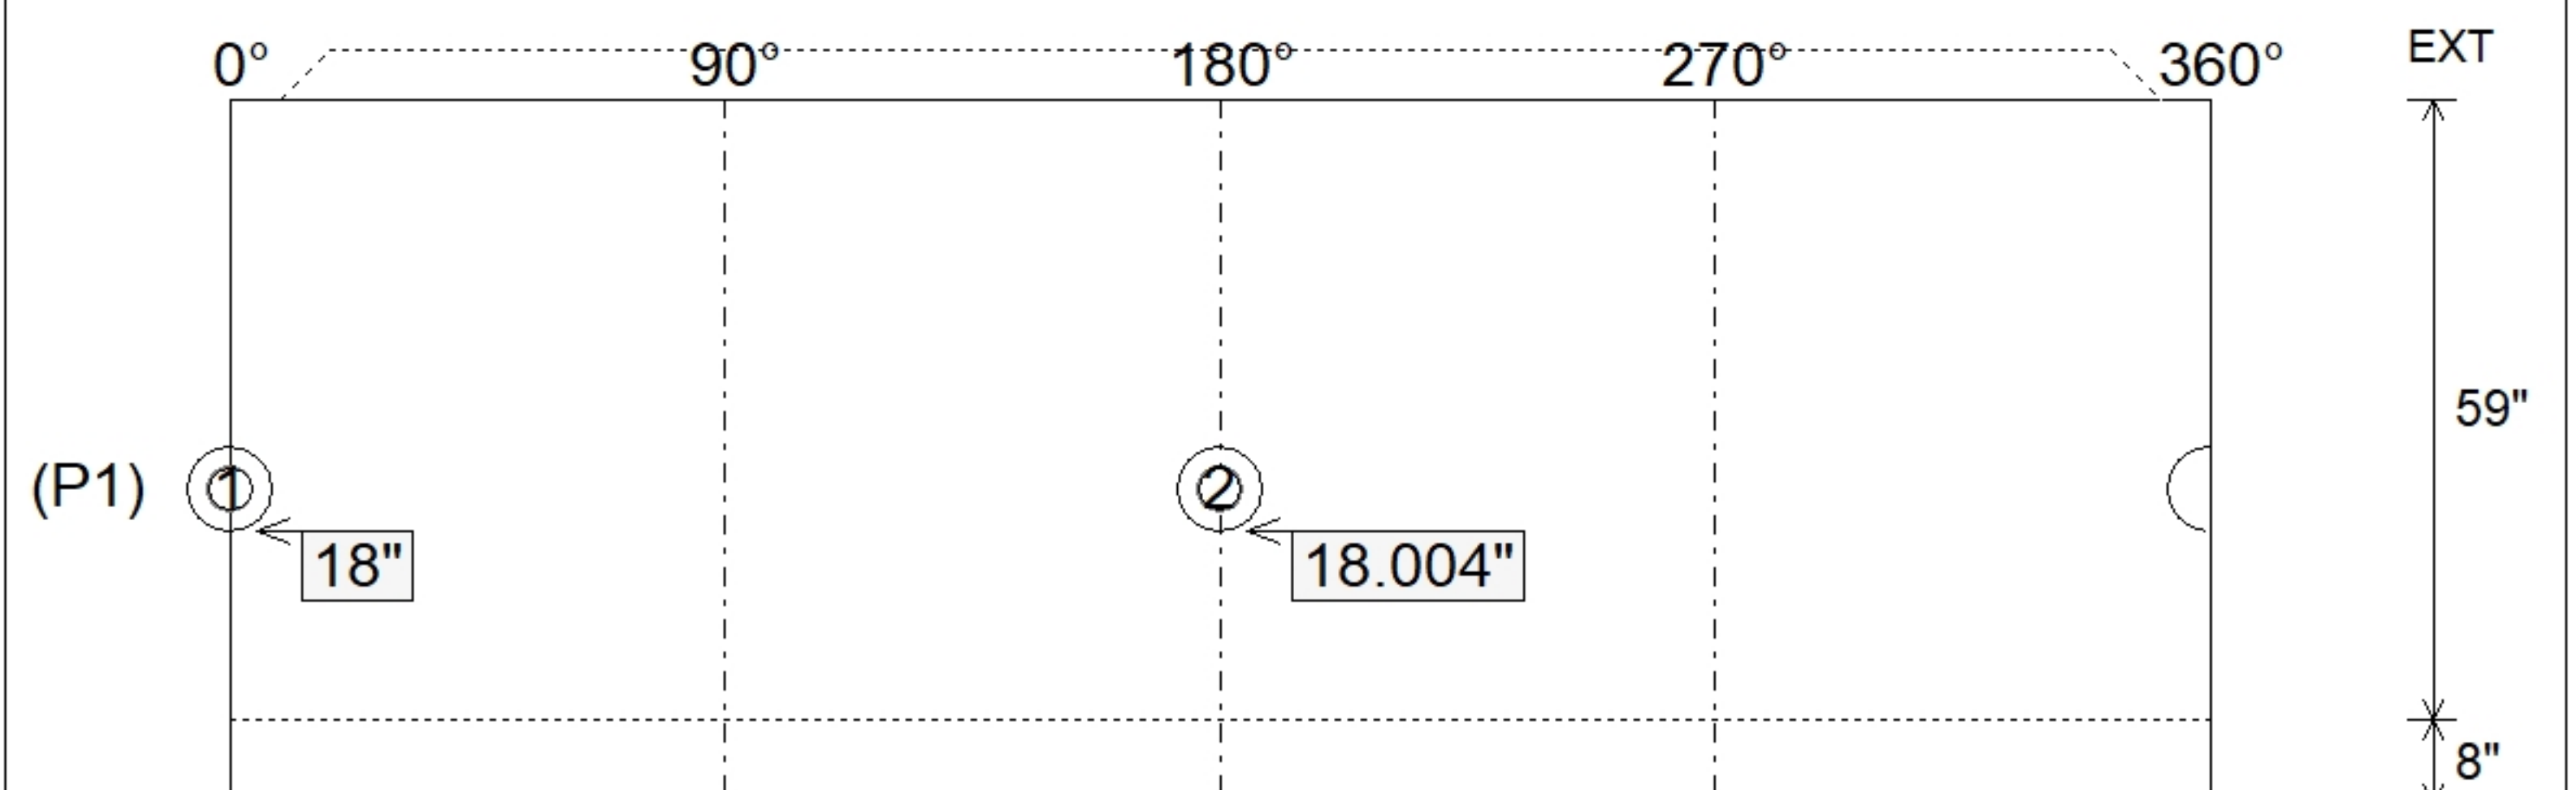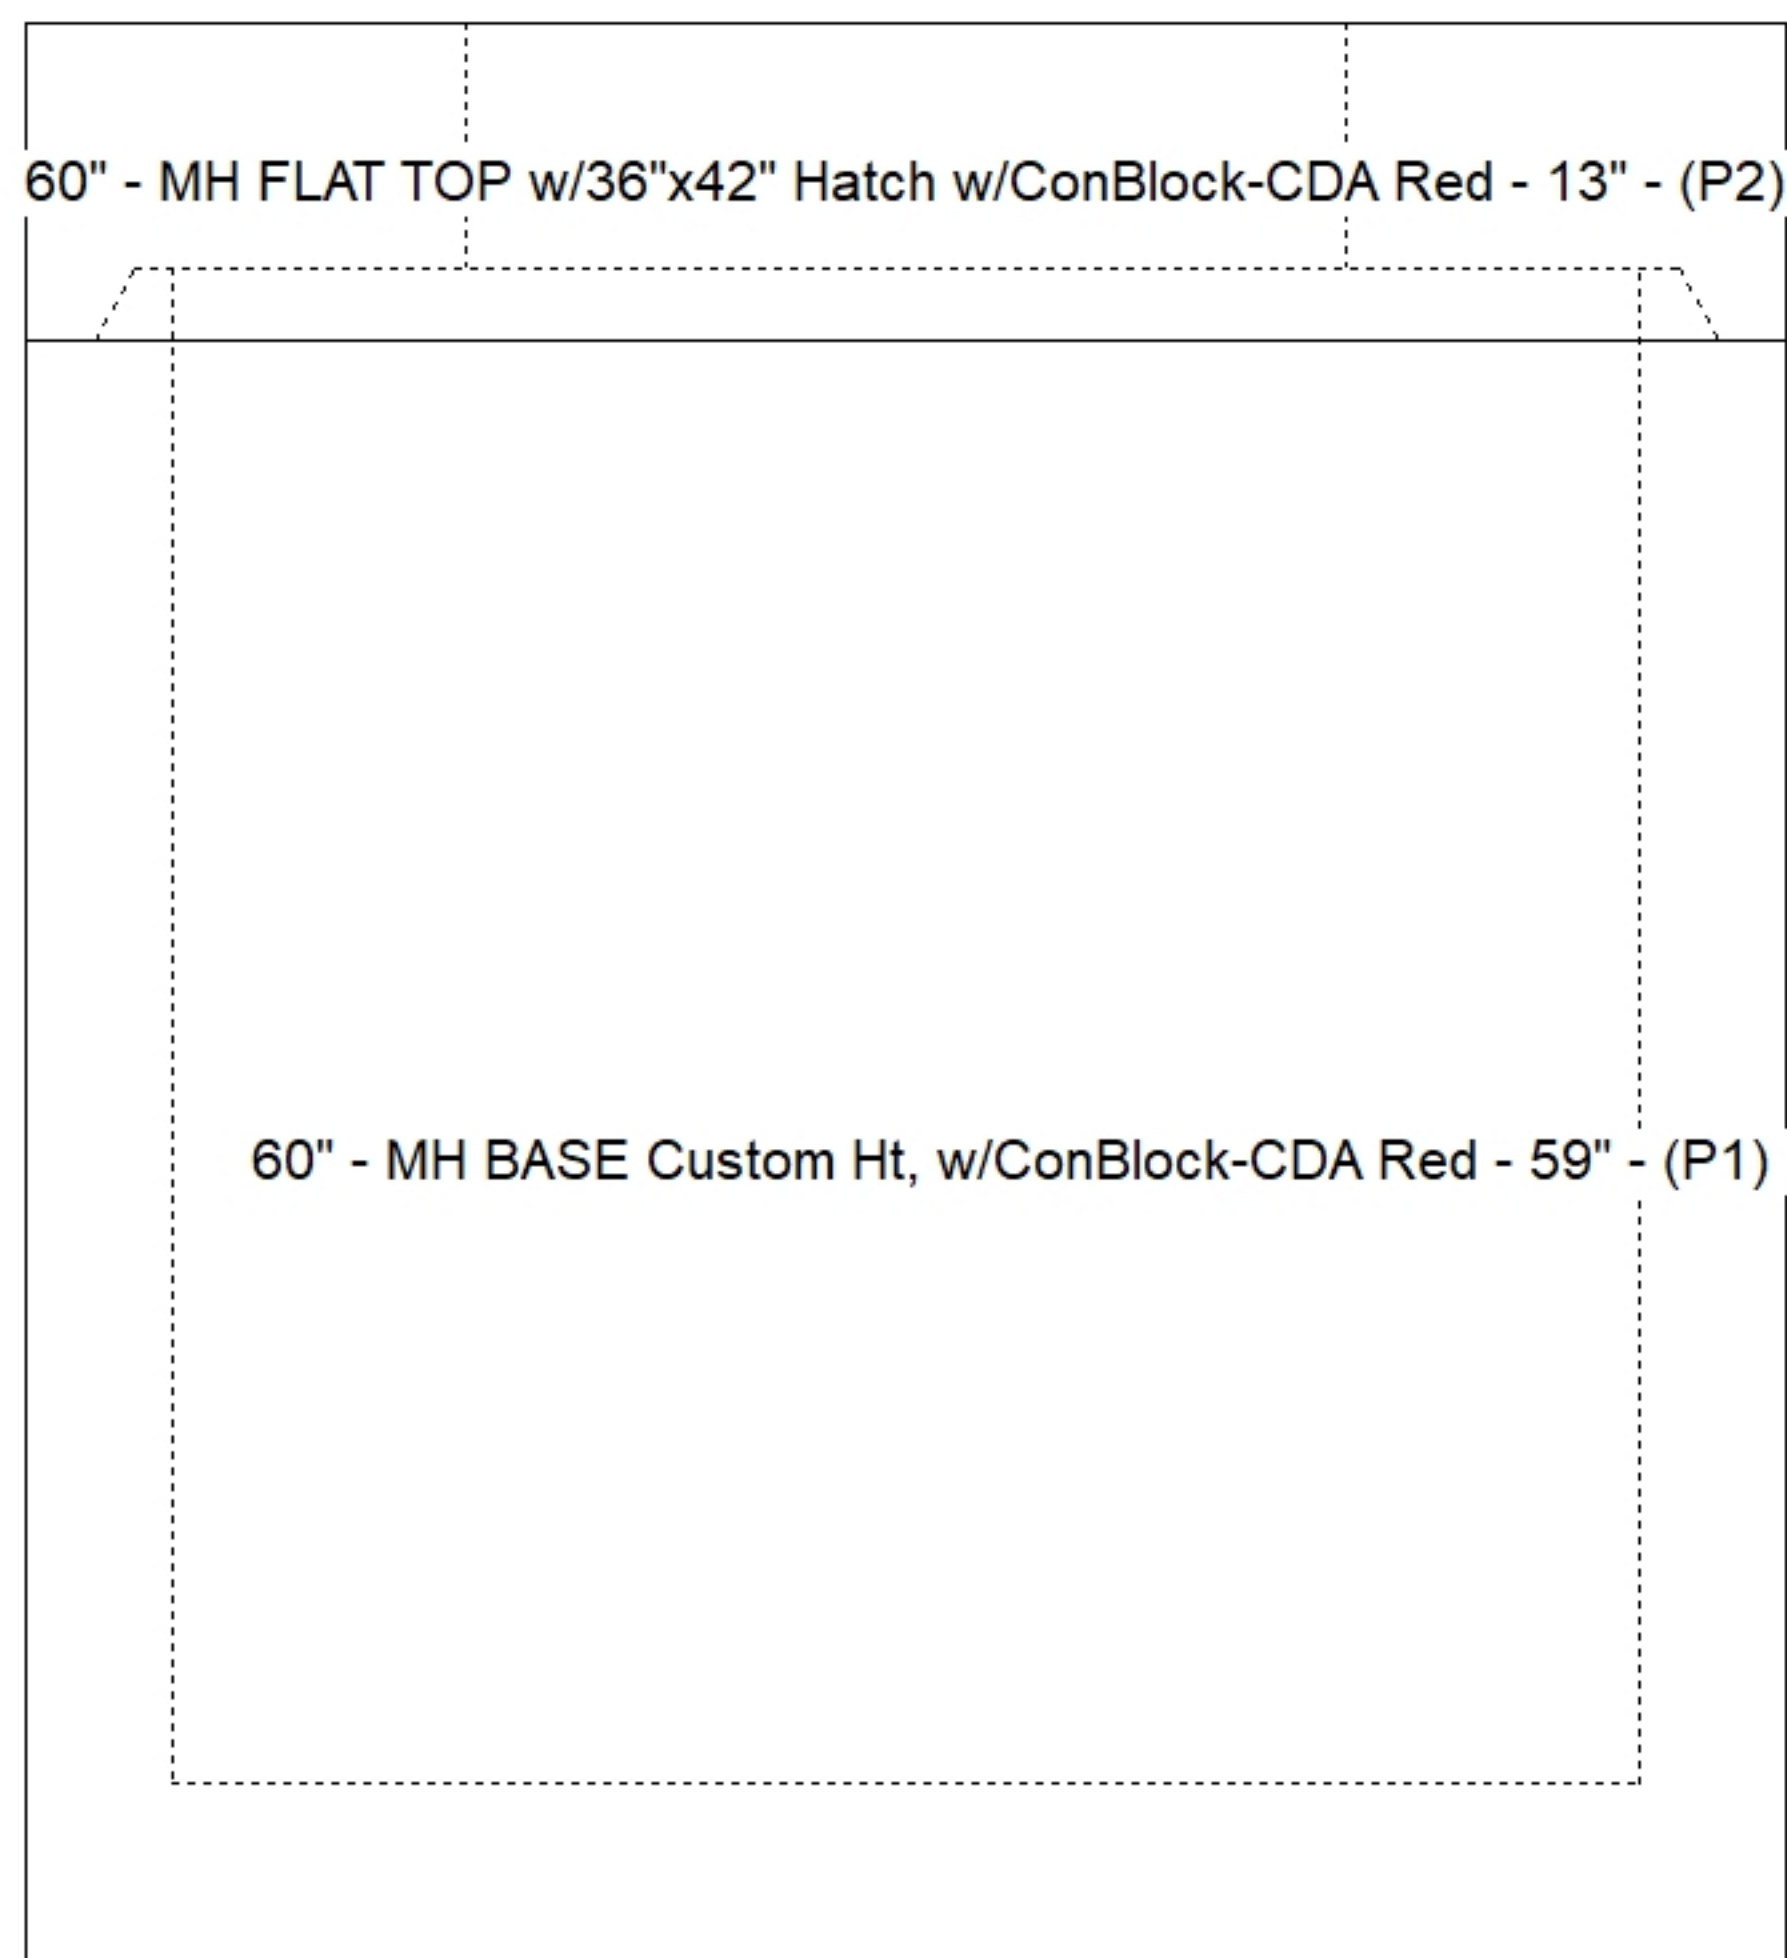

SUBMITTAL
APPROVED BY: