

Job Name: 25-4299 - Seneca High School
 Job Location: Louisville, KY
 Contractor: Dan Cristiani Excavating Co. Inc.

Plant: 100
 2/10/2026 8:24:07 AM

Tech: J. Horsley
 PC: J. Jarvis



Structure ID: A15

P1 MH060BAVF

MH BASE Custom Ht F/n

P3) 24" x 24" - CASTING HEIGHT - 4"
 P2) 60" - MH FLAT TOP SPEC. HT. (6") w/24"x24" Hole F/F - 6"
 P1) 60" - MH BASE Custom Ht F/n - 32"
 1) 60" - Conseal CS-102 1.00"
 2) Hole - 30
 1) Hole - 24

0 lb
 1760 lb
 5101 lb
 0 lb
 0 lb
 0 lb

 6861 lb

Structure Total: 6861 lb



Structure Notes:
 1. PER LOUISVILLE MSD / ASTM C-478 SPECIFICATIONS
 2. CONCRETE: 4,000 PSI AT 28 DAYS
 3. REINFORCEMENT: PER ASTM A615
 4. NO STORM INVERT
 5. NO STEPS
 6. HOE 280T FRAME & GRATE SUPPLIED BY OTHERS

Rim: 486.6' Rim to Invert: 3.55' Slack: 0.6" Sump: 0" Step Position:


Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	483.05'	0°	0"	24" HDPE	27.8"	Hole 30	30"	31.416"	-1.9"	0"
Invert 2	483.05'	147°	92.363"	18" HDPE	21.2"	Hole 24	24"	24.691"	-1.6"	0"
Invert 3	483.05'	287°	180.327"	24" HDPE	27.8"	Hole 30	30"	31.416"	-1.9"	0"
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										

RIGHT-SIDE UP VIEW (int. dimensions)

UPSIDE-DOWN VIEW (int. dimensions)

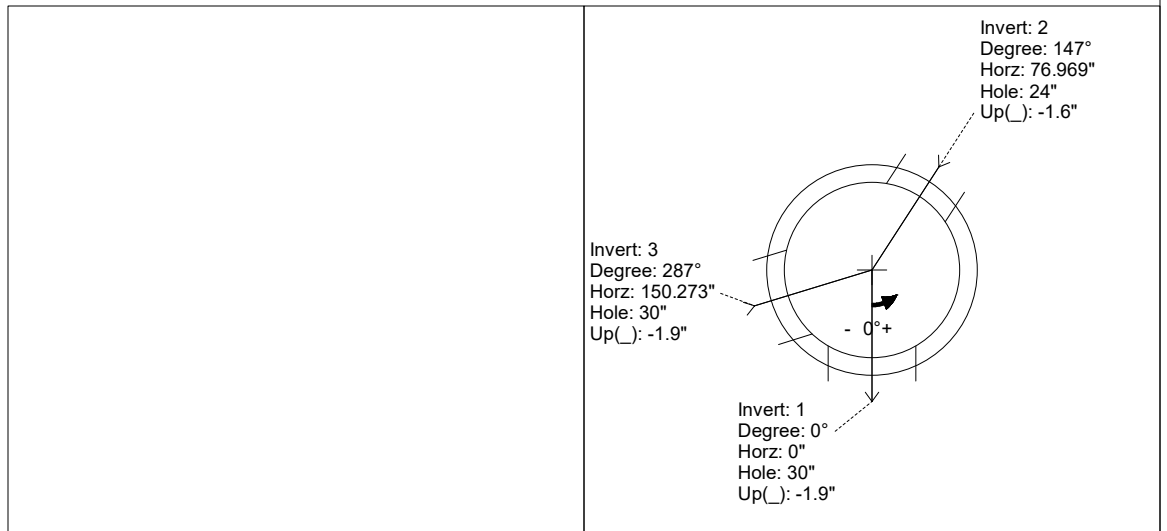

INSIDE WALL DIMENSIONS

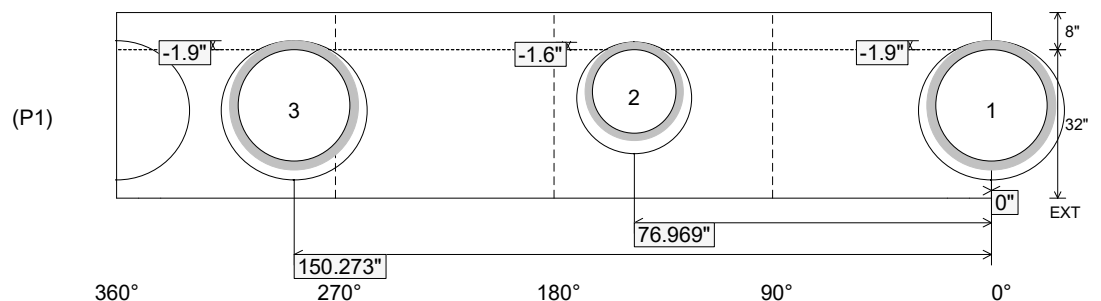

Coating (Int):
 Coating (Ext):

Seam Up: Flat
 Seam Dn: n/a

Wall Thickness: 6"
 Floor Height: 8"

Height (Int): 32"
 Height (Ext): 40"

Weight (Net): 5101 lb
 Volume (Net): 1.3cu.yd