

Job Name: 25-4299 - Seneca High School  
 Job Location: Louisville, KY  
 Contractor: Dan Cristiani Excavating Co. Inc.

Plant: 100  
 2/17/2026 12:47:02 PM

Tech: J. Horsley  
 PC: J. Jarvis



**Structure ID: I7**

**P1 BX1818-06BA18**

**BOX BASE 6inW, 6inF F/n**

P2) 18" x 18" - CASTING HEIGHT - 4"  
 P1) 18" x 18" - BOX BASE 6inW, 6inF F/n - 18"  
 1) 18" x 18" - Conseal CS-102 1.00"  
 1) Hole - 14

0 lb  
 1246 lb  
 0 lb  
 0 lb  
 -----  
 Structure Total: 1246 lb



- Structure Notes:**
- PER LOUISVILLE MSD / ASTM C-913 SPECIFICATIONS
  - CONCRETE: 4,000 PSI AT 28 DAYS
  - REINFORCEMENT: #5 BAR @ 12" C.C. E.W. (GRADE 60) - 2" MIN. REBAR CLEARANCE (TYP)
  - NO STORM INVERT
  - NO STEPS
  - HOE 165-A FRAME & GRATE SUPPLIED BY OTHERS

Rim: 481.95' Rim to Invert: 1.9' Slack: 0.8" Sump: 0" Step Position:


Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ( )	Offset
Invert 1	480.05'	0°	15"	10" HDPE	11.4"	Hole 14	14"	14"	-0.7"	0"
Invert 2										
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										

RIGHT-SIDE UP VIEW (int. dimensions)

UPSIDE-DOWN VIEW (int. dimensions)

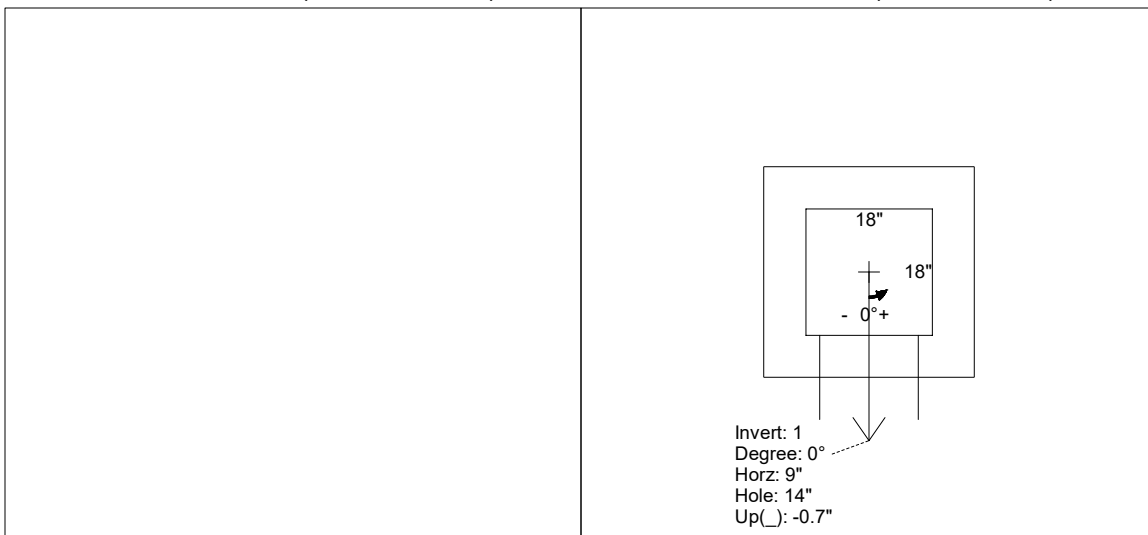

INSIDE WALL DIMENSIONS

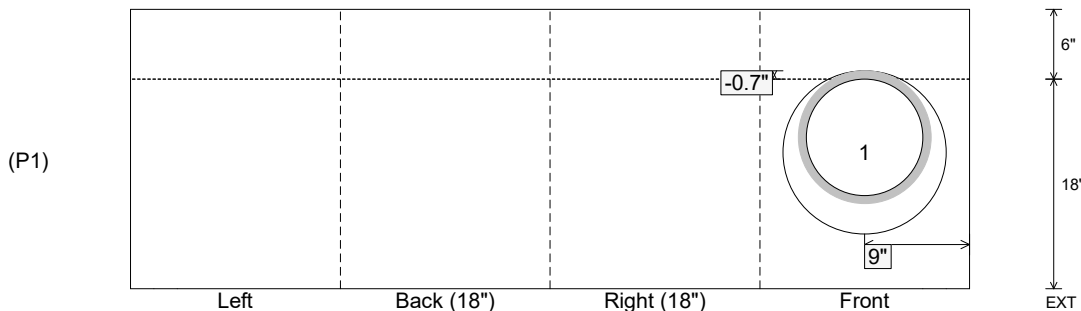

Coating (Int):  
 Coating (Ext):

Seam Up: Flat  
 Seam Dn: n/a

Wall Thickness: 6"  
 Floor Height: 6"

Height (Int): 18"  
 Height (Ext): 24"

Weight (Net): 1246 lb  
 Volume (Net): 0.32cu.yd