

Job Name: 25-4403 - Old Heritage Subdivision Section 6	Plant: 100	Tech: J. Horsey - F	
Job Location: Shelbyville, KY 40065	1/3/2026 12:52:04 PM	PC: C. Goff	
Contractor: Filcon Construction			

Structure ID: 10+73.16 LN 14

P1 BX2436-08BVF

BOX BASE 8inW, 8inF, Variable Ht F/n

P2) 24" x 36" - CASTING HEIGHT - 4"
P1) 24" x 36" - BOX BASE 8inW, 8inF, Variable Ht F/n - 32"
1) 24" x 36" - Conseal CS-102 1.00"
1) Hole - 16

0 lb
4527 lb
0 lb
0 lb

Structure Total: 4527 lb



Structure Notes:
1. PER MSD CB TYPE 2 / ASTM C-913 SPECIFICATIONS
2. CONCRETE: 4,000 PSI AT 28 DAYS
3. REINFORCEMENT: #5 BAR @ 12" C.C. E.W. (GRADE 60) - 2" MIN. REBAR CLEARANCE (TYP)
4. NO INVERT CHANNEL
5. NO STEPS
6. CASTING SUPPLIED BY OTHERS

Rim: 785.9' Rim to Invert: 3.04' Slack: 0.48" Sump: 0" Step Position:


Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up ()	Offset
Invert 1	782.86'	90°	26"	12" HDPE	14.5"	Hole 16	16"	16"	-1.25"	0"
Invert 2										
Invert 3										
Invert 4										
Invert 5										
Invert 6										
Invert 7										
Invert 8										

RIGHT-SIDE UP VIEW (int. dimensions)

UPSIDE-DOWN VIEW (int. dimenions)

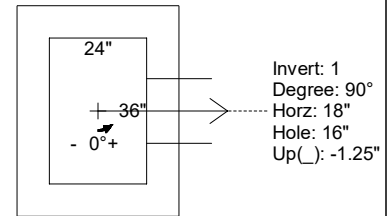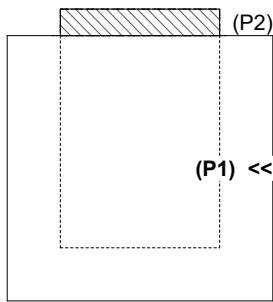

INSIDE WALL DIMENSIONS

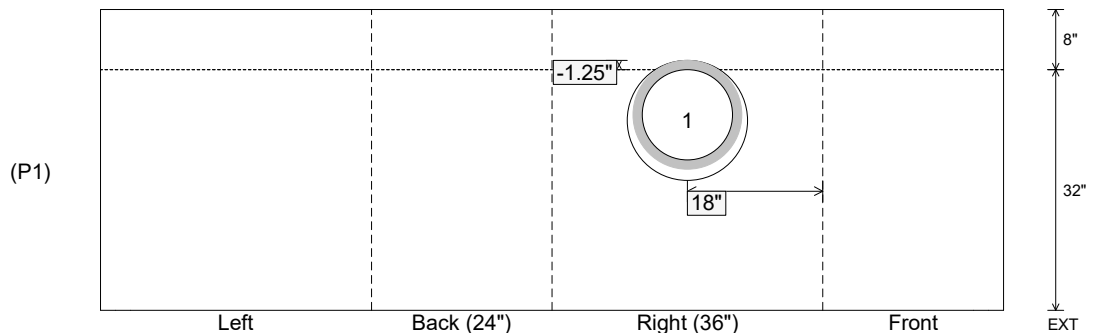

Coating (Int): Coating (Ext):	Seam Up: Flat Seam Dn: n/a	Wall Thickness: 8" Floor Height: 8"	Height (Int): 32" Height (Ext): 40"	Weight (Net): 4527 lb Volume (Net): 1.16cu.yd
----------------------------------	-------------------------------	--	--	--