


4 EA. 5CA14 CONAC A-ANCHORS FOR PLANT & FIELD HANDLING

**PLAN VIEW
(UPSIDE DOWN)**


GENERAL NOTES:

1. MANUFACTURED PER ASTM C-913 SPECIFICATIONS
2. CONCRETE: 5,000 PSI AT 28 DAYS
3. REINFORCEMENT: #5 BAR @ 6" C.C. E.W. (GRADE 60) - 2" MIN. REBAR CLEARANCE (TYP)
4. WEIGHT: 17,415 LBS
5. ALUMINUM LADDER & SAFETY POST SUPPLIED BY OTHERS
6. LINK-SEAL CONNECTORS SUPPLIED BY OTHERS
7. LIFTERS: 4 EA. 5CA14 CONAC A-ANCHORS FOR PLANT & FIELD HANDLING

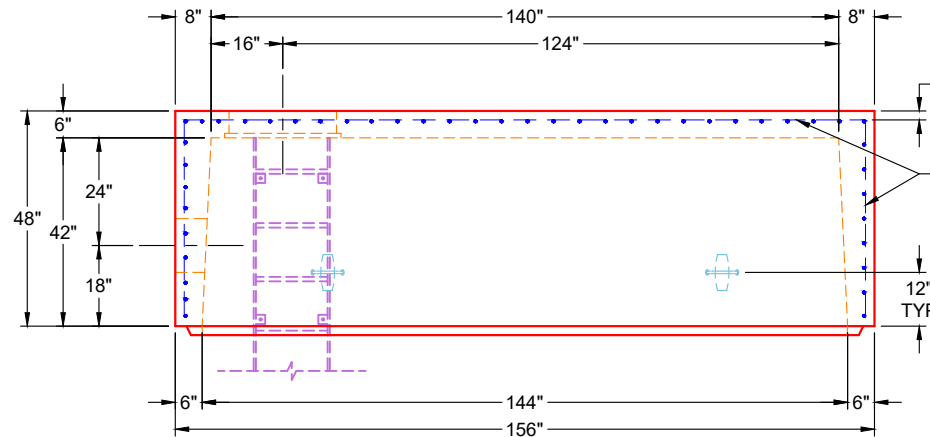

**VIEW A
(UPSIDE DOWN)**

2" MIN. CLR. (TYP)
#5 BAR @ 6" C.C. E.W. (GRADE 60) - TYP WALLS & FLOOR
ALUMINUM LADDER & SAFETY POST SUPPLIED BY OTHERS

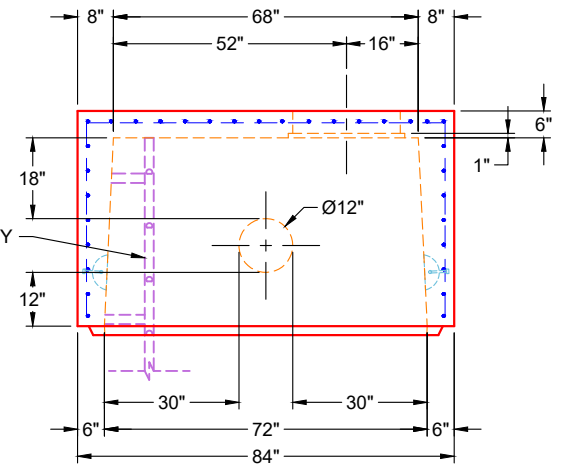

**VIEW B
(UPSIDE DOWN)**

PRODUCTION WORK ORDER		PRODUCT I.D.: BX072144-06W06F-VF	DESCRIPTION: 72" X 144" X 42" BASE, 6" WALLS & 6" FLOOR		
	QUALITY CONTROL CHECKLIST	PRODUCT VIEW: UPSIDE DOWN	CUSTOMER: STRIEGEL DESIGN & CONSTRUCTION		
	<input type="checkbox"/> ALL DIMENSIONS CORRECT. <input type="checkbox"/> LIFTERS INSTALLED. <input type="checkbox"/> HOLE LOCATION(S) CORRECT. <input type="checkbox"/> REINFORCING & SPACING CORRECT. <input type="checkbox"/> SURFACE QUALITY ACCEPTABLE. <input type="checkbox"/> EDGES CHAMFERED. <input type="checkbox"/> JOINT INSTALLED.	PLANT: BEAVER DAM, KY	PROJECT: 2025 NEW WELL FIELDS		
		WEIGHT: 17,415 LBS	STRUCTURE: 2-54406-9		
		TOP SECTION JOINT: N / A	ORDER NO: 25-4406		
		BASE SECTION JOINT: TONGUE	PE: J.H. ROSS	DRAWING: K. CARDWELL	
		QC CHECK INITIALS:	DATE: 02/11/26	SCALE: NTS	PG. 1 OF 1