

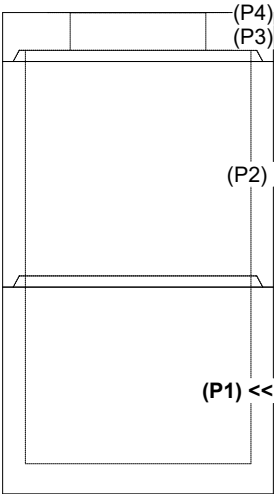
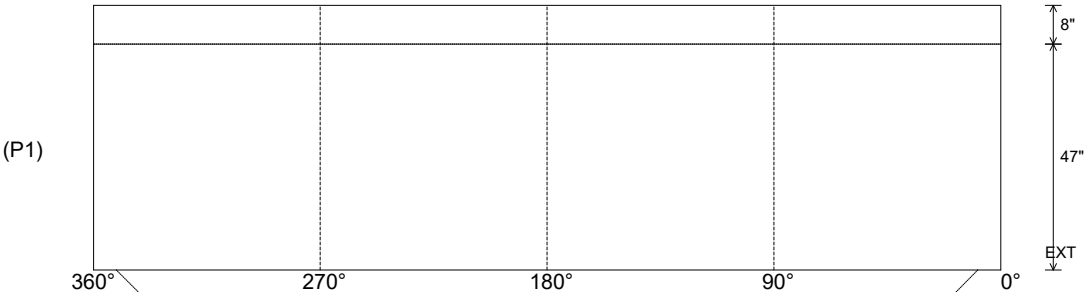


Job Name: 25-4547 - WWTP Improvements & Hydraulic Expansion					Plant: 100		Tech: Jared - F																										
Job Location: Shepherdsville, KY					6/4/2026 5:54:14 PM		PC: J Jarvis																										
Contractor: Pace Contracting, LLC																																	
Structure ID: METER VAULT 2																																	
P1 MH060BAVF			MH BASE Custom Ht T/n																														
P4) 36" x 36" - CASTING HEIGHT - 0" P3) 60" - MH FLAT TOP w/36"x36" Hatch F/G - 13" P2) 60" - MH RISER T/G - 60" P1) 60" - MH BASE Custom Ht T/n - 47" 1) HATCH (Alum.) - HALLIDAY W1S 36"x36" 2) 60" - Conseal CS-102 1.00" (Double) 1) 36" x 36" - Conseal CS-102 1.00" (Double) 2) PSX - 8QRS DD					0 lb 2132 lb 6213 lb 7640 lb 78 lb 0 lb 0 lb 13 lb ----- Structure Total: 16075 lb		Structure Notes: 1. PER ASTM C478 SPECIFICATIONS. 2. CONCRETE = 4,000 PSI AT 28 DAYS. 3. HATCH SUPPLIED BY I-CAST (HALLIDAY W1S 36"X36") REINFORCING PER ASTM A615 (GRADE 60). - TOP SLAB (As .62) #5 BARS AT 6" C.C.E.W. - RISER/WALLS (As .18) - FLOOR (As .47) #5 BARS AT 12" C.C.E.W.																										
Rim: 454' Rim to Invert: 5.06' Slack: -0.002" Sump: 59.28" Step Position:																																	
Position	Elev	Angle	Ext. (cw)	Pipe	Pipe OD	Connector	Hole	Horz Size	Up (_)	Offset																							
Invert 1																																	
Invert 2																																	
Invert 3																																	
Invert 4																																	
Invert 5																																	
Invert 6																																	
Invert 7																																	
Invert 8																																	
RIGHT-SIDE UP VIEW (int. dimensions)  UPSIDE-DOWN VIEW (int. dimenions)   INSIDE WALL DIMENSIONS  <table><tr><td colspan="3">Coating (Int):</td><td colspan="2">Seam Up: Tongue</td><td colspan="2">Wall Thickness: 6"</td><td colspan="2">Height (Int): 47"</td><td colspan="2">Weight (Net): 7640 lb</td></tr><tr><td colspan="3">Coating (Ext):</td><td colspan="2">Seam Dn: n/a</td><td colspan="2">Floor Height: 8"</td><td colspan="2">Height (Ext): 55"</td><td colspan="2">Volume (Net): 1.95cu.yd</td></tr></table>												Coating (Int):			Seam Up: Tongue		Wall Thickness: 6"		Height (Int): 47"		Weight (Net): 7640 lb		Coating (Ext):			Seam Dn: n/a		Floor Height: 8"		Height (Ext): 55"		Volume (Net): 1.95cu.yd	
Coating (Int):			Seam Up: Tongue		Wall Thickness: 6"		Height (Int): 47"		Weight (Net): 7640 lb																								
Coating (Ext):			Seam Dn: n/a		Floor Height: 8"		Height (Ext): 55"		Volume (Net): 1.95cu.yd																								